


aLIGO: magnetometer near ITMY SUS coil driver in test stand setup

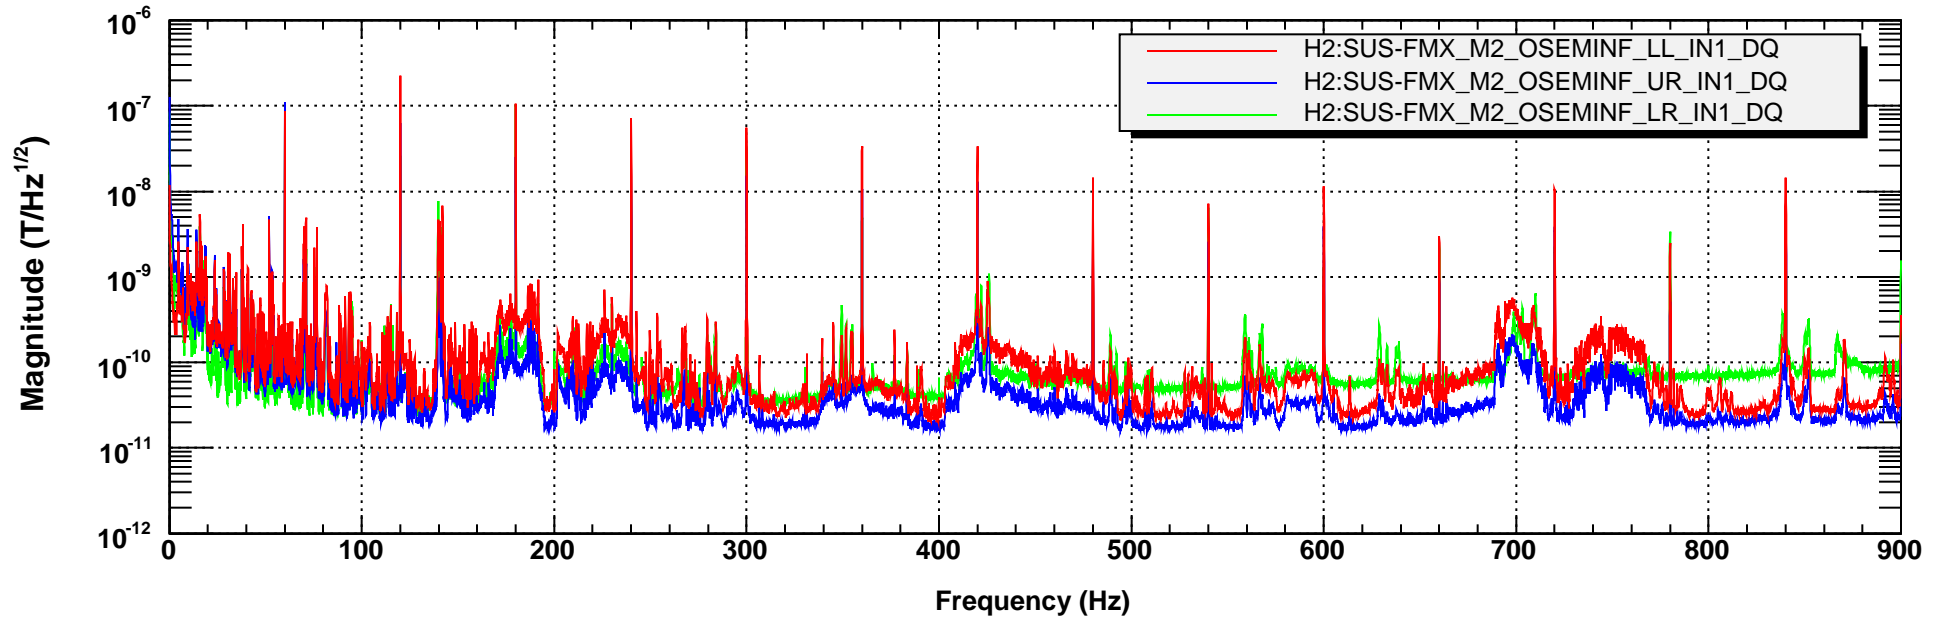


T0=17/08/2011 00:30:04

Avg=3/Bin=92

BW=0.00145929

iLIGO: magnetometer near ITM controller

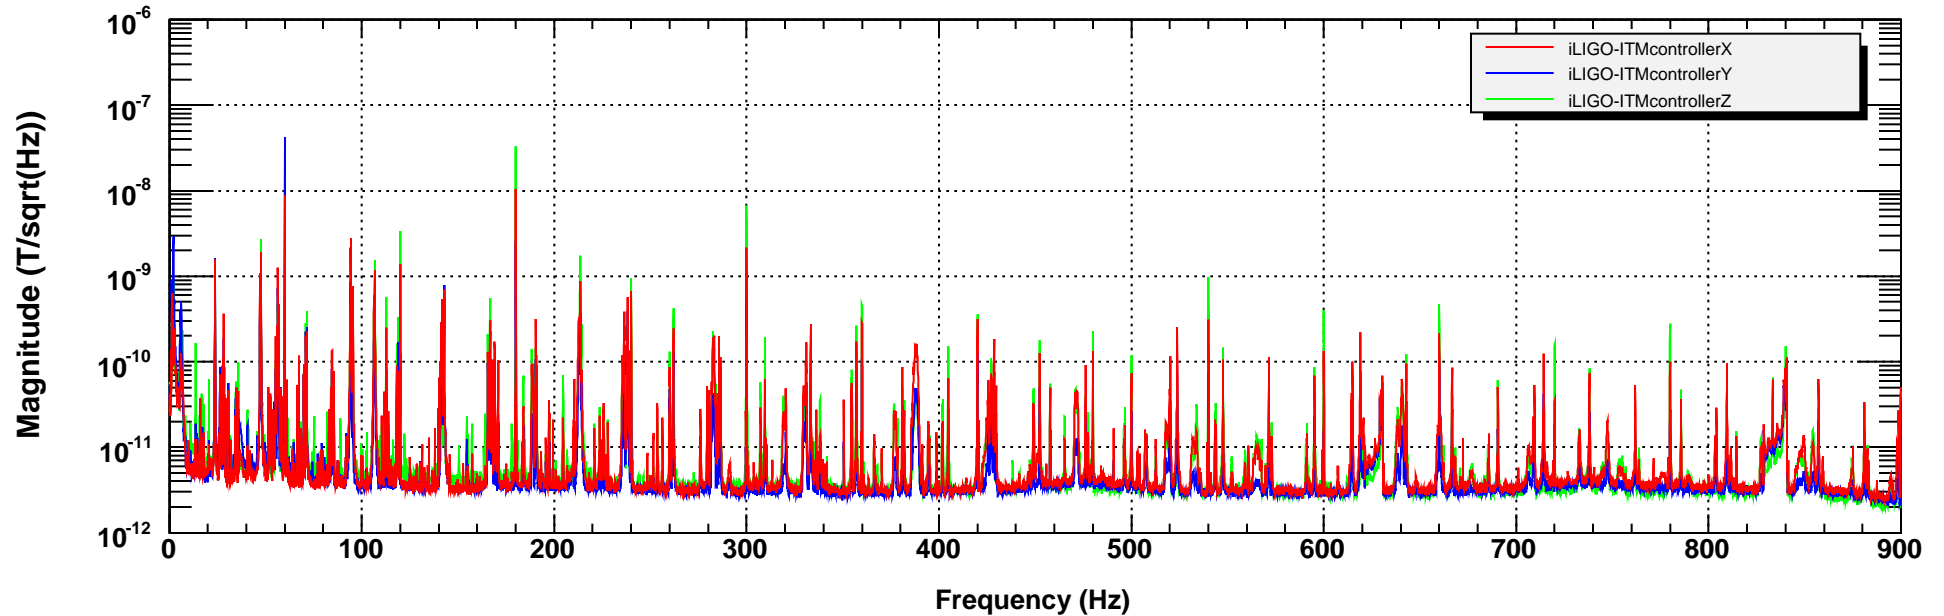

T0=06/01/1980 00:00:00

Avg=1/Bin=92

BW=0