



H1 SUS ETMY L1 Actuator Strength

$5.12\text{e-}11 \pm 8.6\text{e-}13 \text{ [m/ct]} (\pm 1.7\%)$

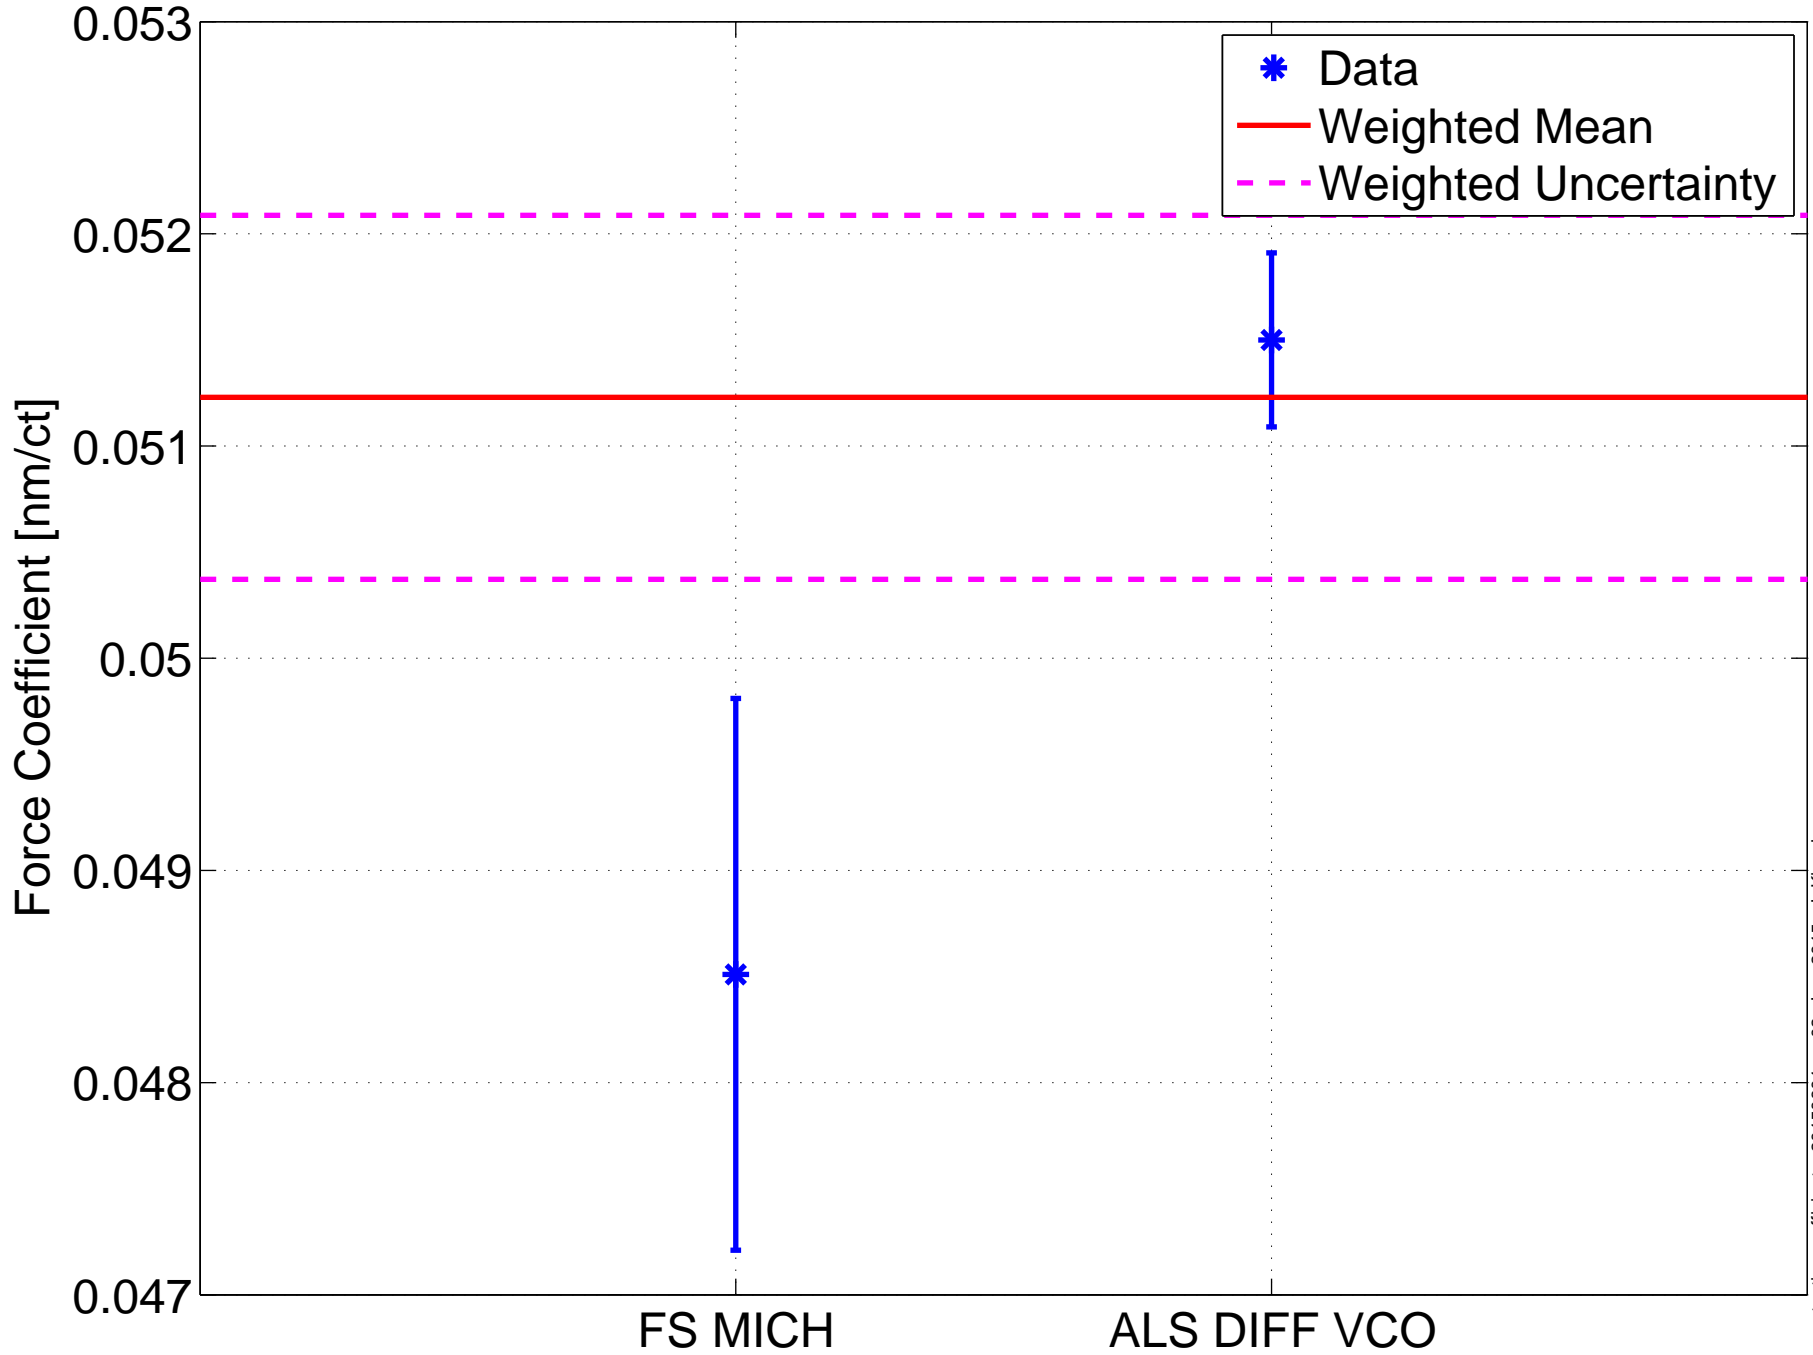


H1 SUS ETMY L2 Actuator Strength

$6.97e-13 \pm 1.2e-14$ [m/ct] ($\pm 1.8\%$)

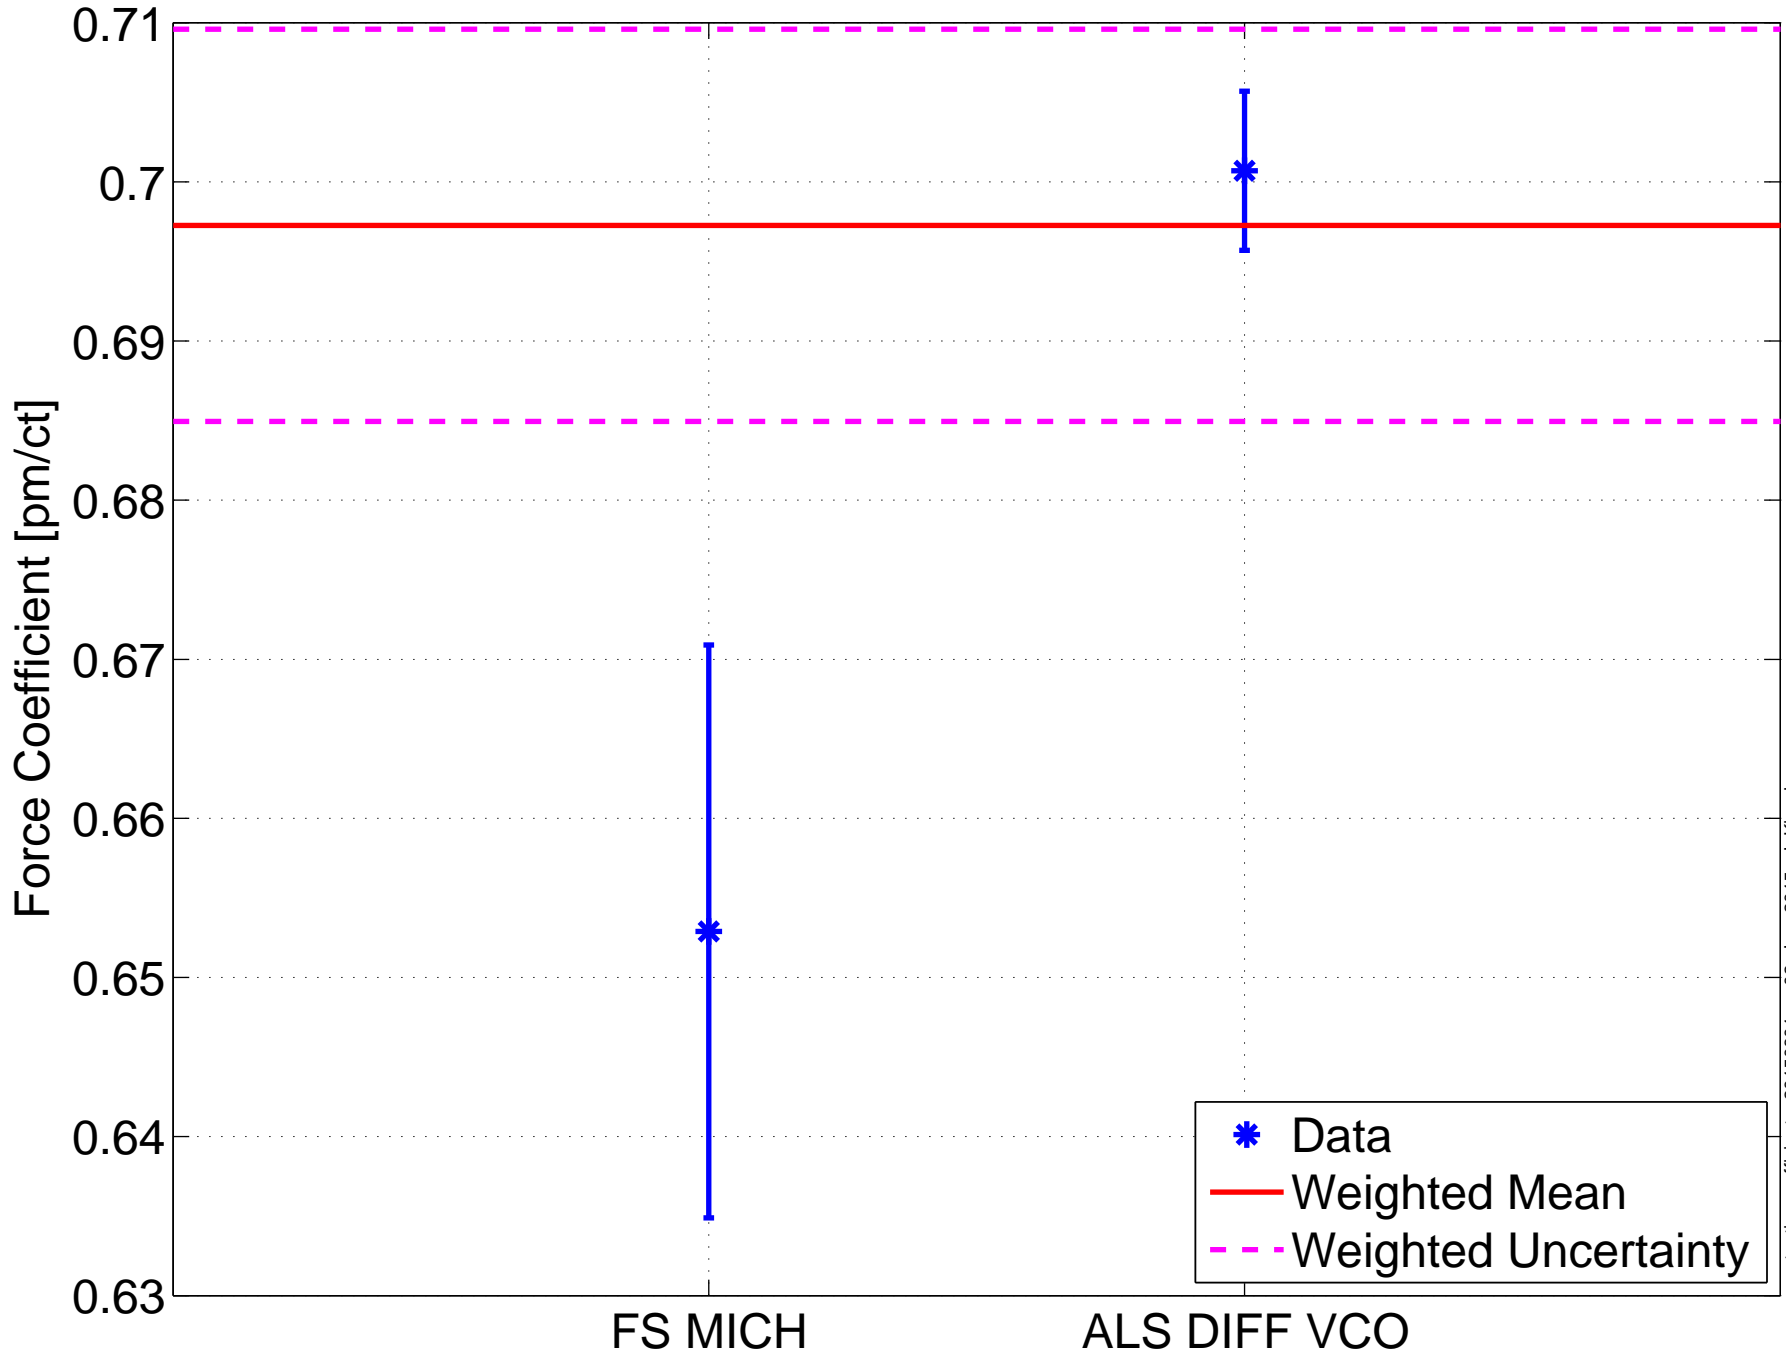

H1 SUS ETMY L3 Actuator Strength

$6.07e-15 \pm 1.4e-16$ [m/ct] ($\pm 2.4\%$)

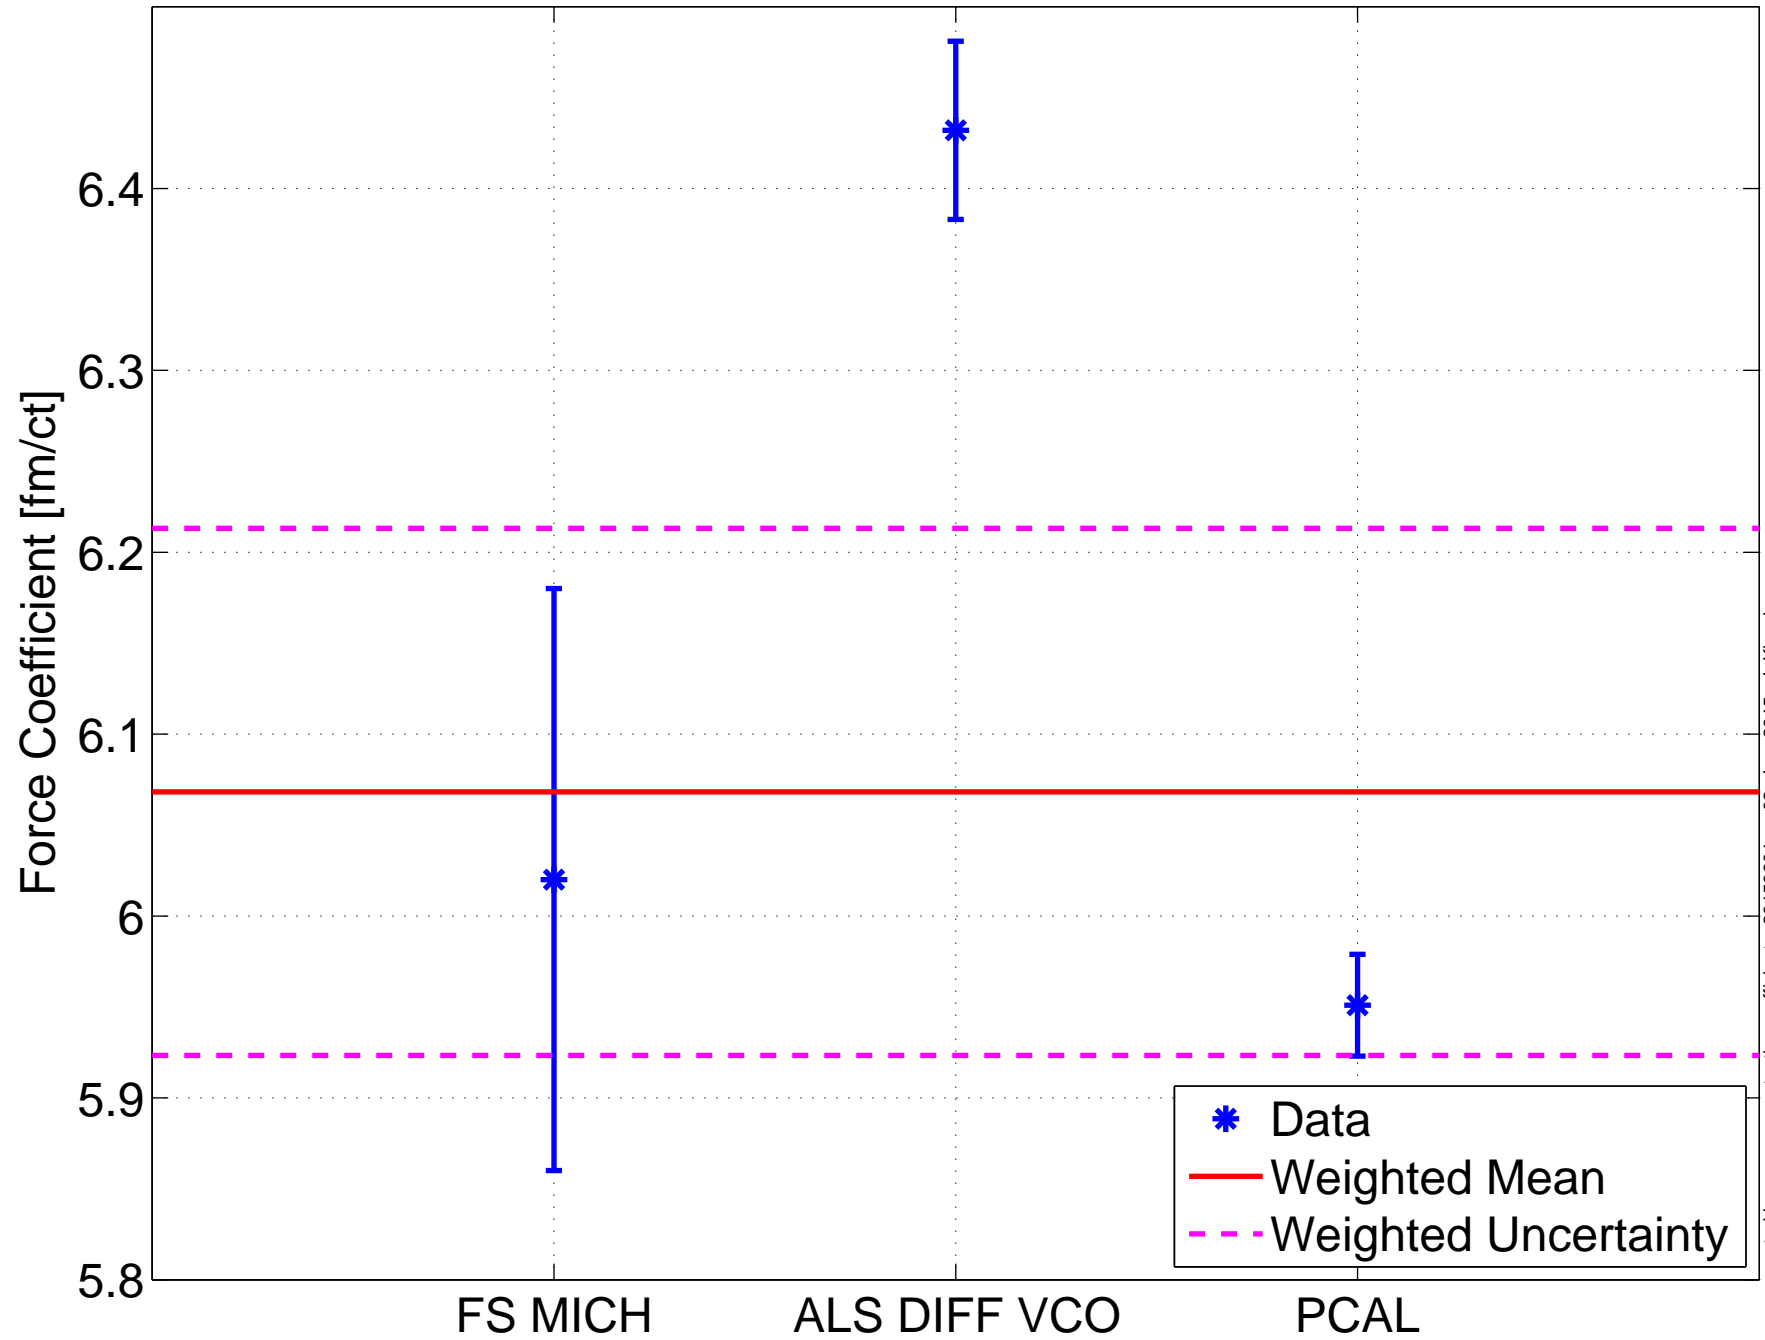

H1 SUS ETMX L3 Actuator Strength

$3.56e-13 \pm 8.2e-15$ [m/ct] ($\pm 2.3\%$)

