




2015-08-29 H1SUSEMY L3 Absolute Calibration

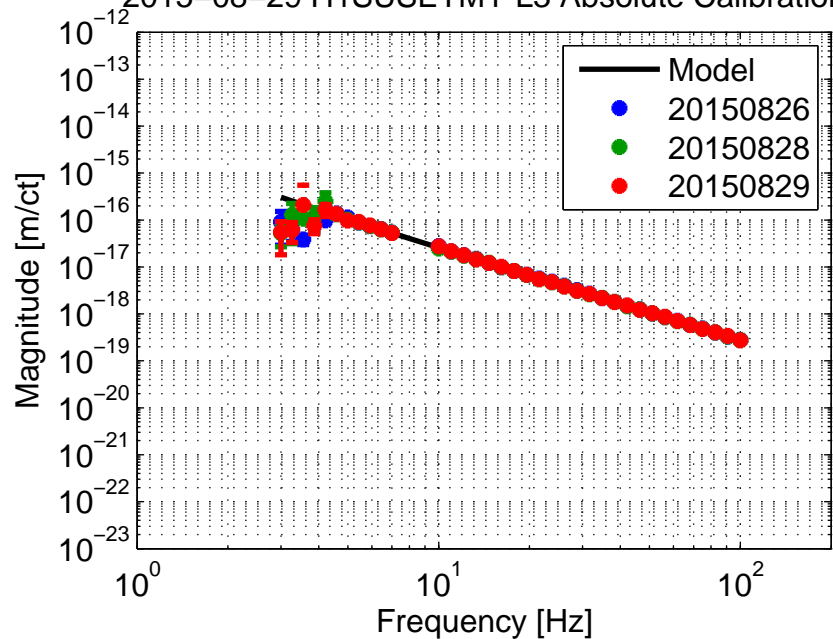


Meas / Model

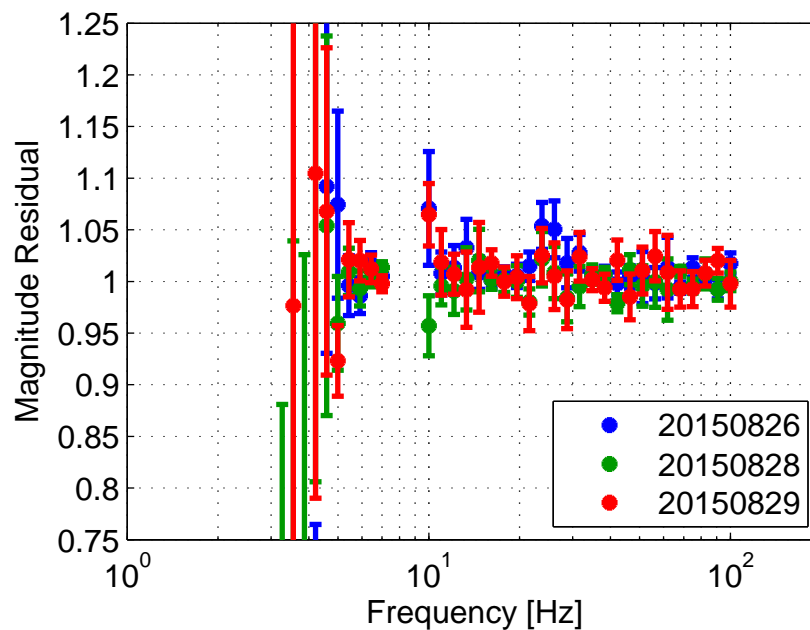

$1.55e-10 \pm 1.5e-13$  [N/V<sup>2</sup>]  
 Rel. Unc. on Mean: 0.096 %, Mean Std: 10 %

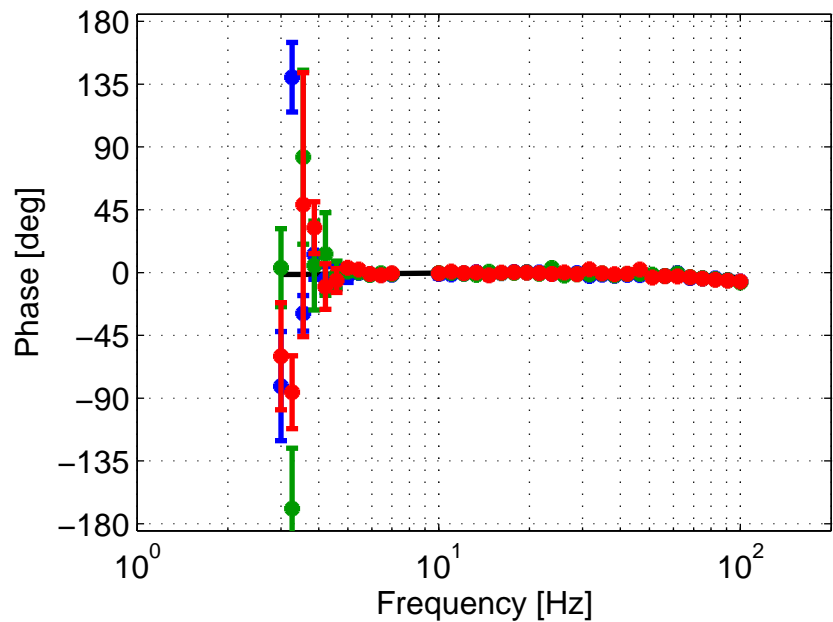

$4.24e-12 \pm 4.1e-15$  [N/ct]  
 $1.11e-14 \pm 1.1e-17$  [m/ct]

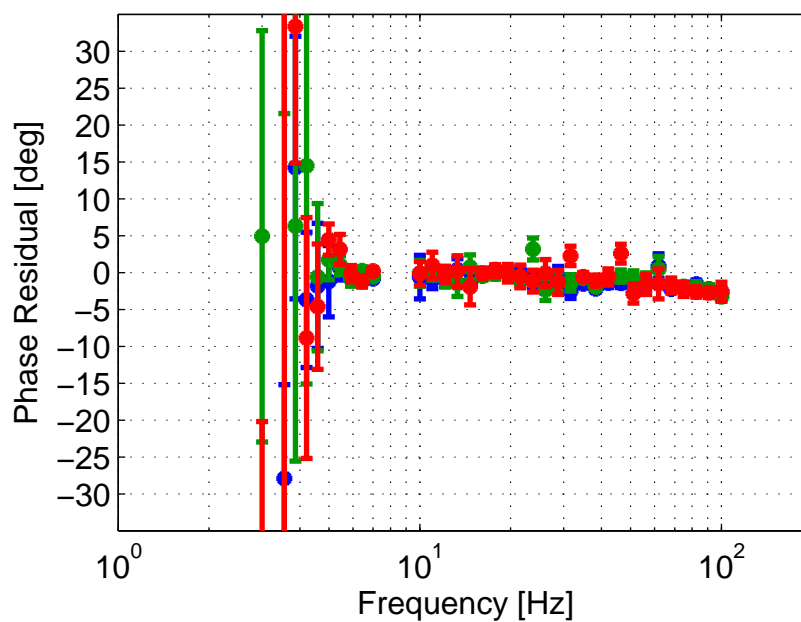

All H1SUSETMY L3 PCAL Absolute Calibrations

