

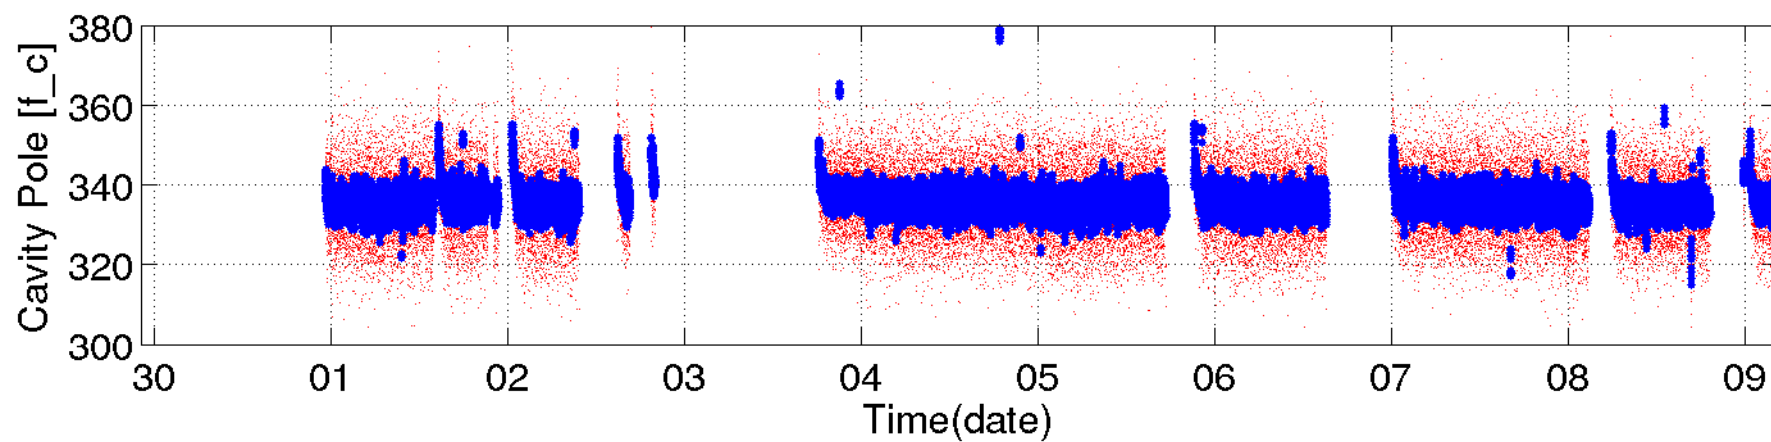
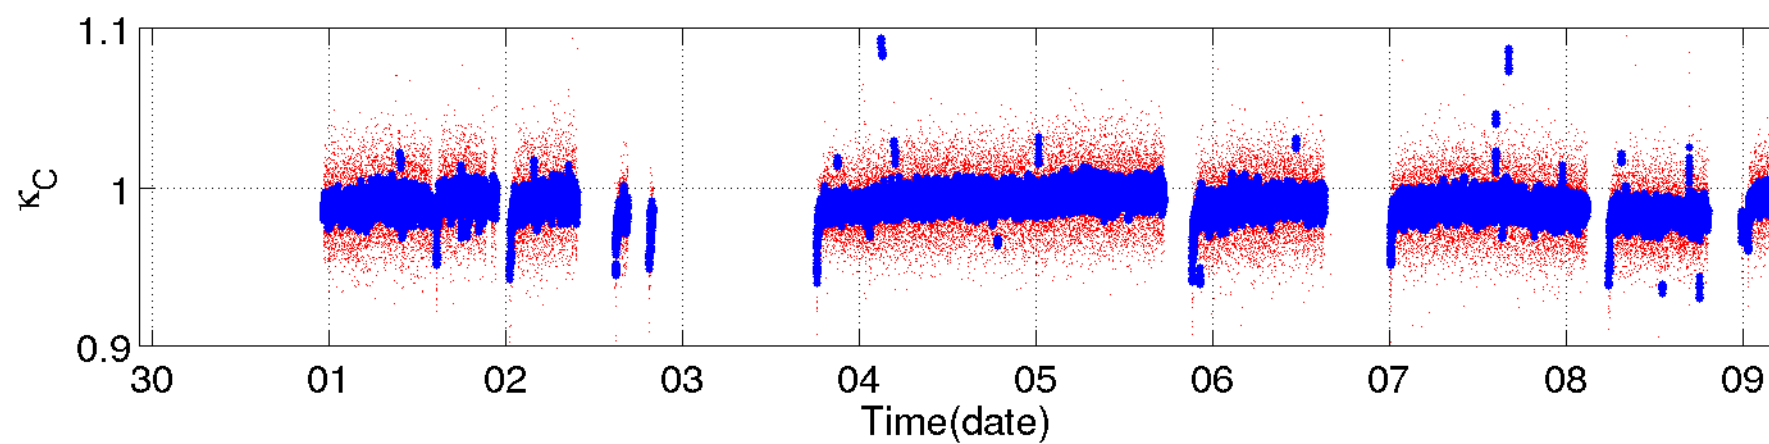
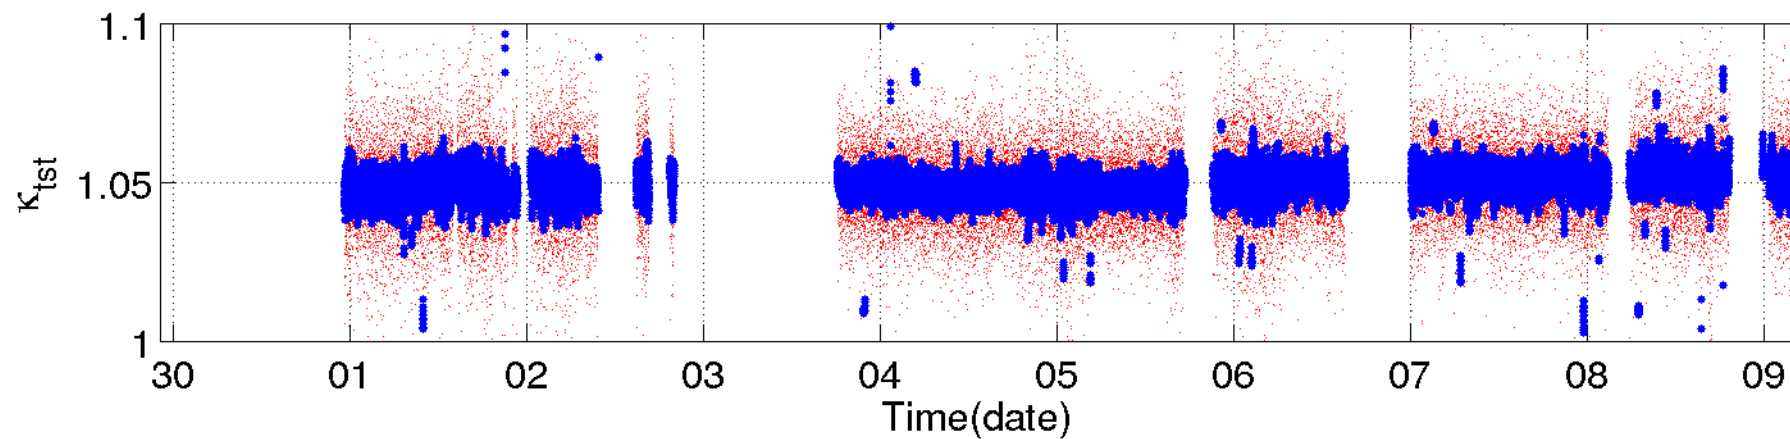
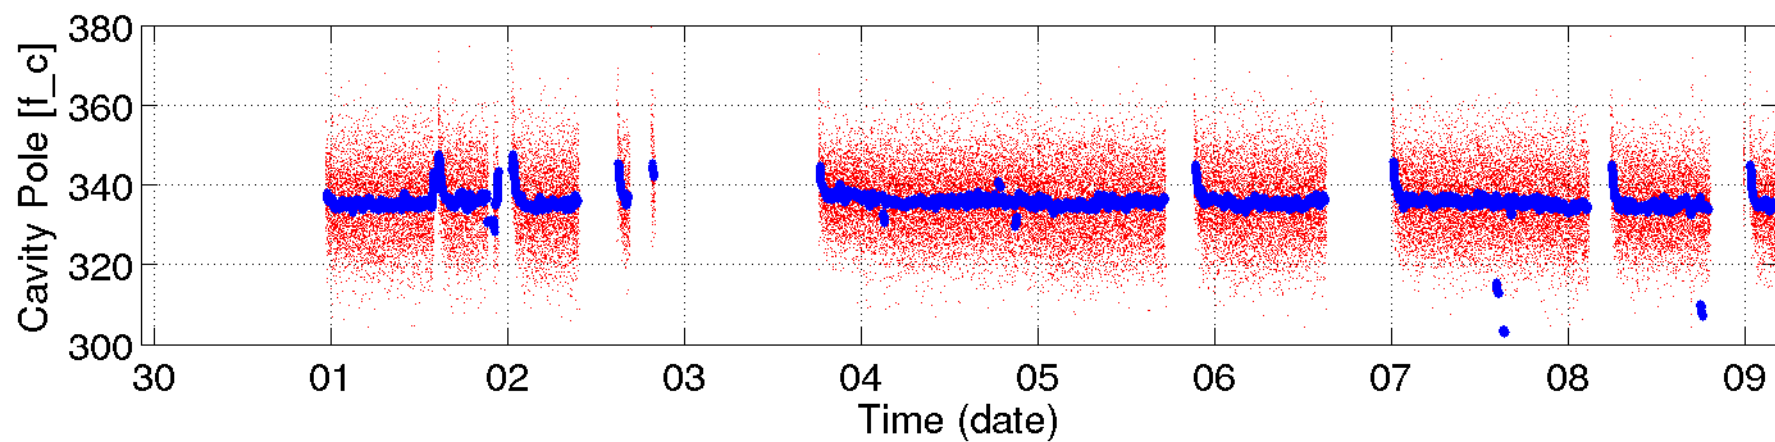




LHO TIME VARYING CALIBRATION PARAMETERS (κ_{tst} , κ_{C} & f_{C})

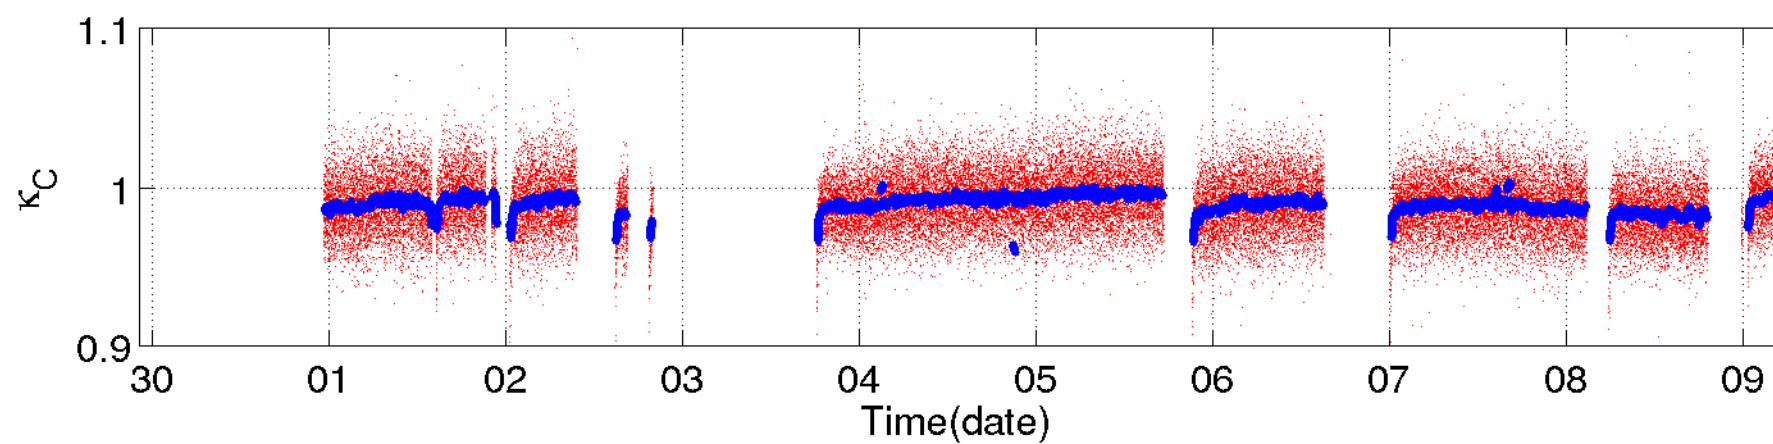



LHO TIME VARYING CALIBRATION PARAMETERS (κ_{tst} , κ_{C} & f_{C})

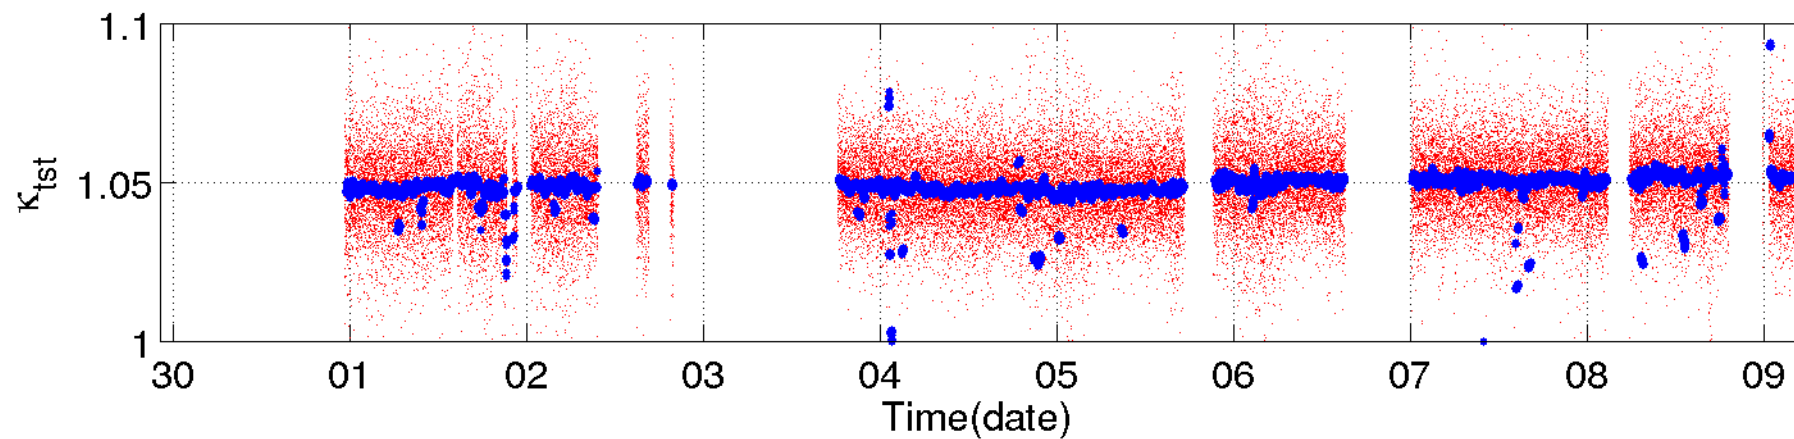



H1:36Hz GDS/Pcal

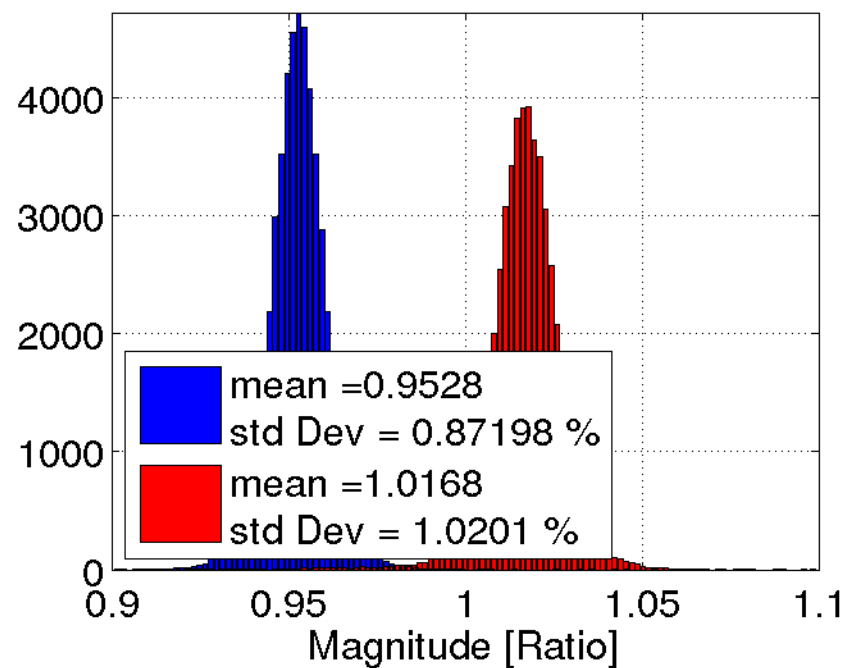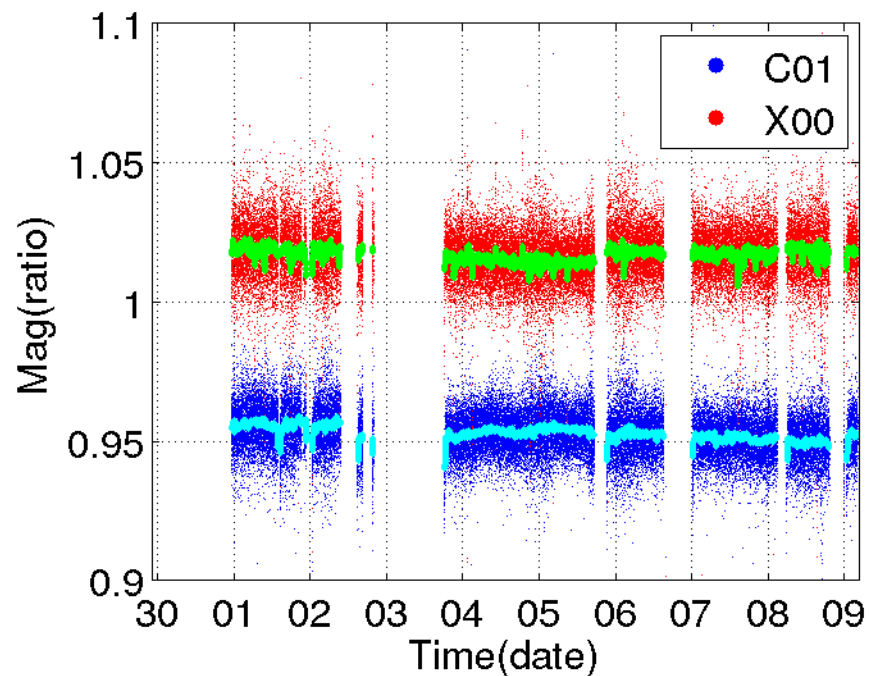



H1:36Hz GDS/Pcal

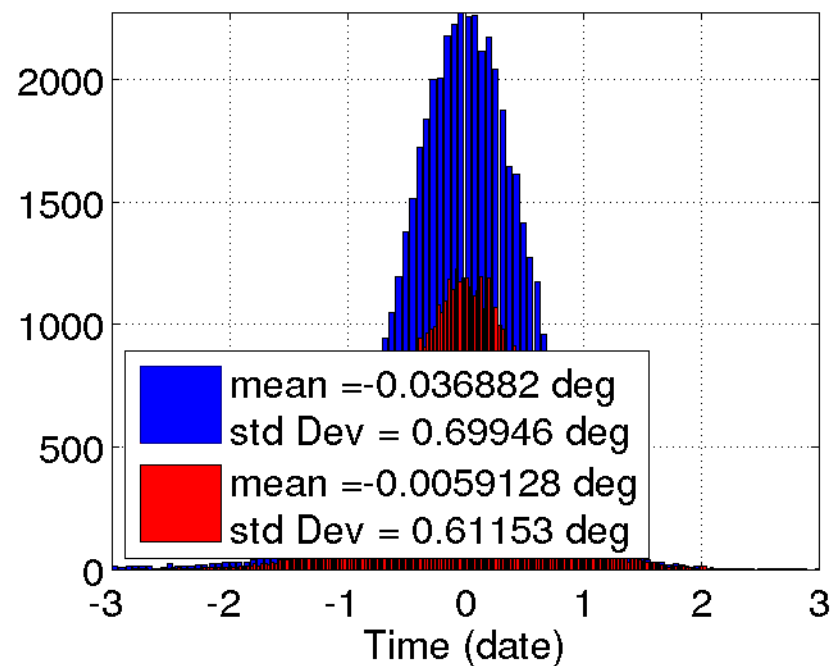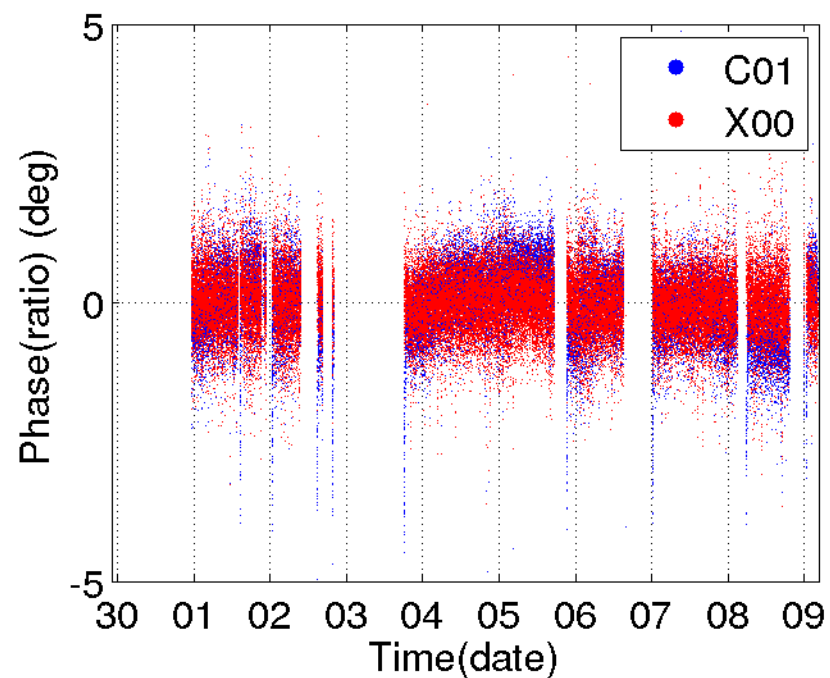



H1:332 Hz GDS/Pcal

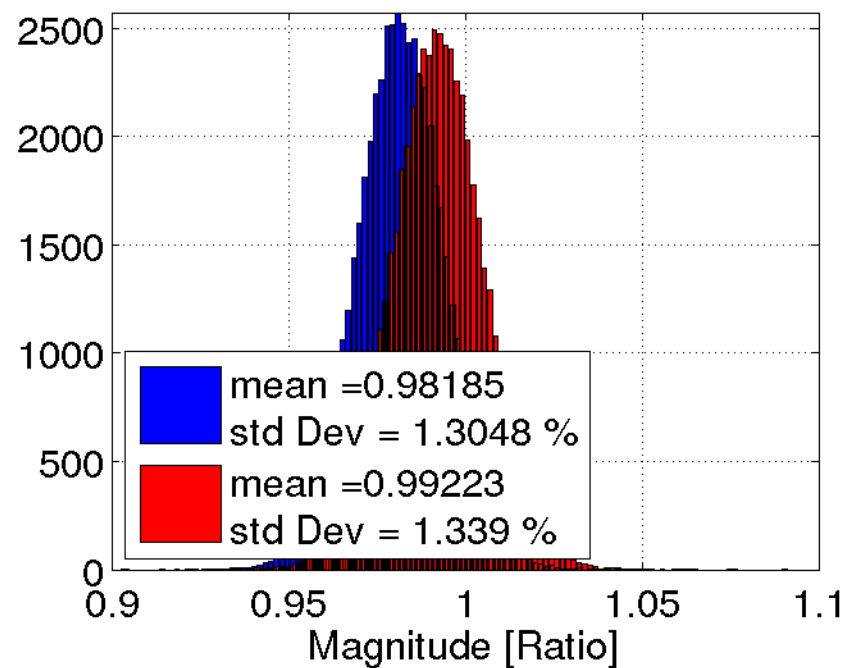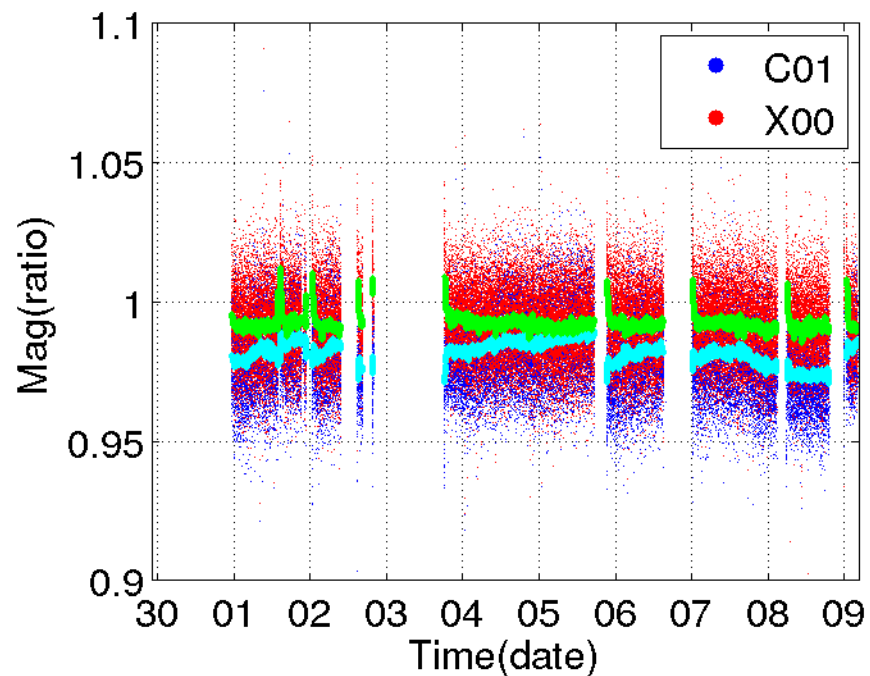



H1:332 Hz GDS/Pcal

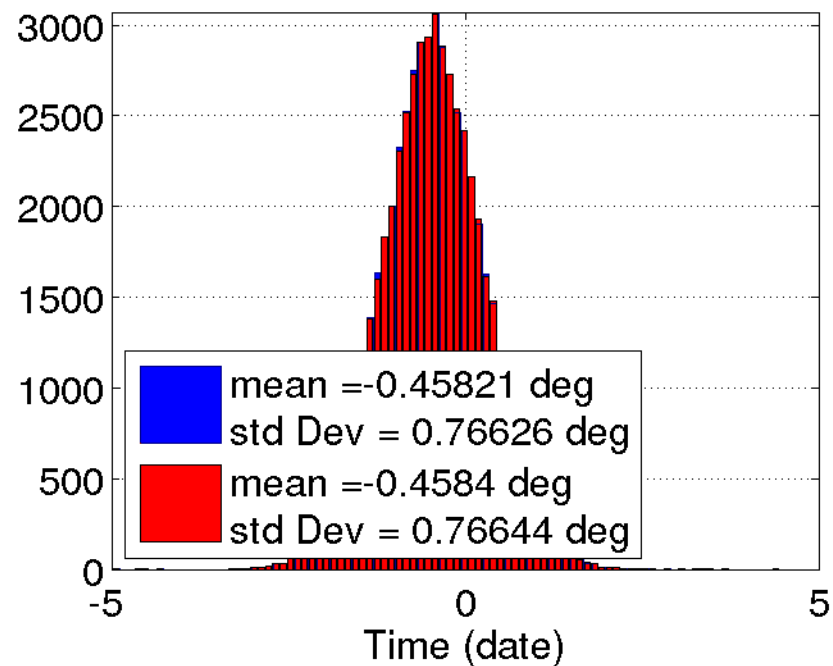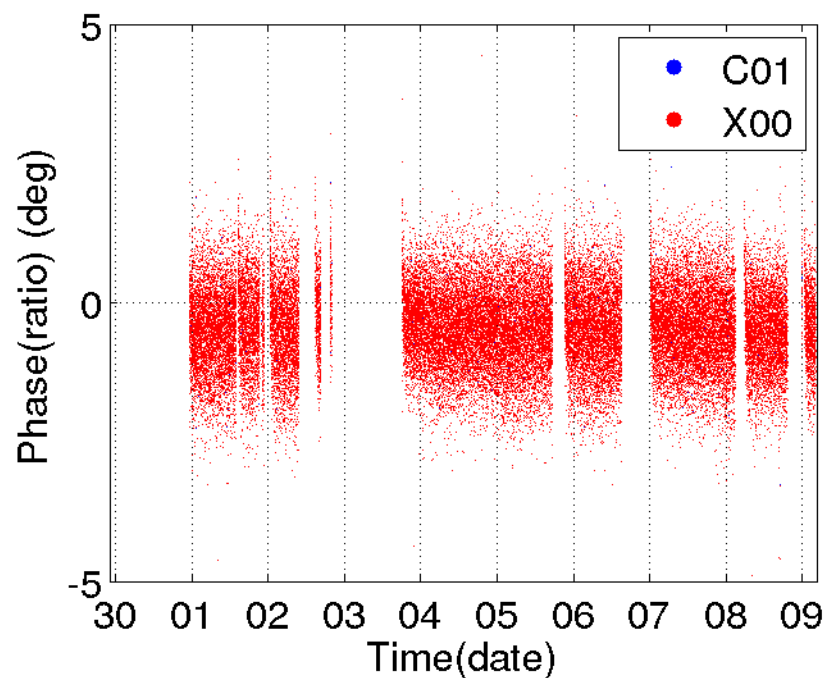



H1: 1 KHz GDS/Pcal

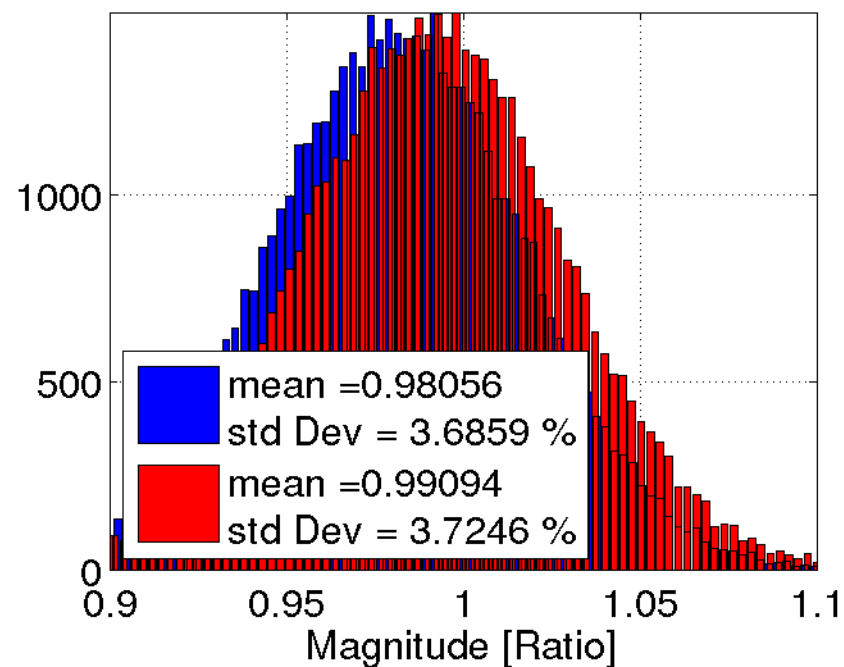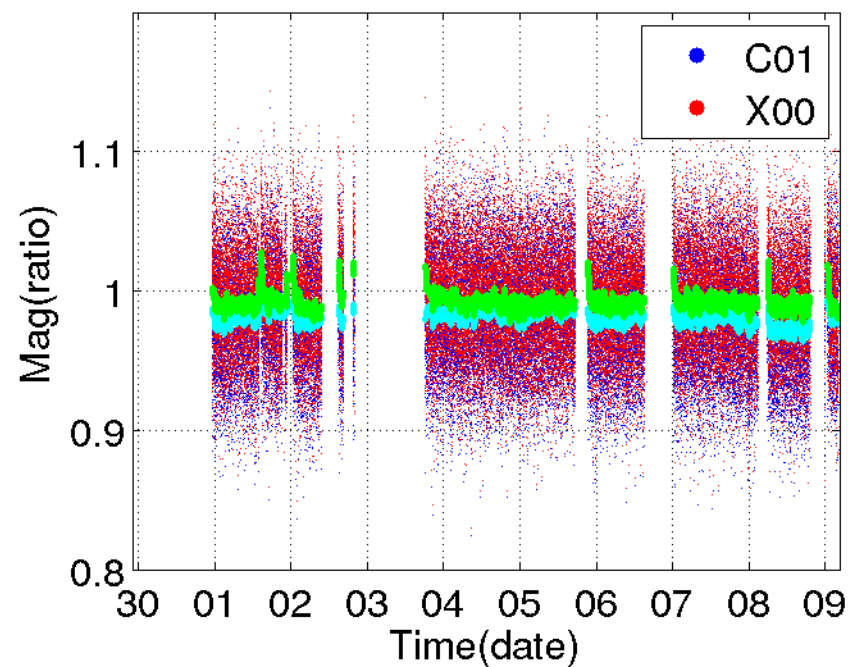

H1:1 KHz GDS/Pcal

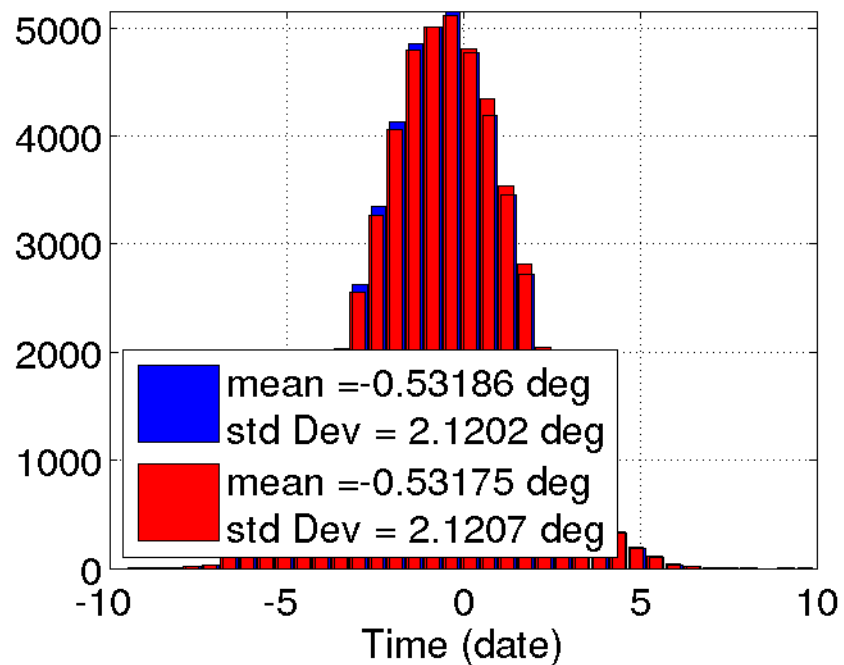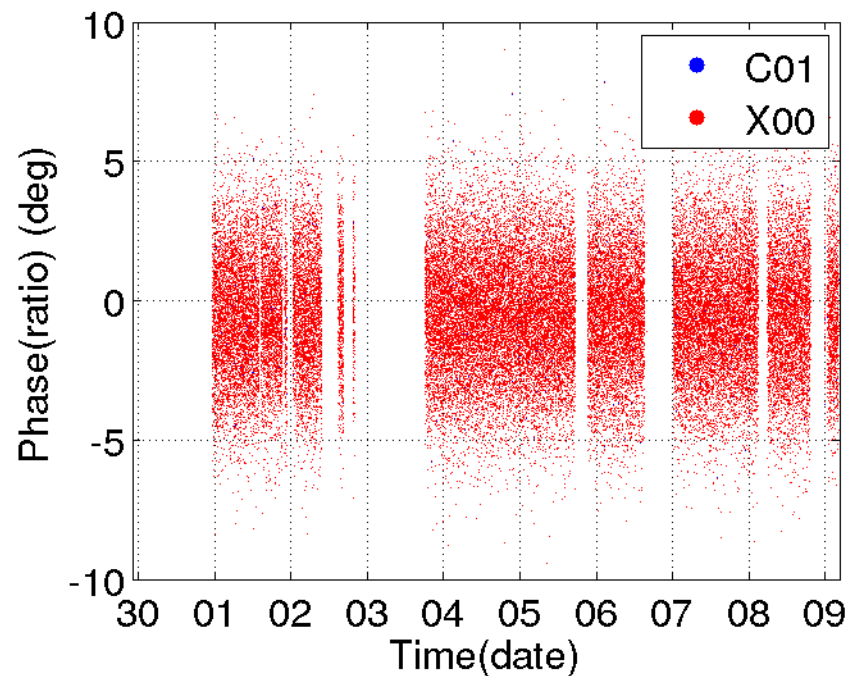

H1:3 KHz GDS/Pcal

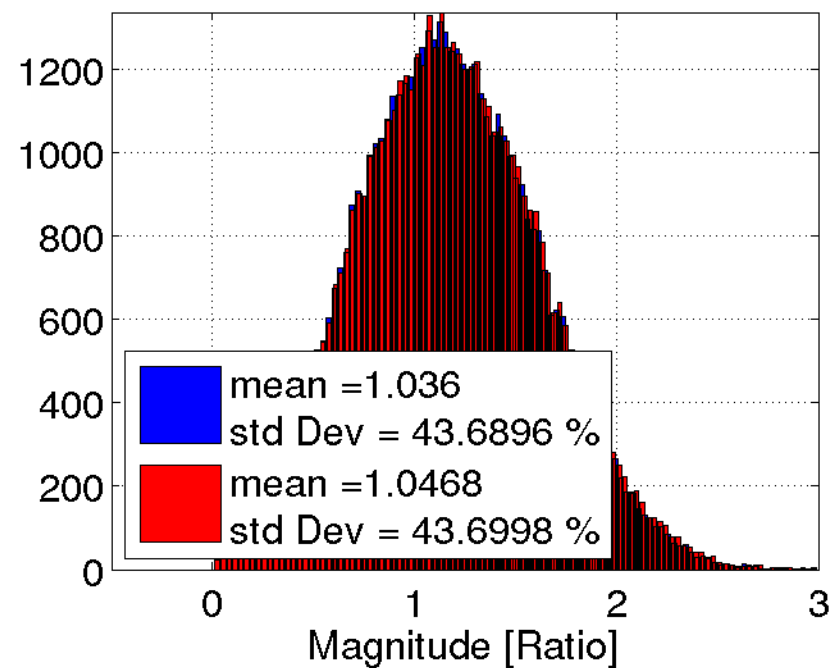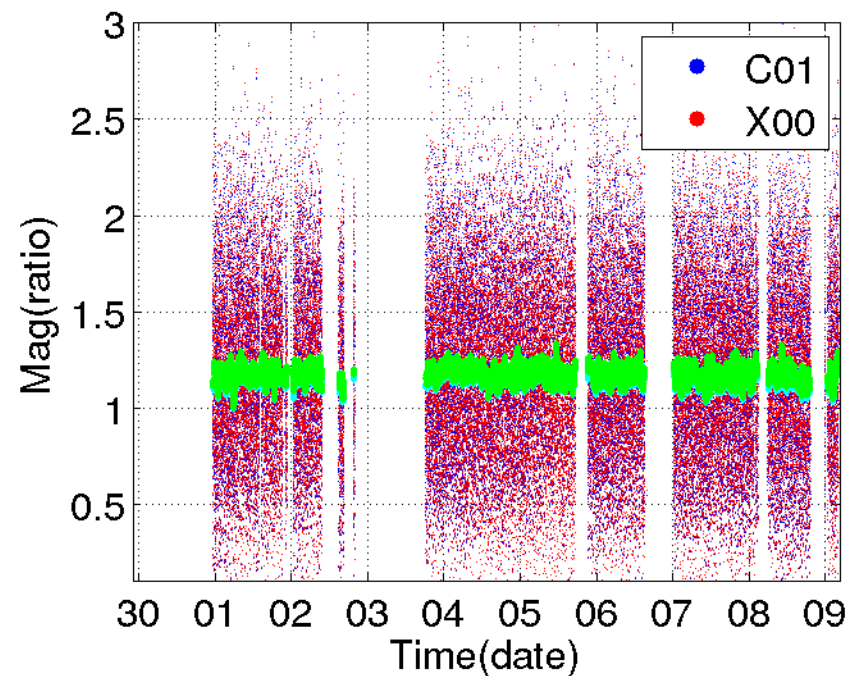

H1:3 KHz GDS/Pcal

