



RED: nominal, BLUE: CS,EX,EY main chillers and turbines and OSB fans off

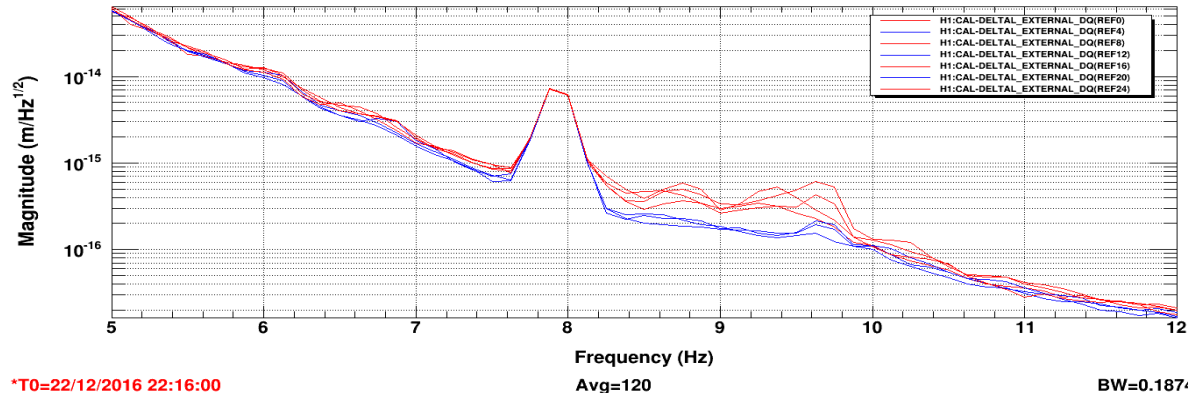

EX coherence between GS13 and DARM, RED: HVAC normal, BLUE: partial shutdown

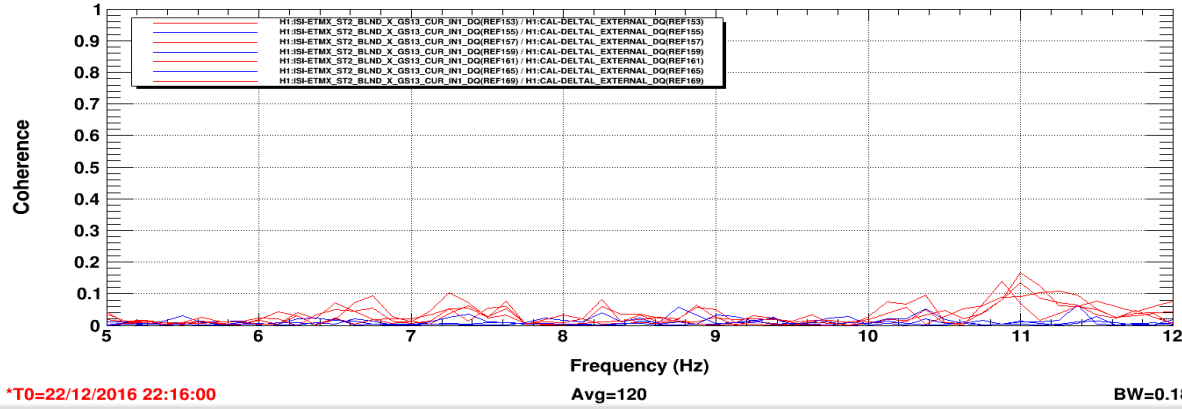

EY coherence between GS13 and DARM, RED: HVAC normal, BLUE: partial shutdown

