


MEAN

Trend from 18-09-04-13-44-44 to 18-09-04-21-44-44

Ch 1: H0:VAC-MR_IP1_III161_IC_VOLTS

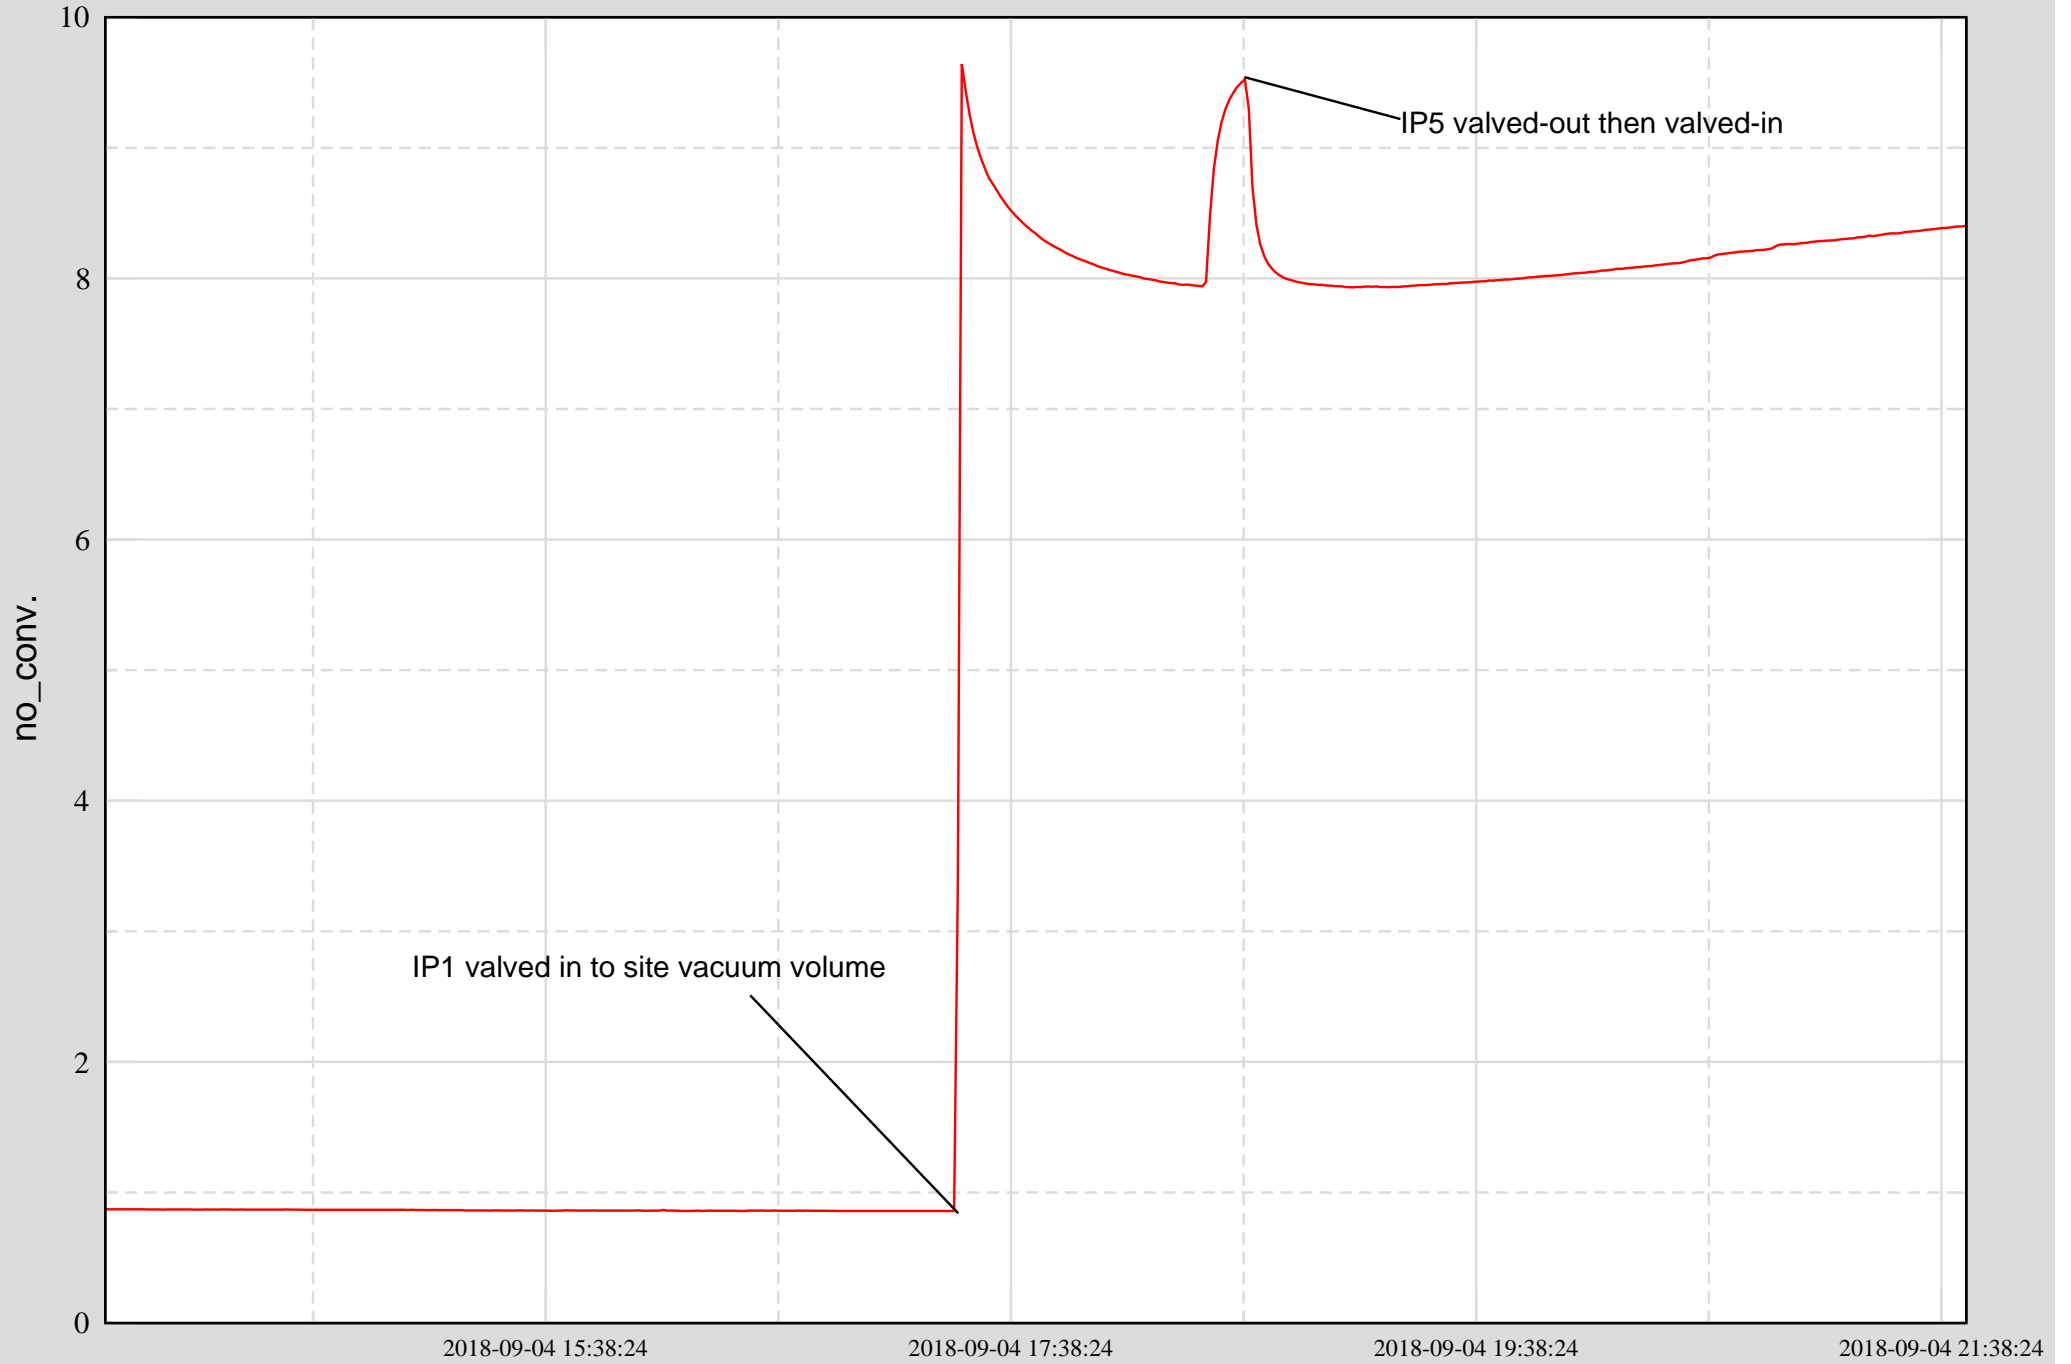

IP1 valved in to site vacuum volume

IP5 valved-out then valved-in