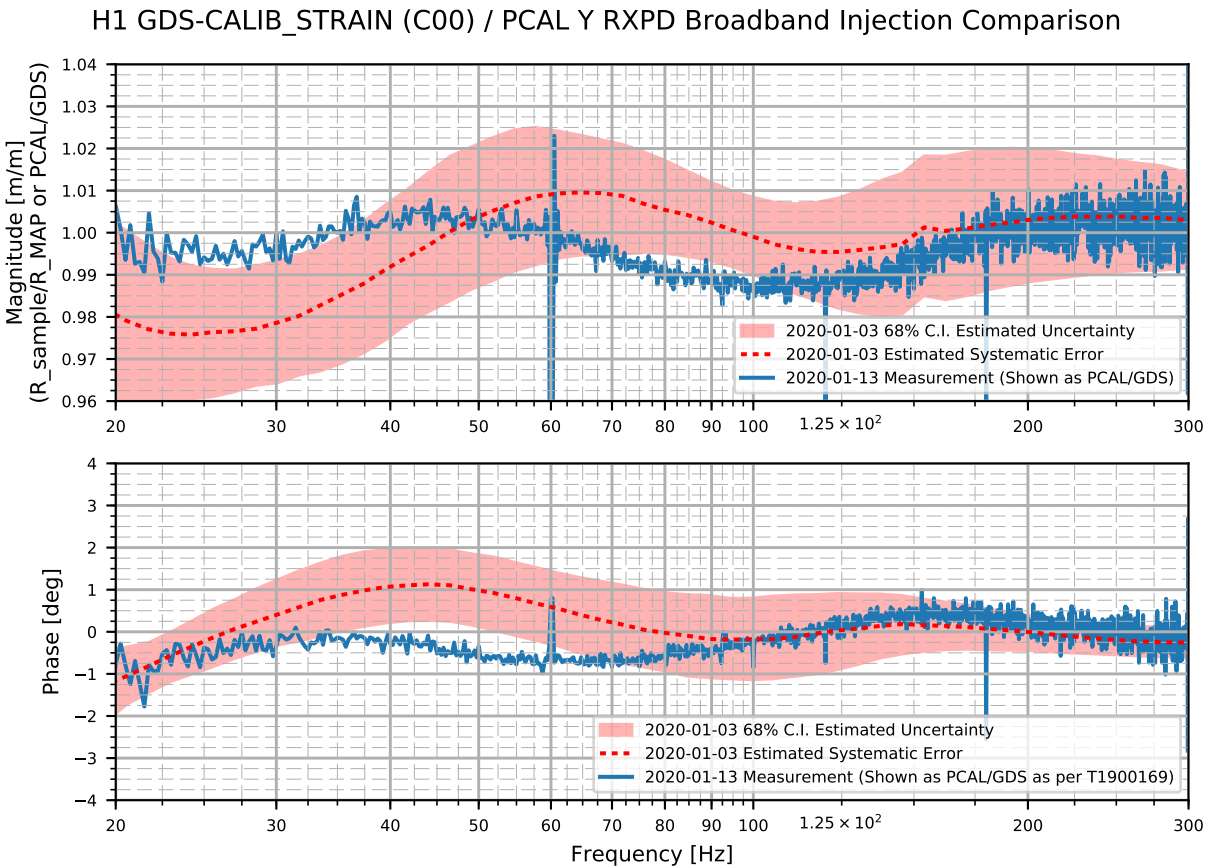
H1 GDS-CALIB_STRAIN (C00) / PCAL Y RXPD Broadband Injection Comparison
Magnitude [m/m]
(R_sample/R_MAP or PCAL/GDS)
2020-01-03 68% C.I. Estimated Uncertainty
2020-01-03 Estimated Systematic Error
2020-01-13 Measurement (Shown as PCAL/GDS)
Phase [deg]
2020-01-03 68% C.I. Estimated Uncertainty
2020-01-03 Estimated Systematic Error
2020-01-13 Measurement (Shown as PCAL/GDS as per T1900169)
Frequency [Hz]