



Input Measurement Excitation Result

Transfer function

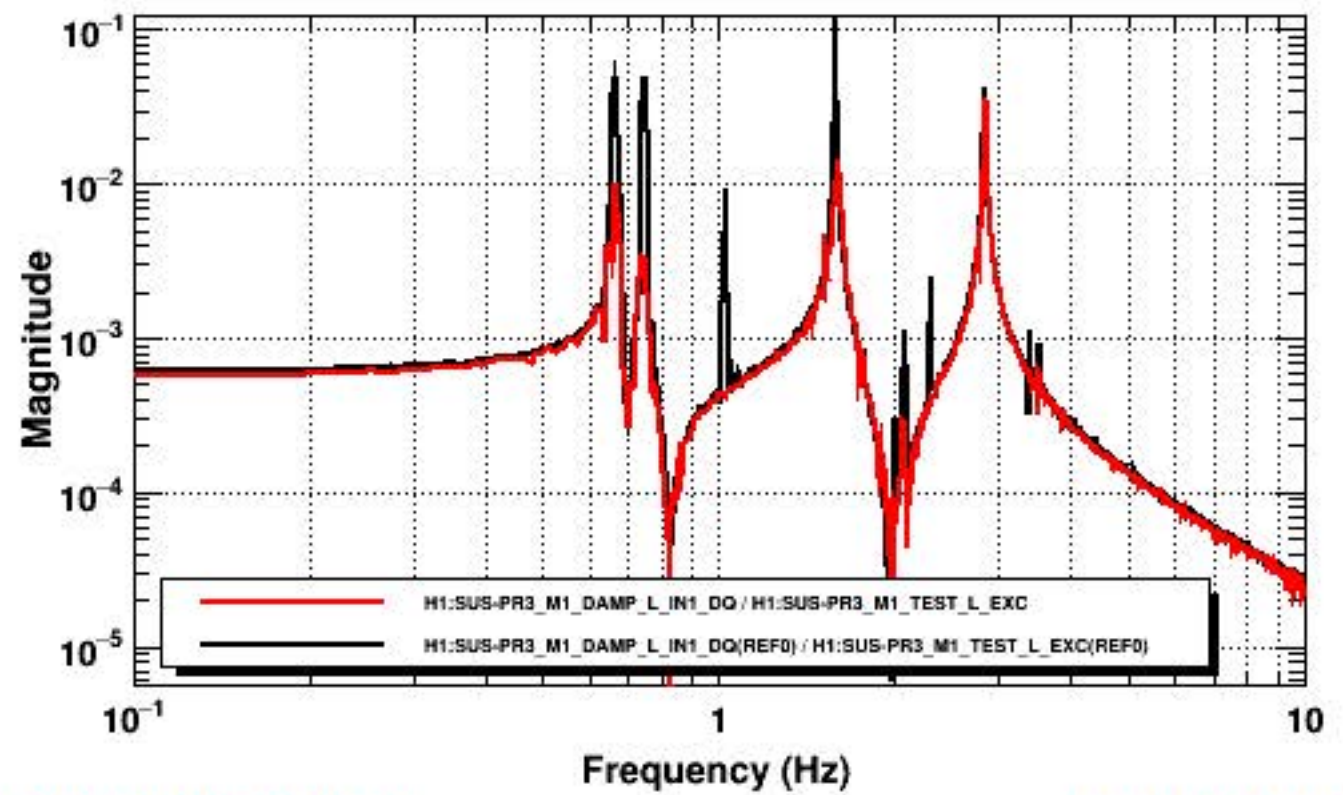


*T0=29/10/2020 16:46:37 Avg=5 *BW=0.0117187

Transfer function

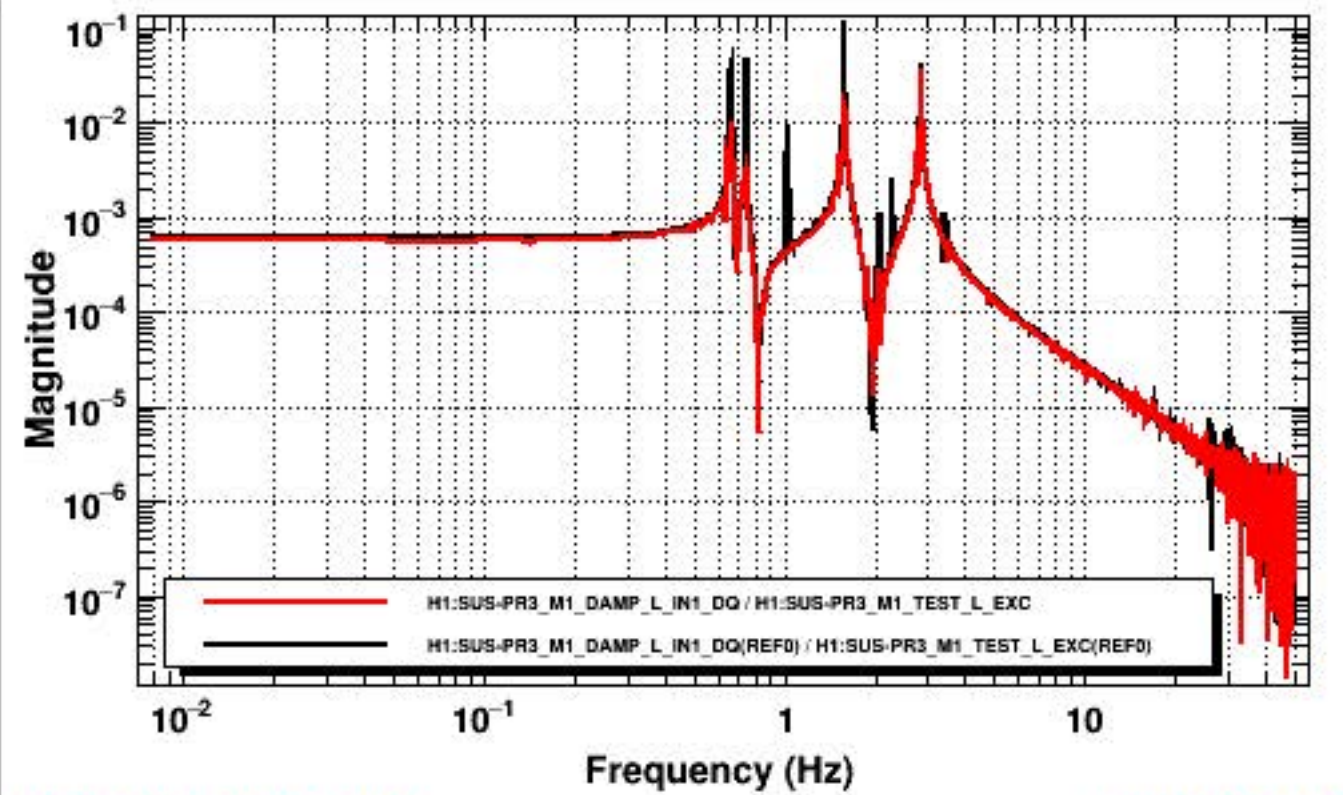


*T0=29/10/2020 16:46:37 Avg=5 *BW=0.0117187

Coherence

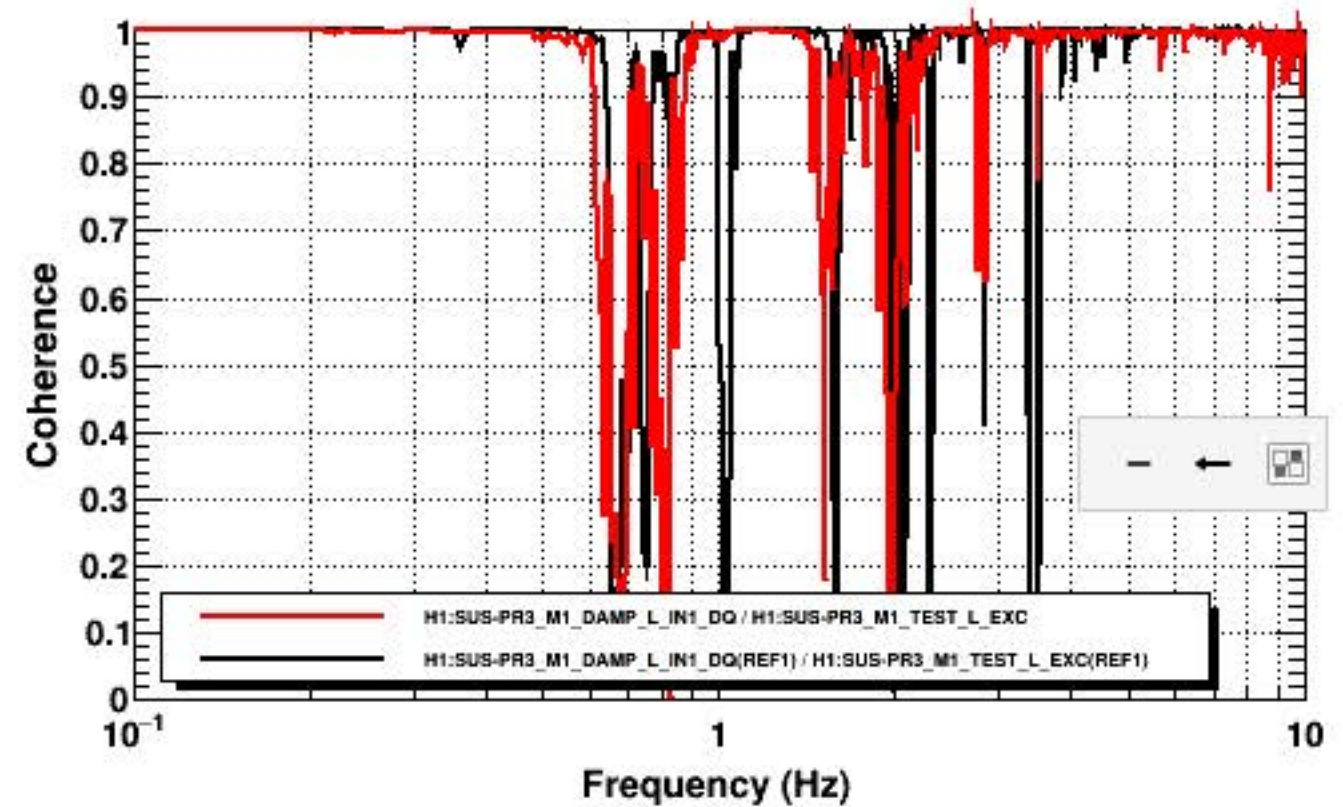

*T0=29/10/2020 16:46:37 Avg=5 BW=0.0117187

Transfer function

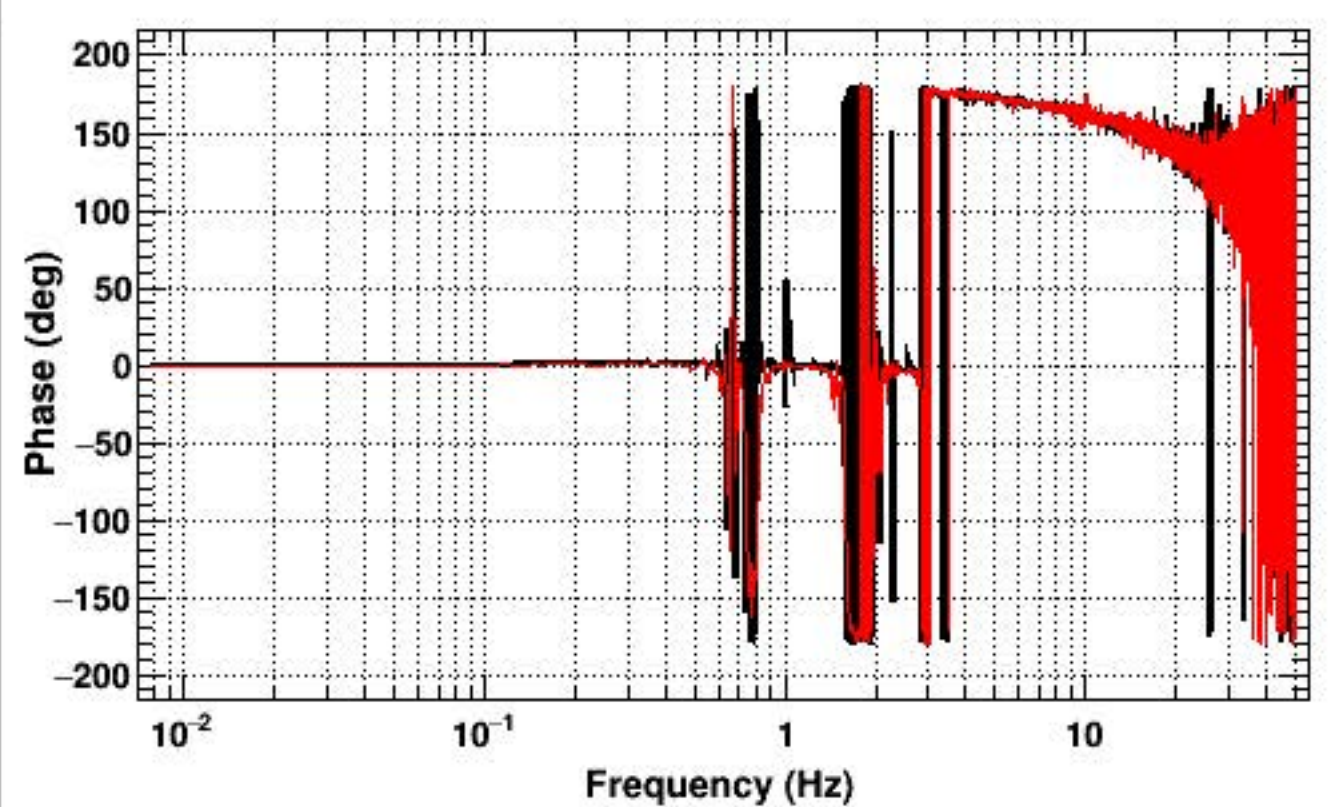

*T0=29/10/2020 16:46:37 Avg=5 *BW=0.0117187


Reset Zoom Active New Options...

Import... Export... Reference... Calibration... Print...

Start Pause Resume Abort


Input Measurement Excitation Result

Transfer function

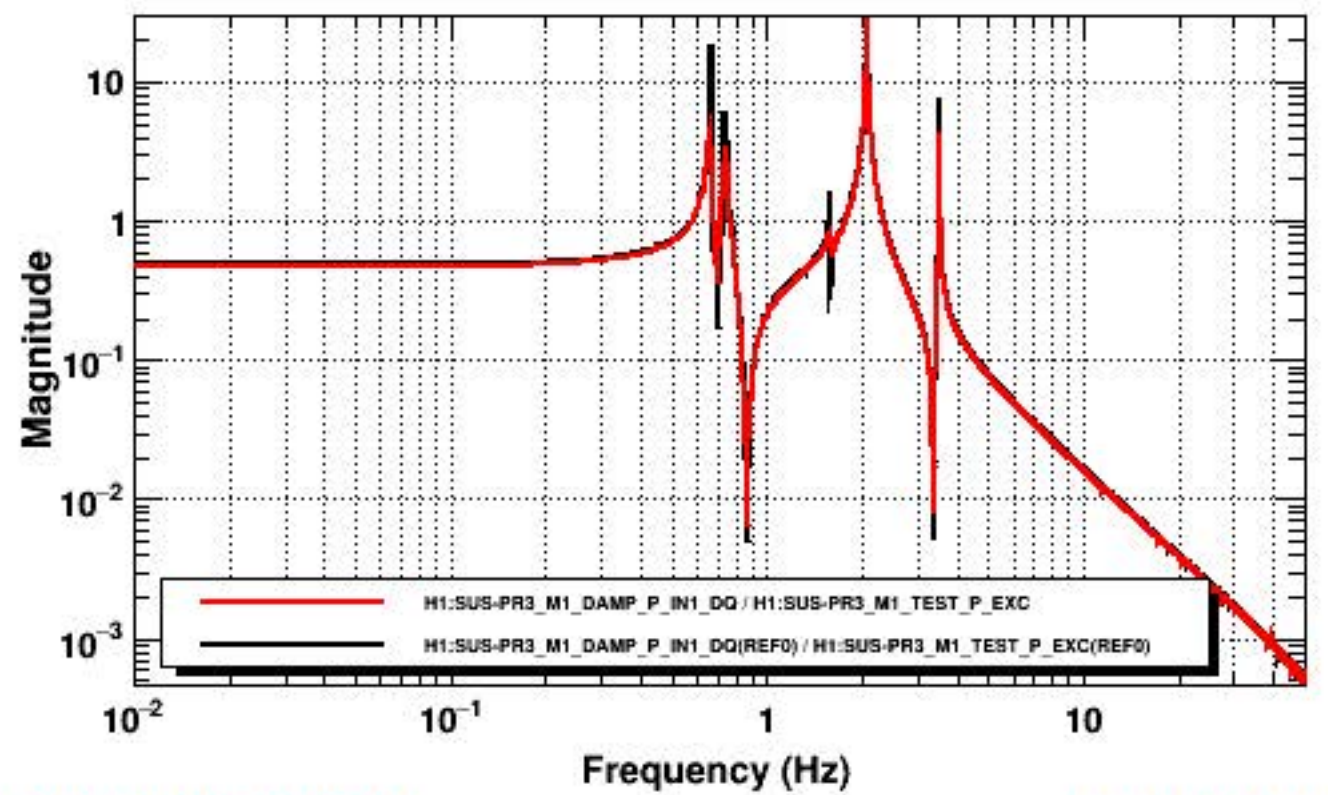


*T0=29/10/2020 17:02:21 Avg=5 *BW=0.0117187

Transfer function

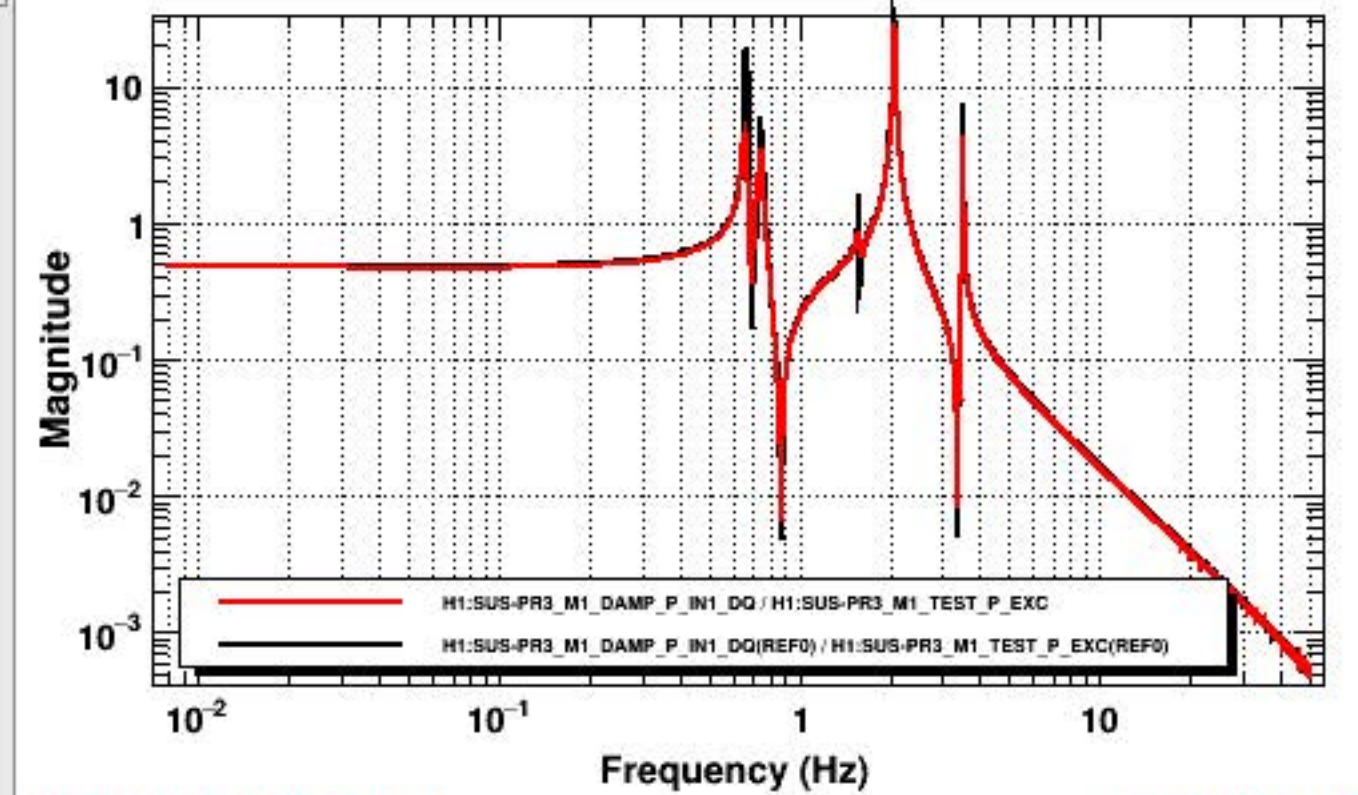


*T0=29/10/2020 17:02:21 Avg=5 *BW=0.0117187

Coherence

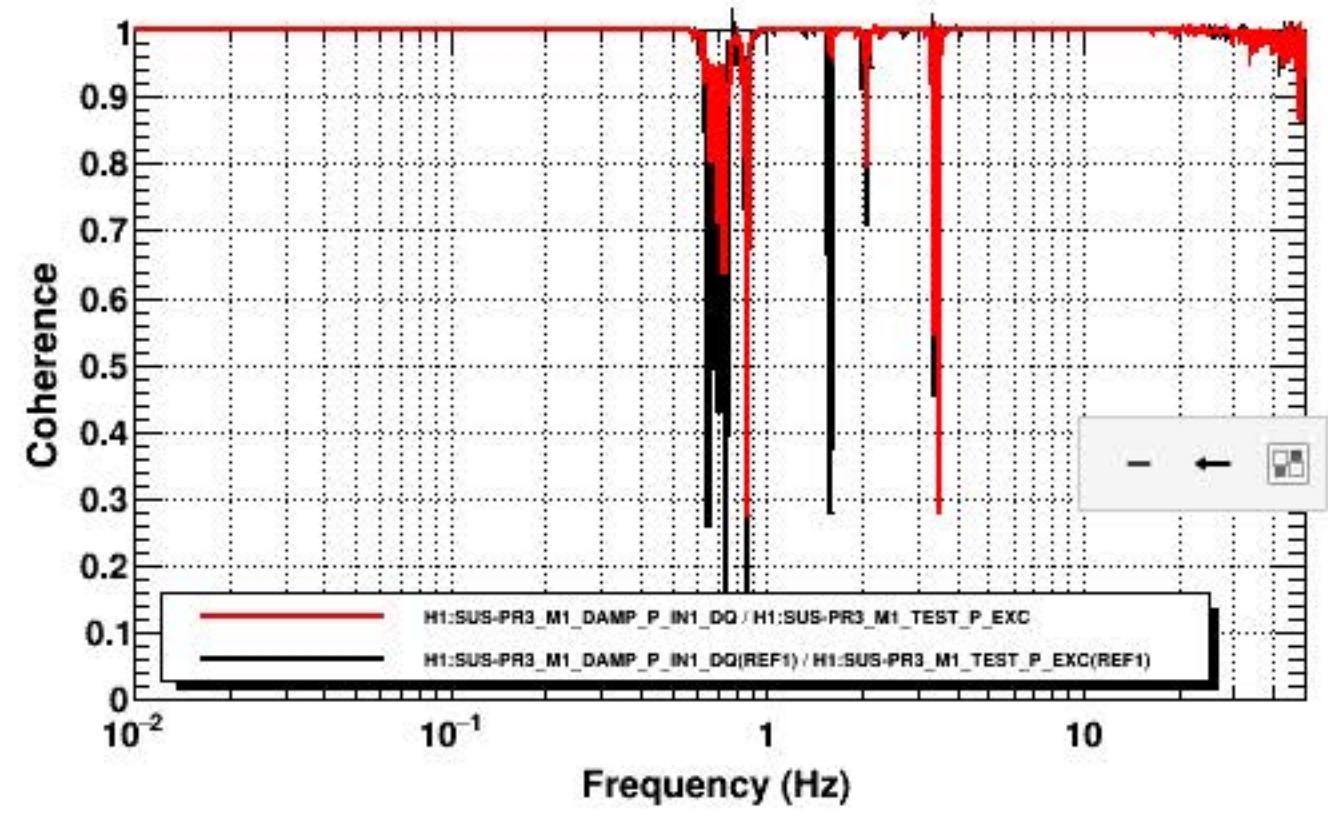

*T0=29/10/2020 17:02:21 Avg=5 BW=0.0117187

Transfer function

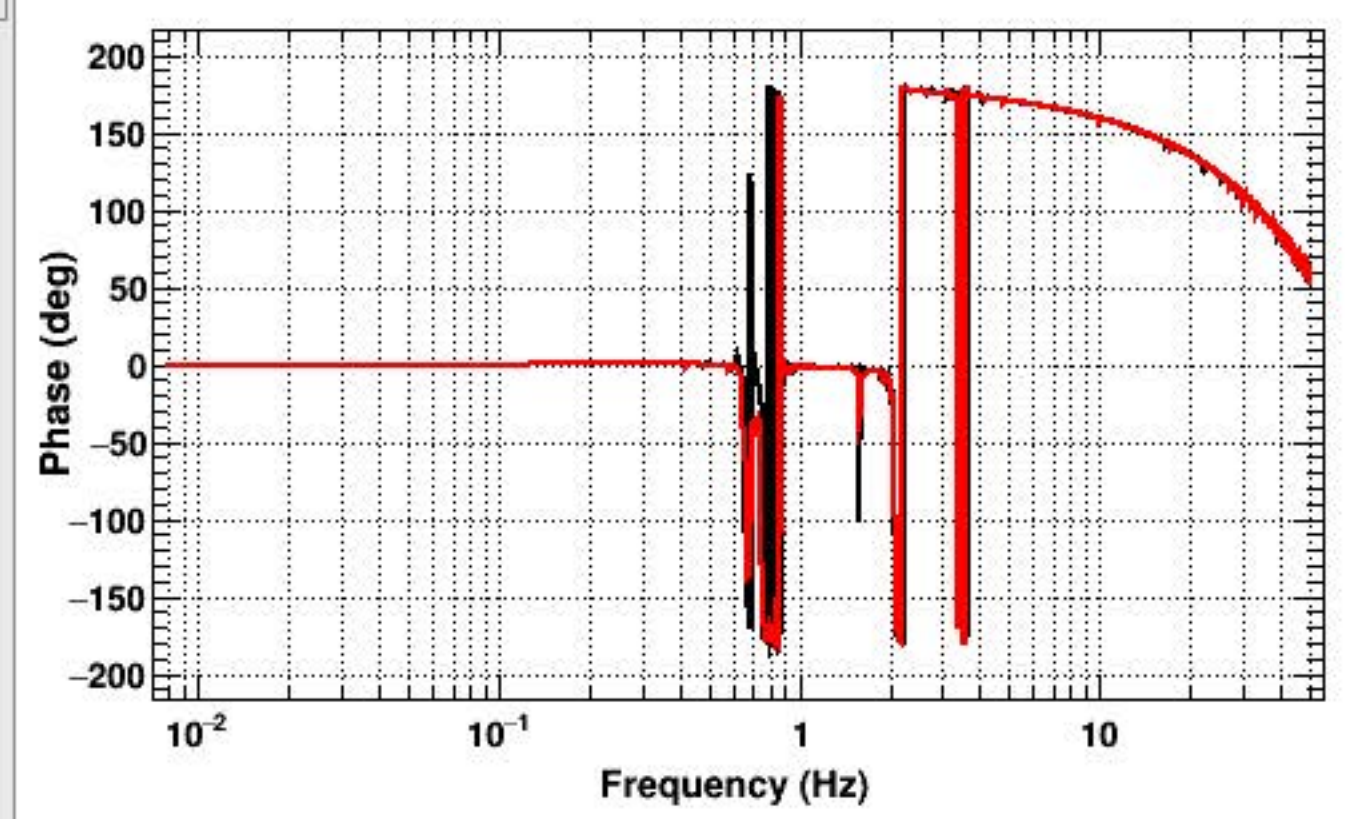

*T0=29/10/2020 17:02:21 Avg=5 *BW=0.0117187


Reset Zoom Active New Options...

Import... Export... Reference... Calibration... Print...

Start Pause Resume Abort


Input Measurement Excitation Result

Transfer function

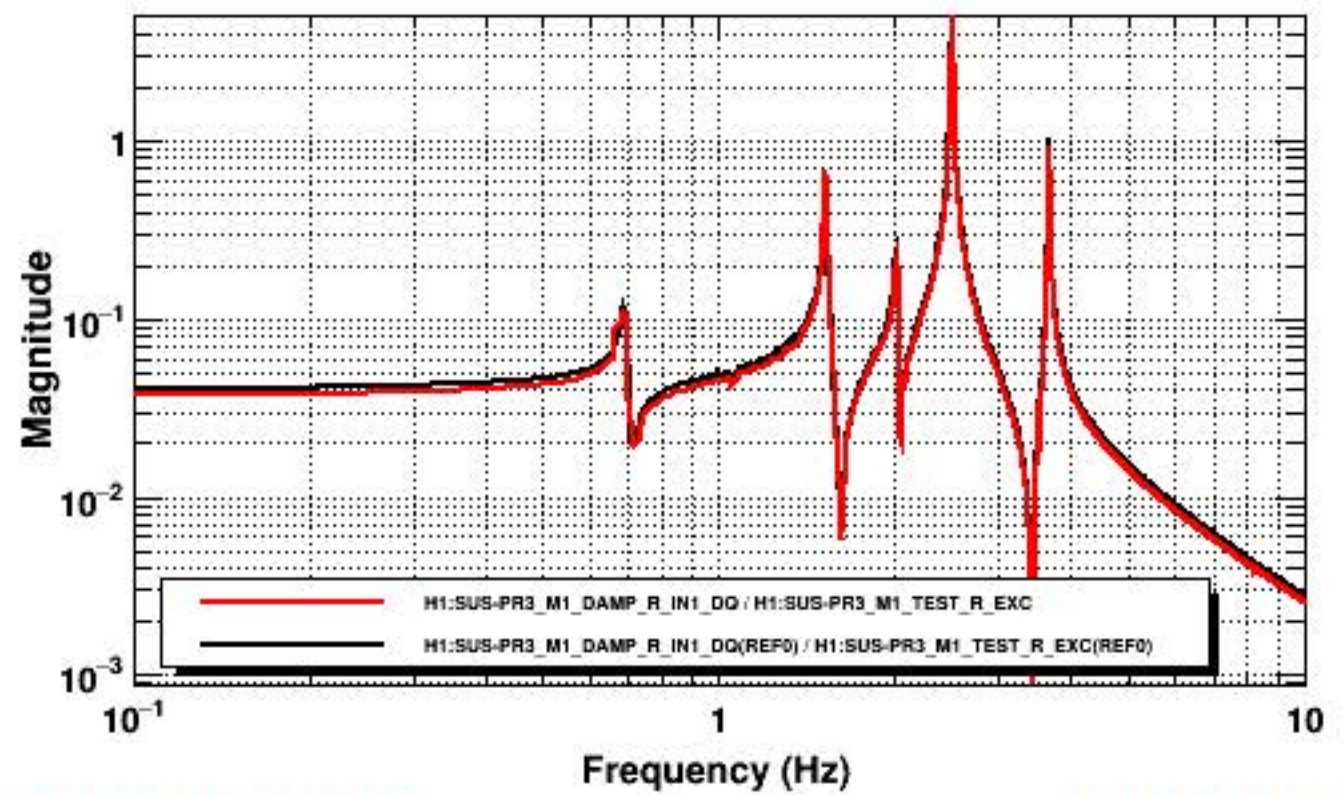


*T0=29/10/2020 17:12:39 Avg=5 *BW=0.0117187

Transfer function

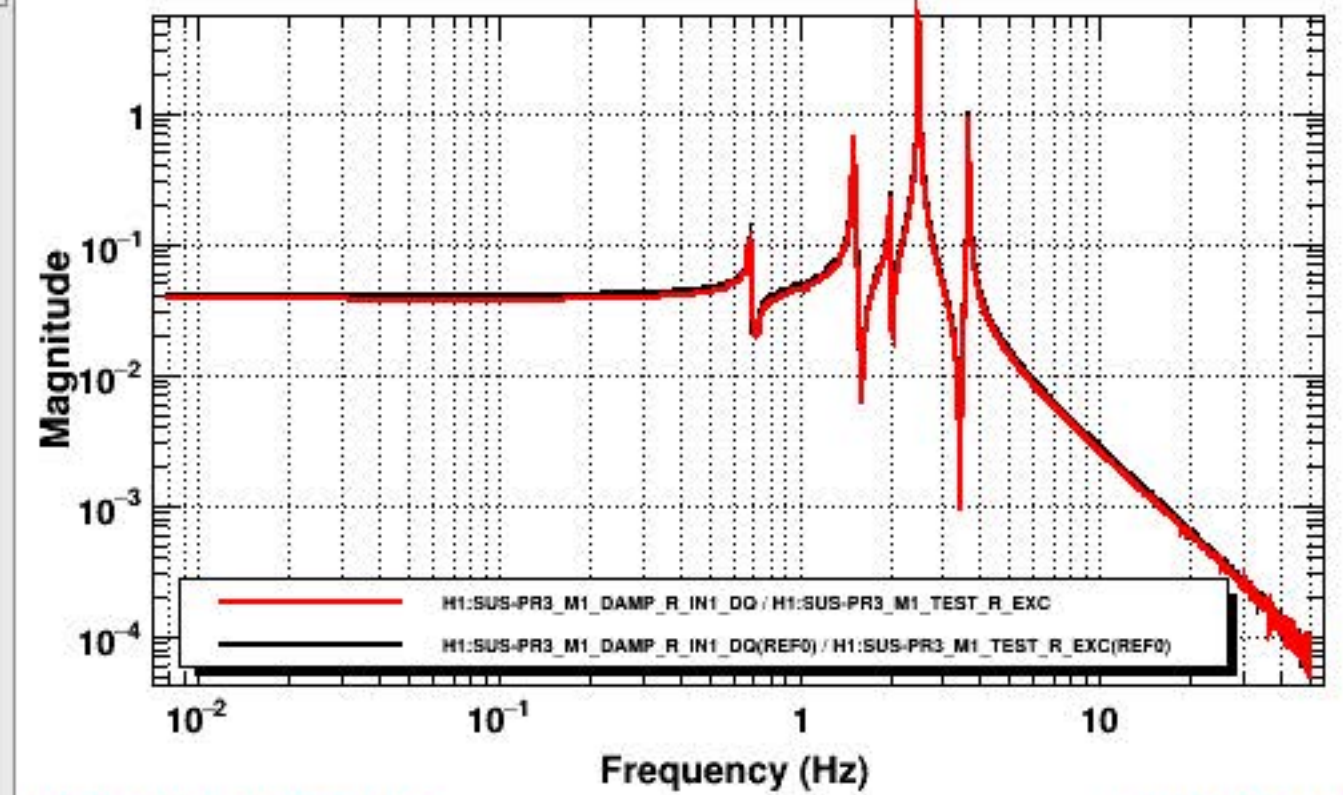


*T0=29/10/2020 17:12:39 Avg=5 *BW=0.0117187

Coherence

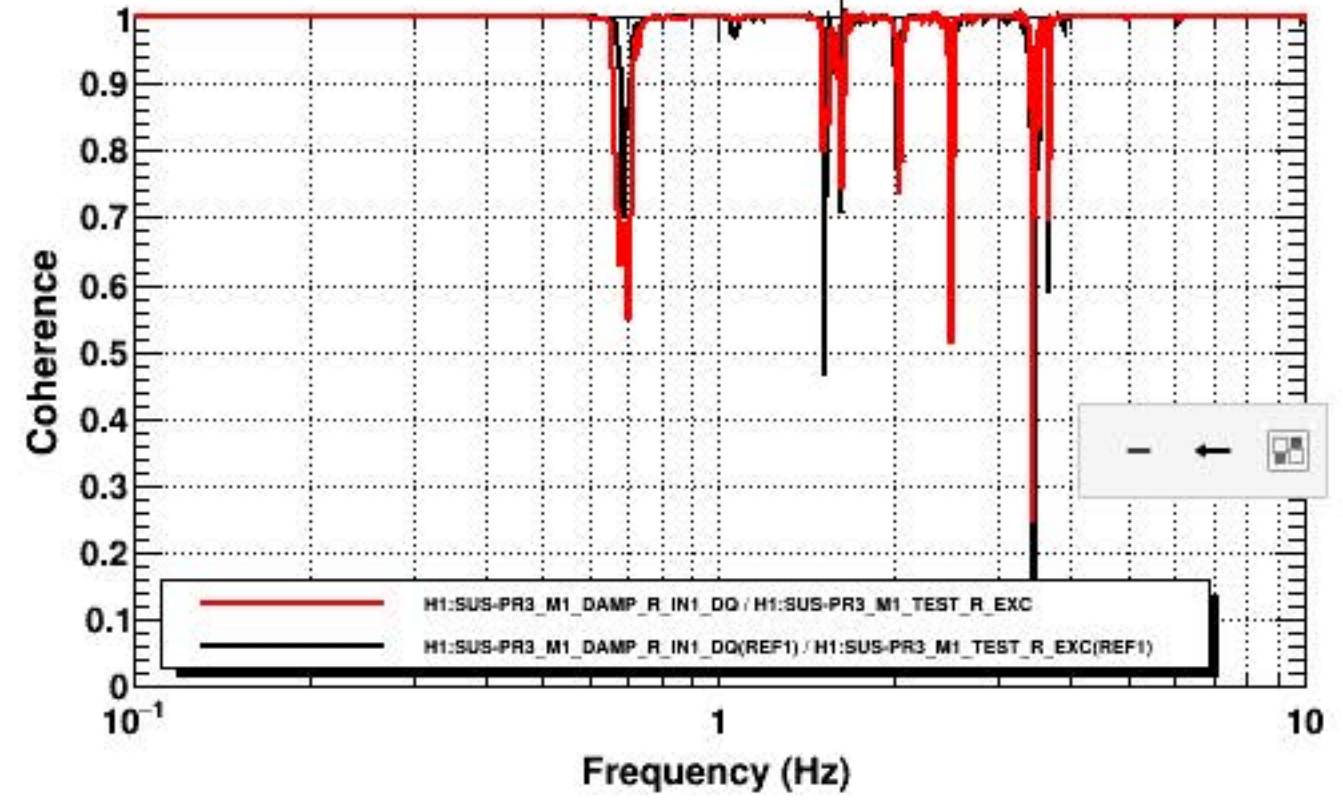

*T0=29/10/2020 17:12:39 Avg=5 BW=0.0117187

Transfer function

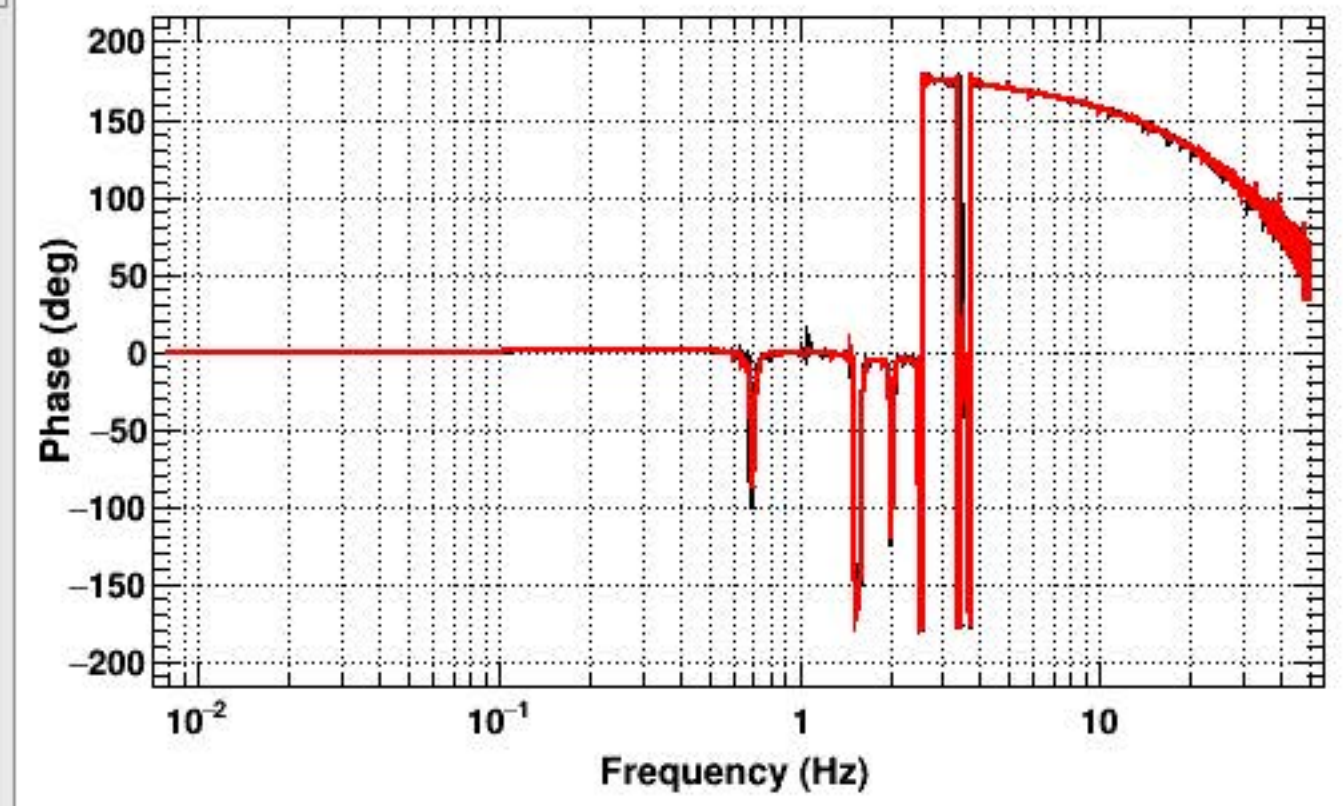

*T0=29/10/2020 17:12:39 Avg=5 *BW=0.0117187

Reset Zoom Active New Options...


Import... Export... Reference... Calibration... Print...

Start Pause

Resume Abort


Input Measurement Excitation Result

Transfer function

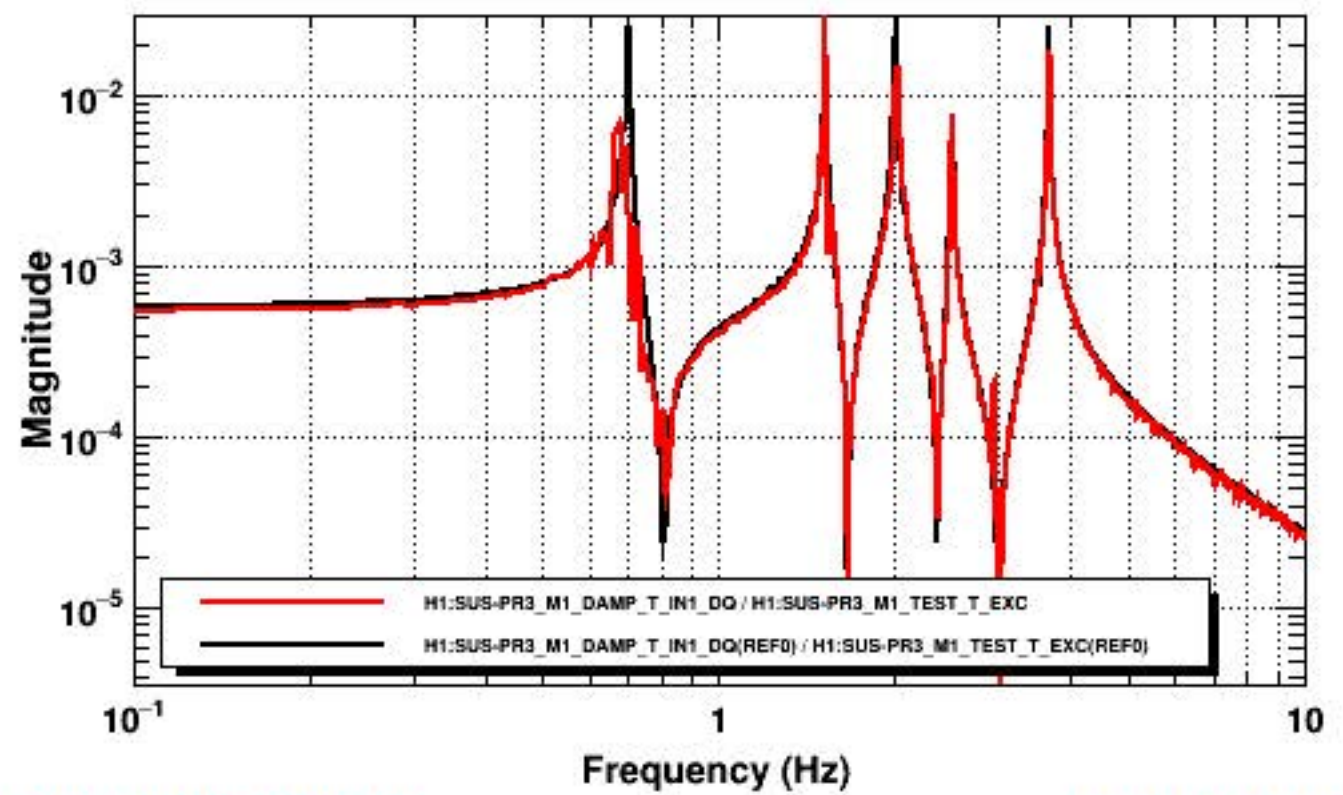


*T0=29/10/2020 17:22:06 Avg=5 *BW=0.0117187

Transfer function

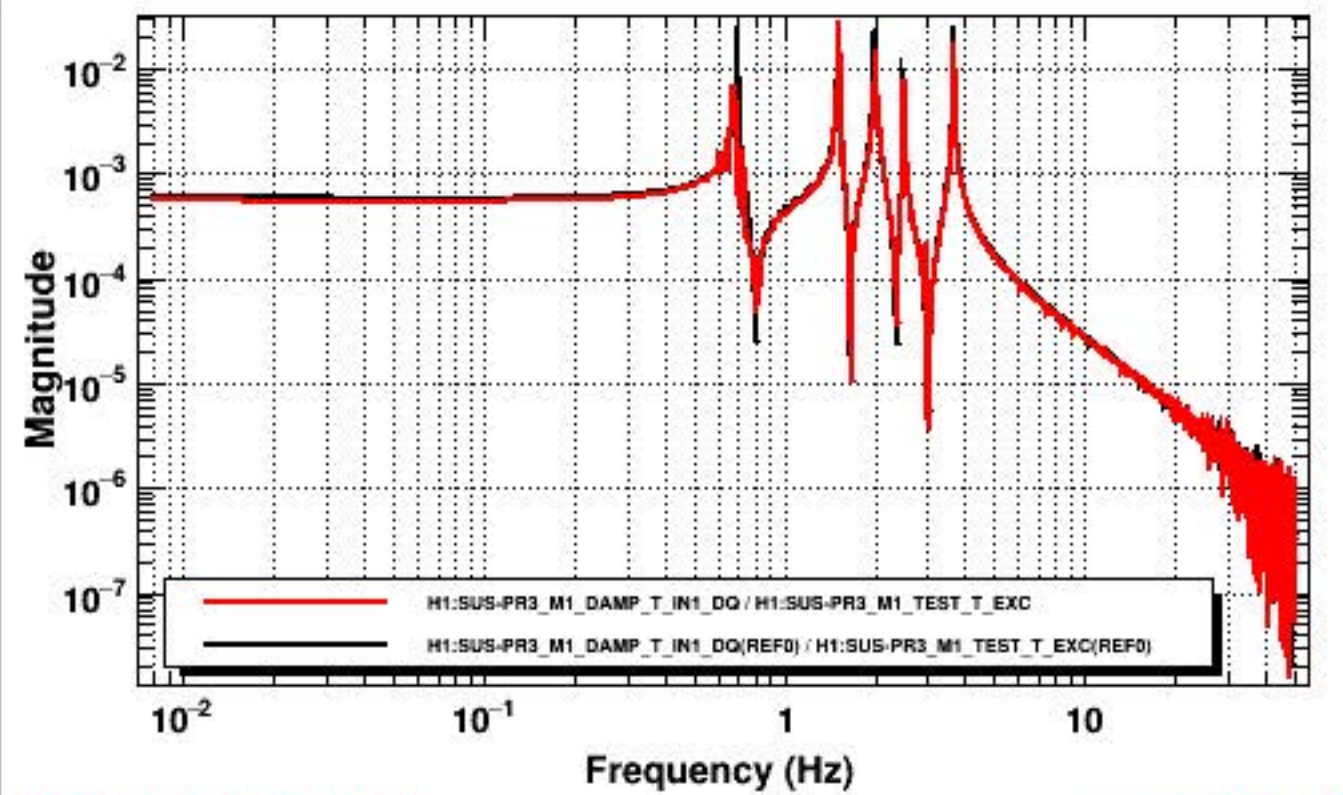


*T0=29/10/2020 17:22:06 Avg=5 *BW=0.0117187

Coherence

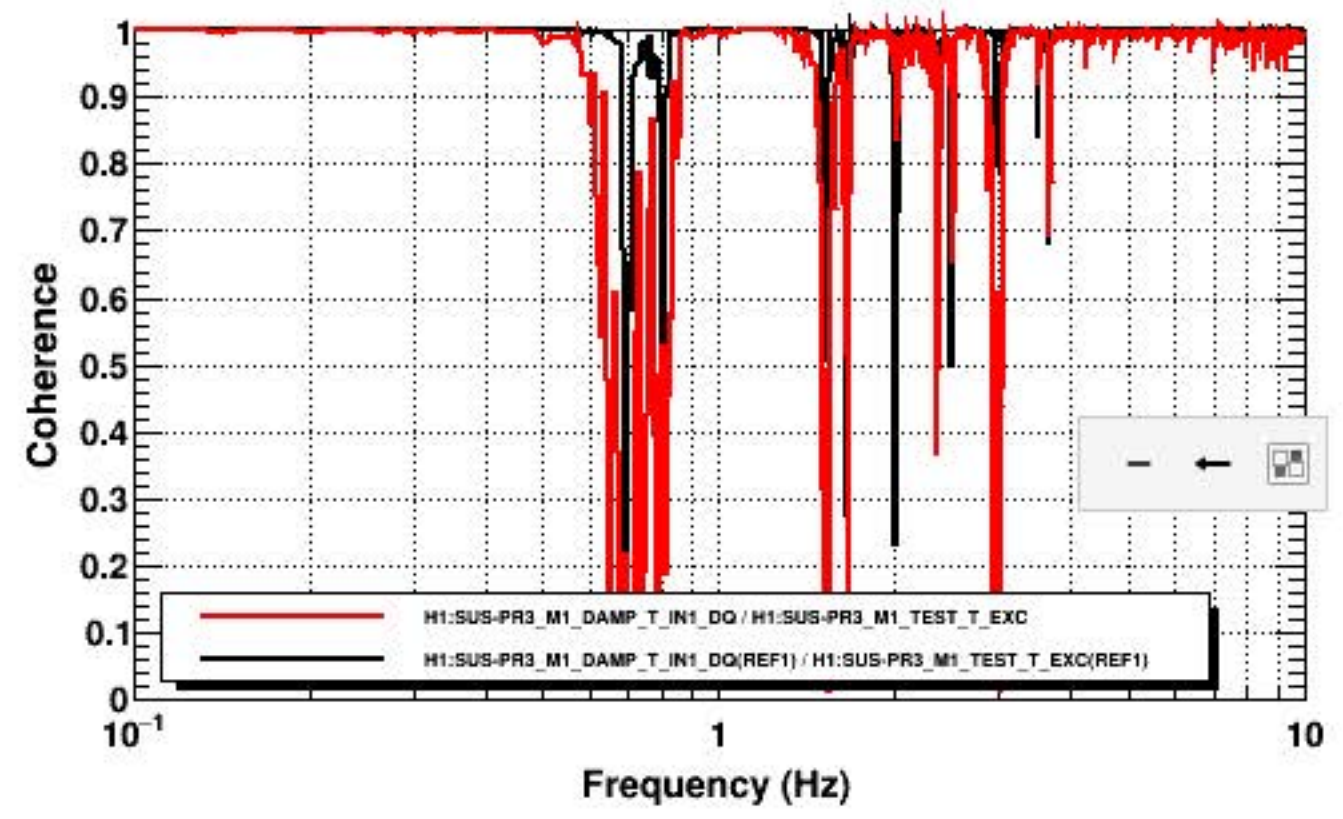

*T0=29/10/2020 17:22:06 Avg=5 BW=0.0117187

Transfer function

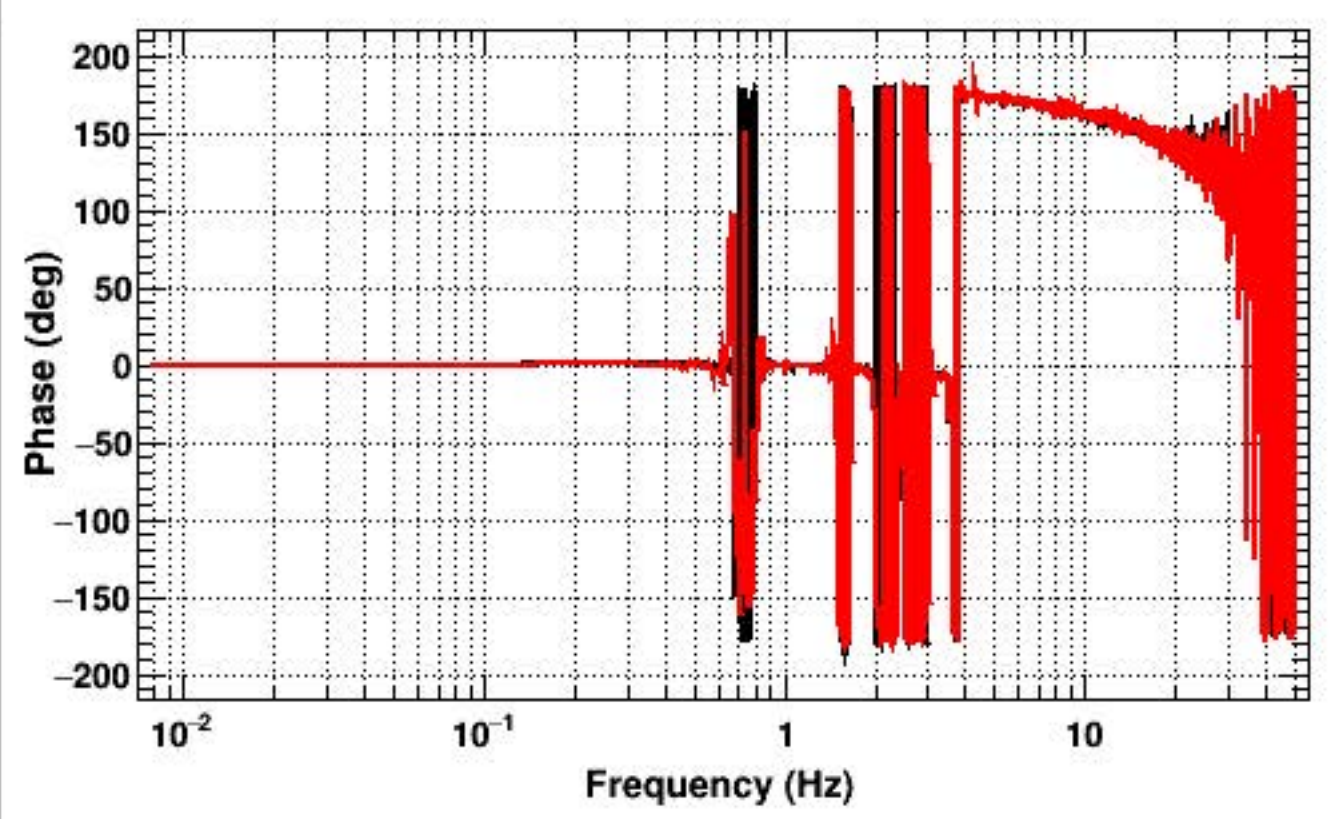

*T0=29/10/2020 17:22:06 Avg=5 *BW=0.0117187


Reset Zoom Active New Options...

Import... Export... Reference... Calibration... Print...

Start Pause Resume Abort


Input Measurement Excitation Result

Transfer function

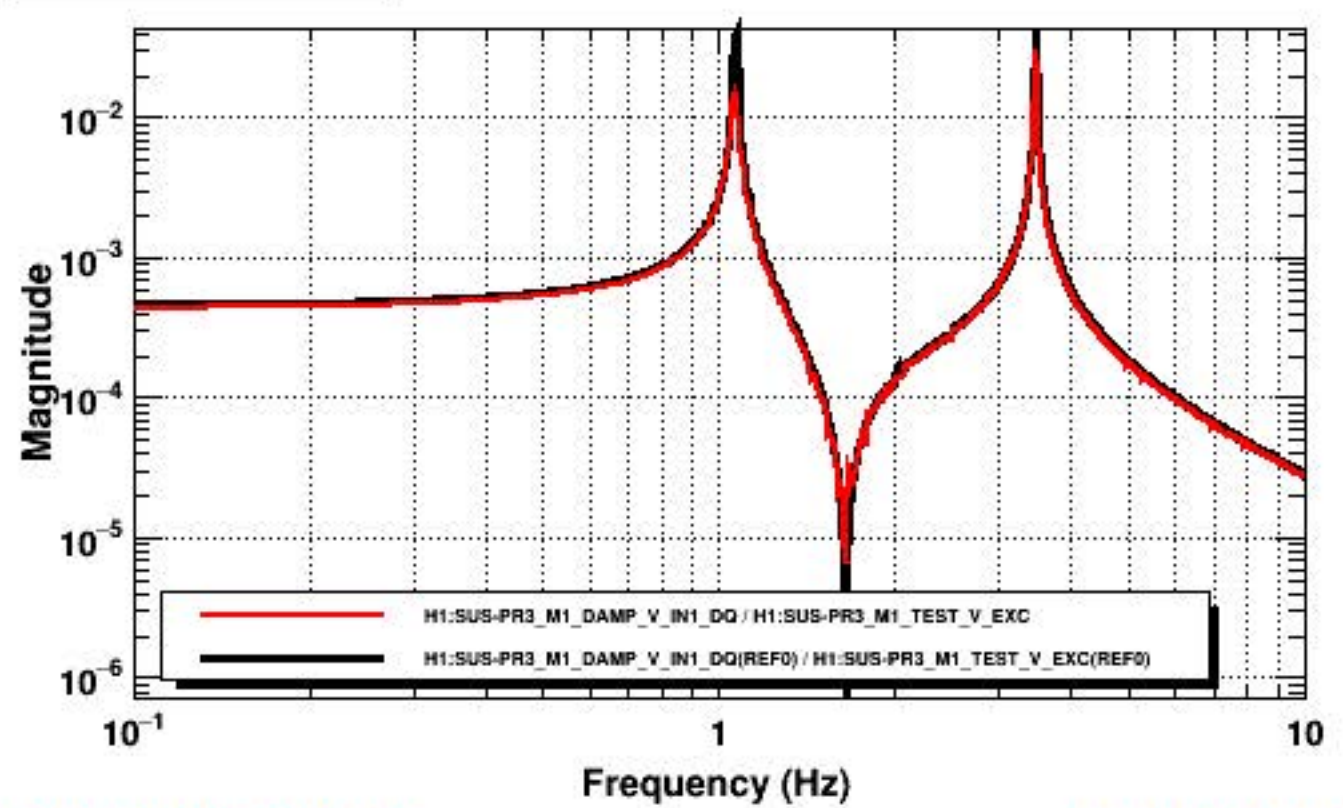


*T0=29/10/2020 17:31:47 Avg=5 *BW=0.0117187

Transfer function

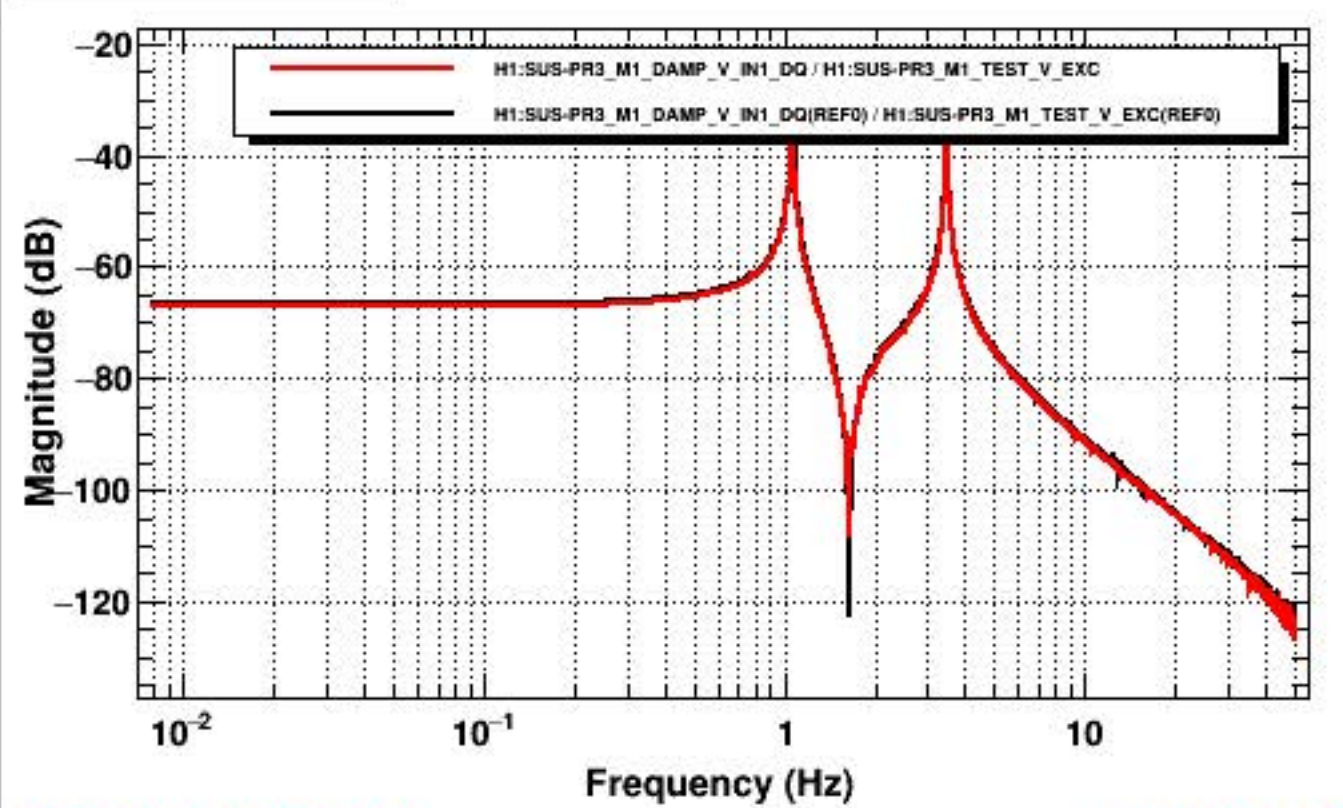


*T0=29/10/2020 17:31:47 Avg=5 *BW=0.0117187

Coherence

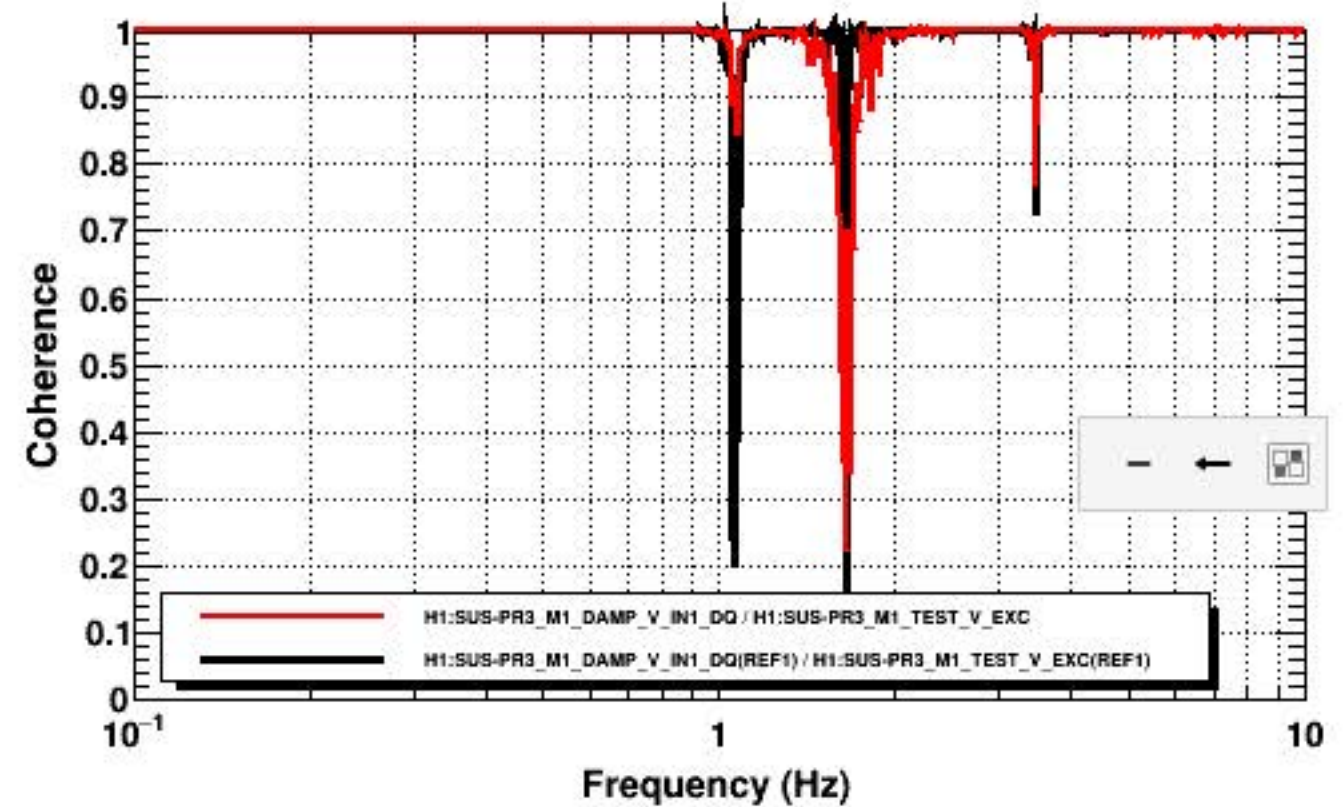

*T0=29/10/2020 17:31:47 Avg=5 BW=0.0117187

Transfer function

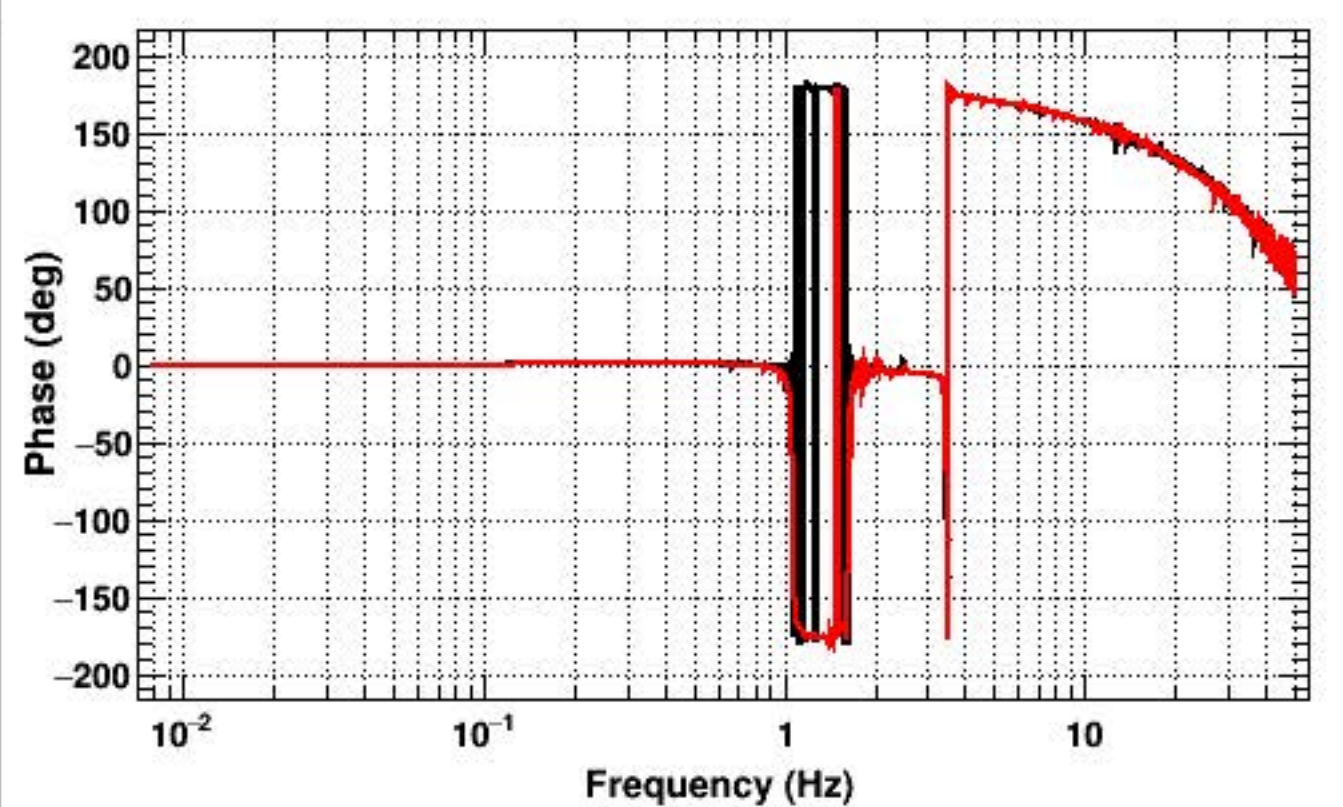

*T0=29/10/2020 17:31:47 Avg=5 *BW=0.0117187


Reset Zoom Active New Options...

Import... Export... Reference... Calibration... Print...

Start Pause Resume Abort


Input Measurement Excitation Result

Transfer function

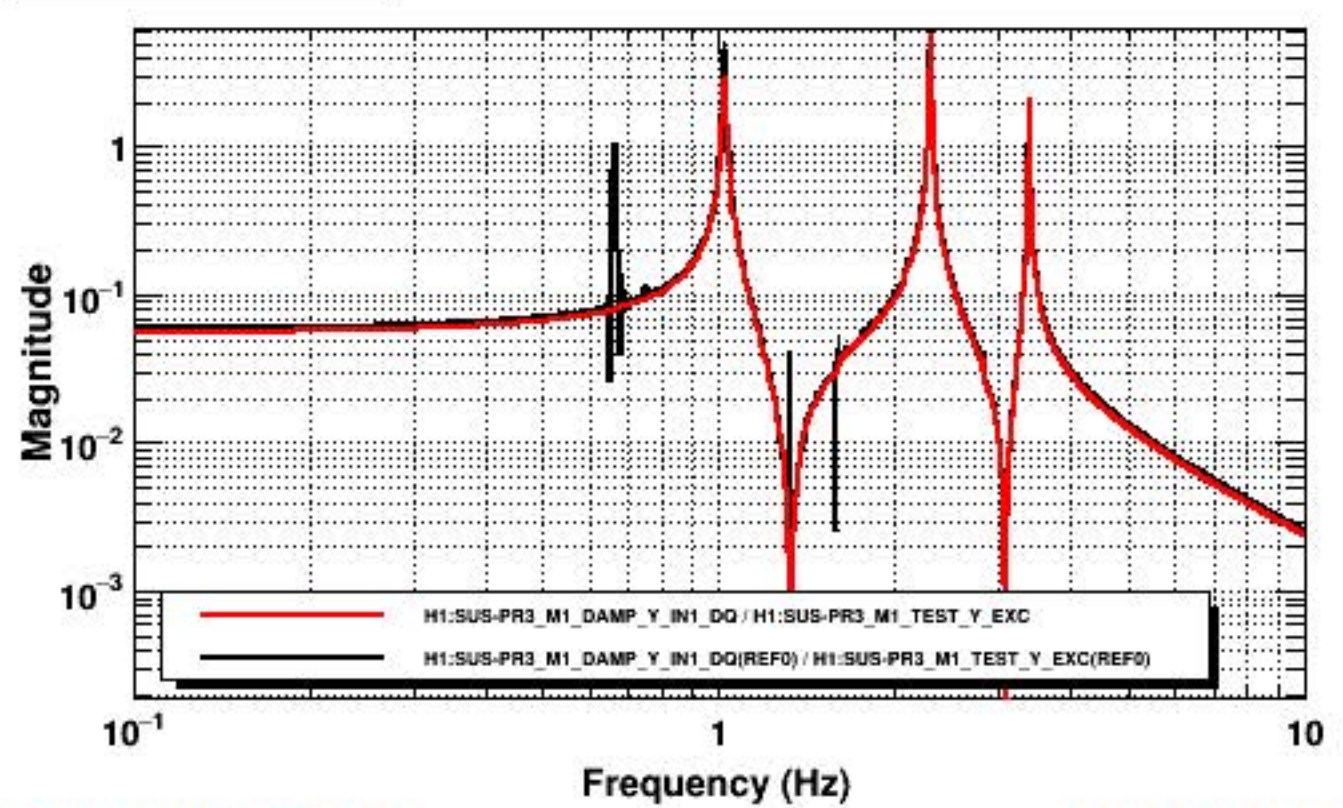


*T0=29/10/2020 17:41:47 Avg=5 *BW=0.0117187

Transfer function

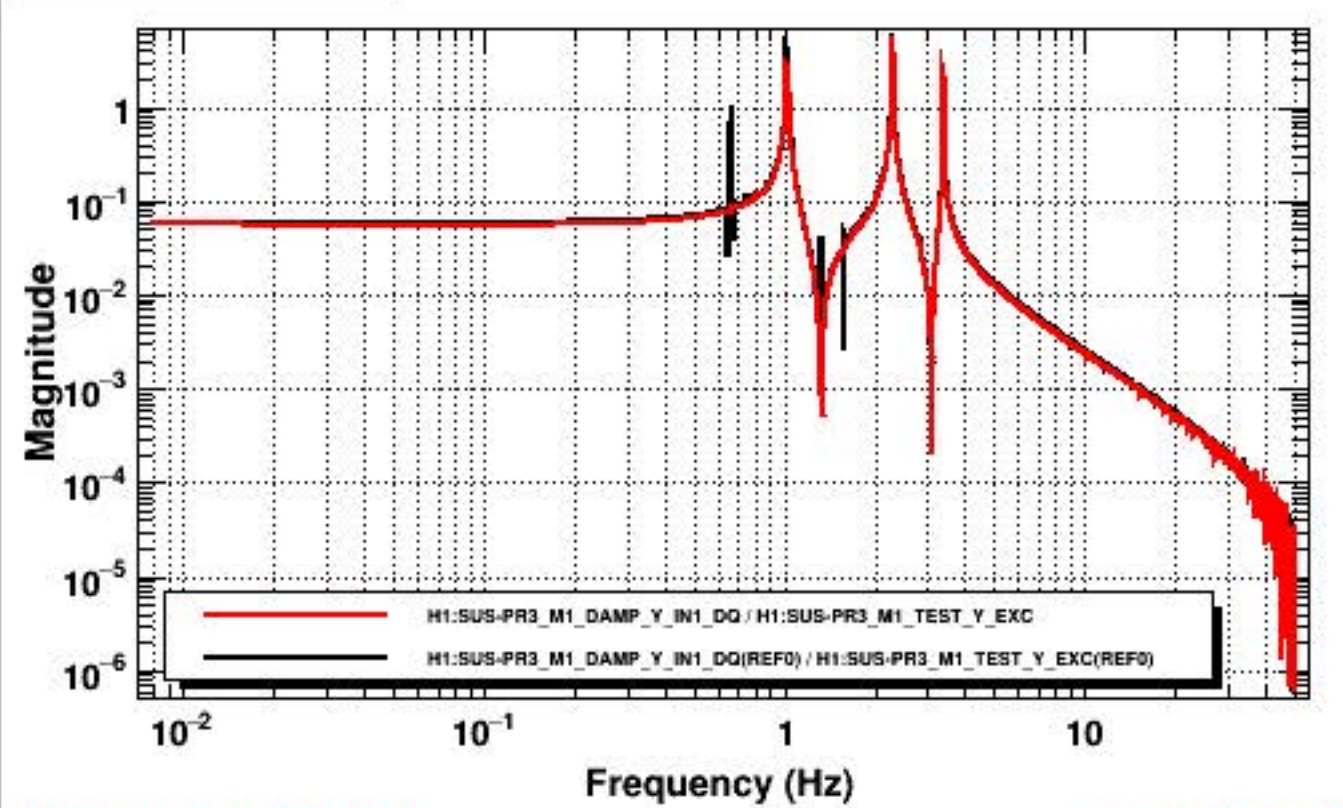


*T0=29/10/2020 17:41:47 Avg=5 *BW=0.0117187

Coherence

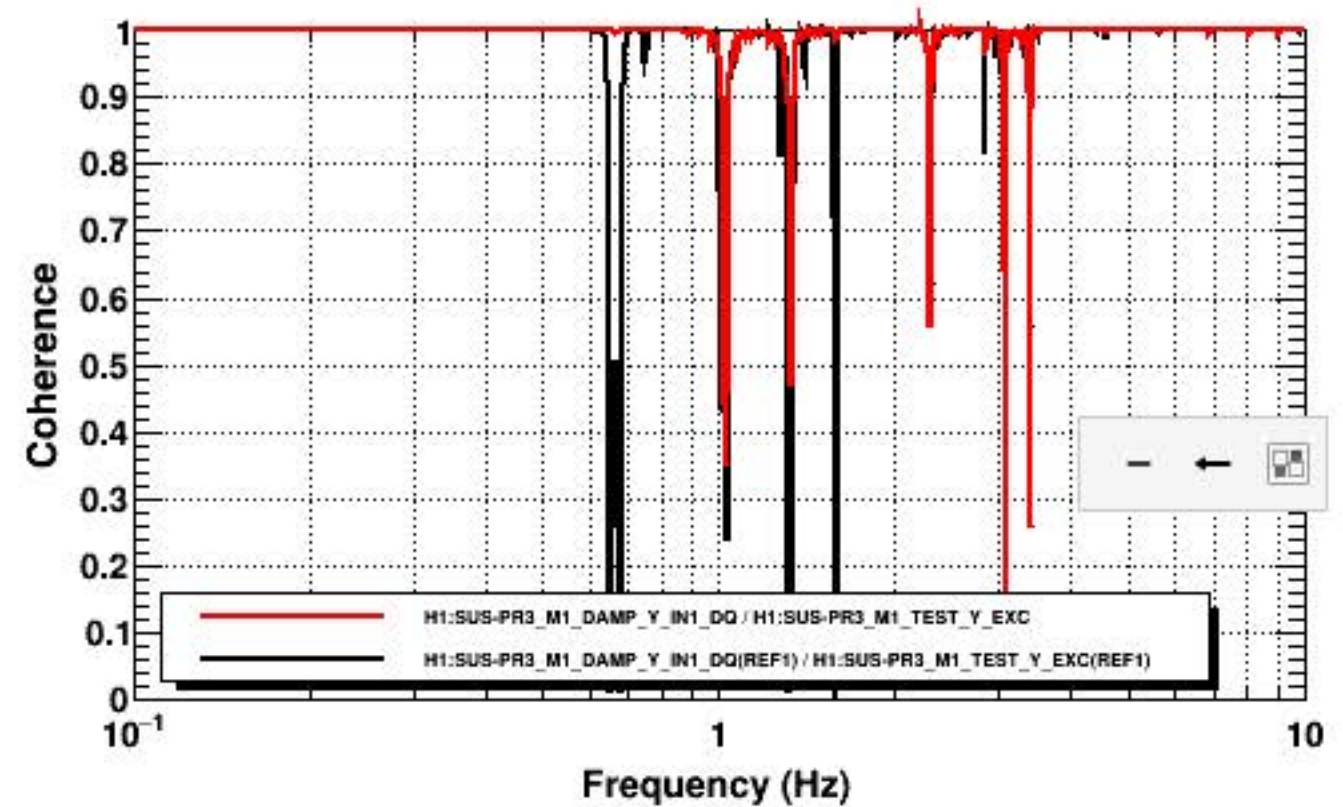

*T0=29/10/2020 17:41:47 Avg=5 BW=0.0117187

Transfer function

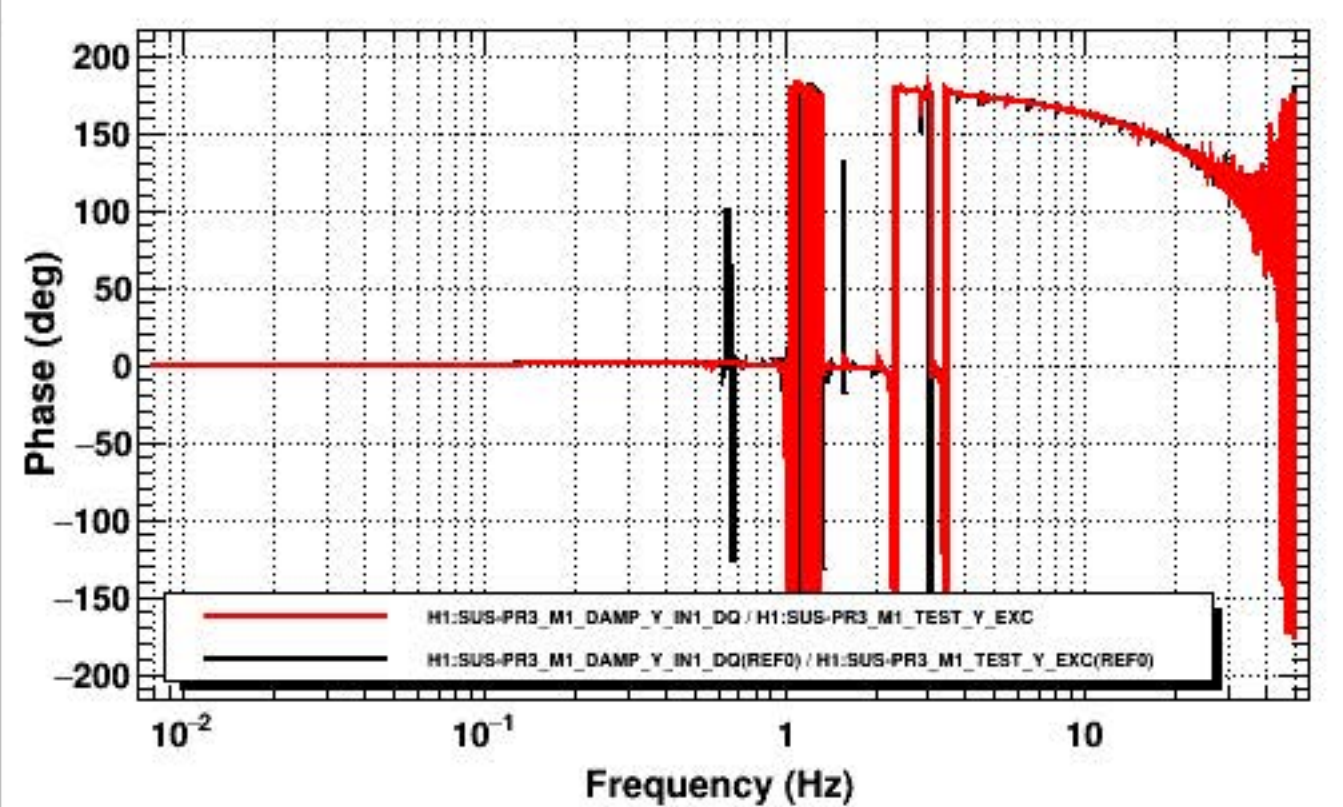

*T0=29/10/2020 17:41:47 Avg=5 *BW=0.0117187

Reset Zoom Active New Options...

Import... Export... Reference... Calibration... Print...

Start Pause

Resume Abort