


Transfer function

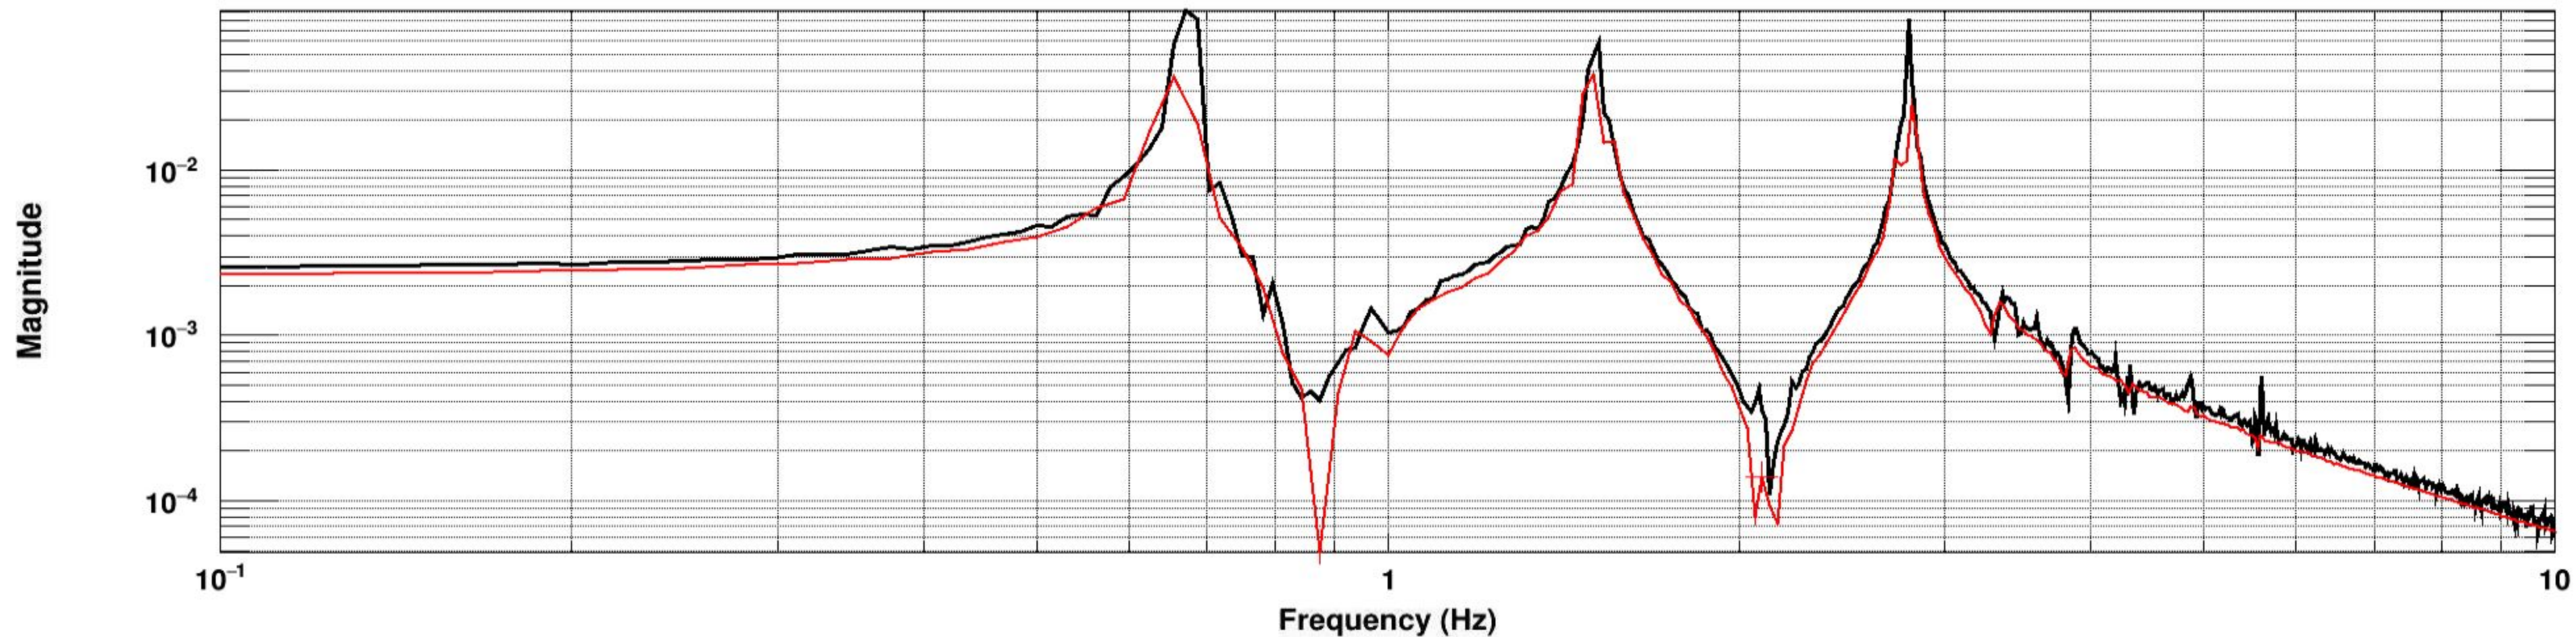


*T0=20/01/2024 19:13:32

Avg=5

*BW=0.046875

Coherence

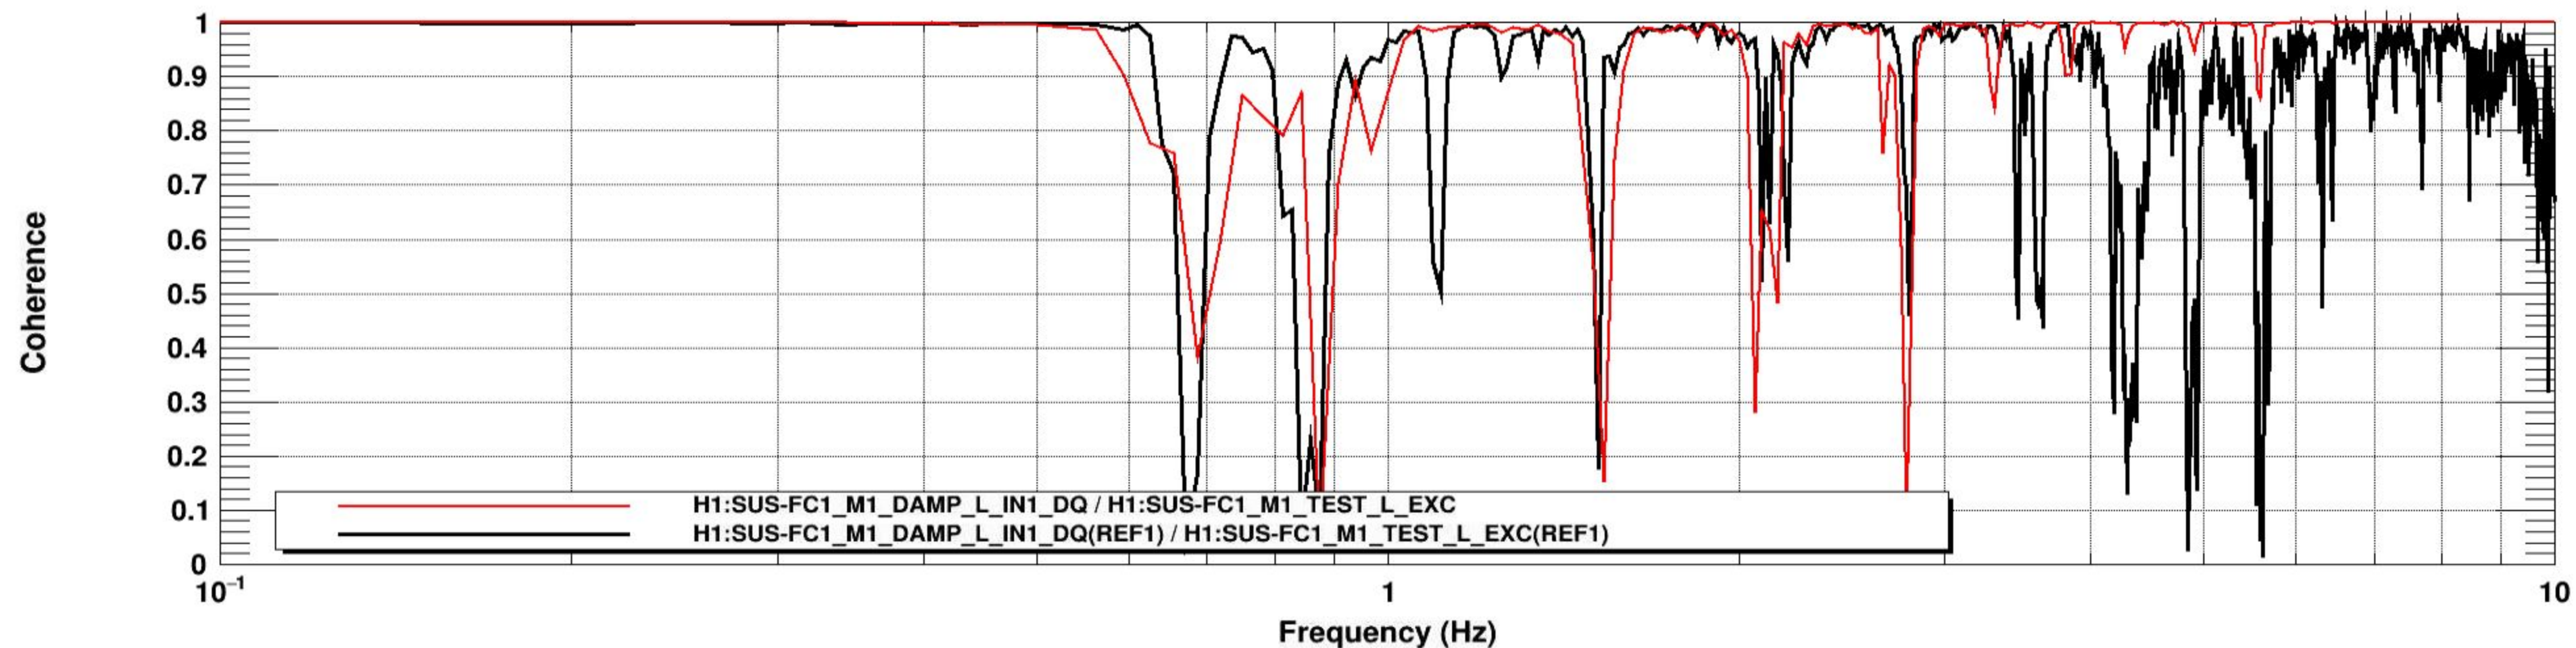

*T0=20/01/2024 19:13:32

Avg=5

*BW=0.046875

Active

New

Options...

Import...

Export...

Reference...

Calibration...


Print...

Pause

Resume

Abort

Transfer function

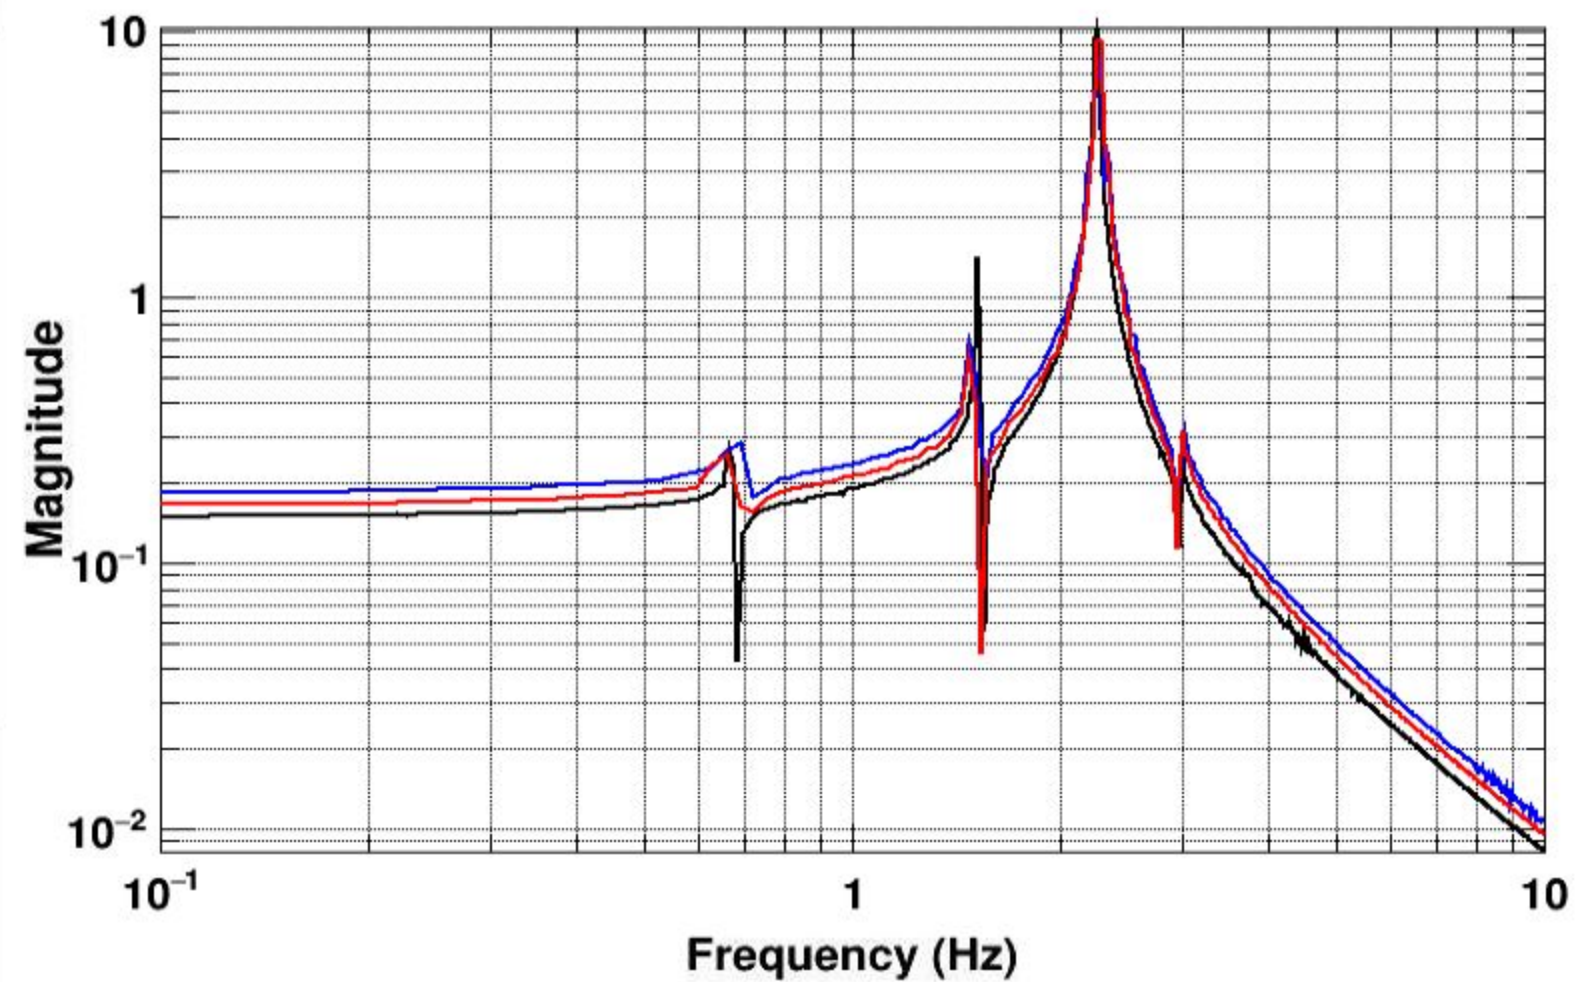


*T0=20/01/2024 19:17:44

Avg=5

*BW=0.046875

Coherence

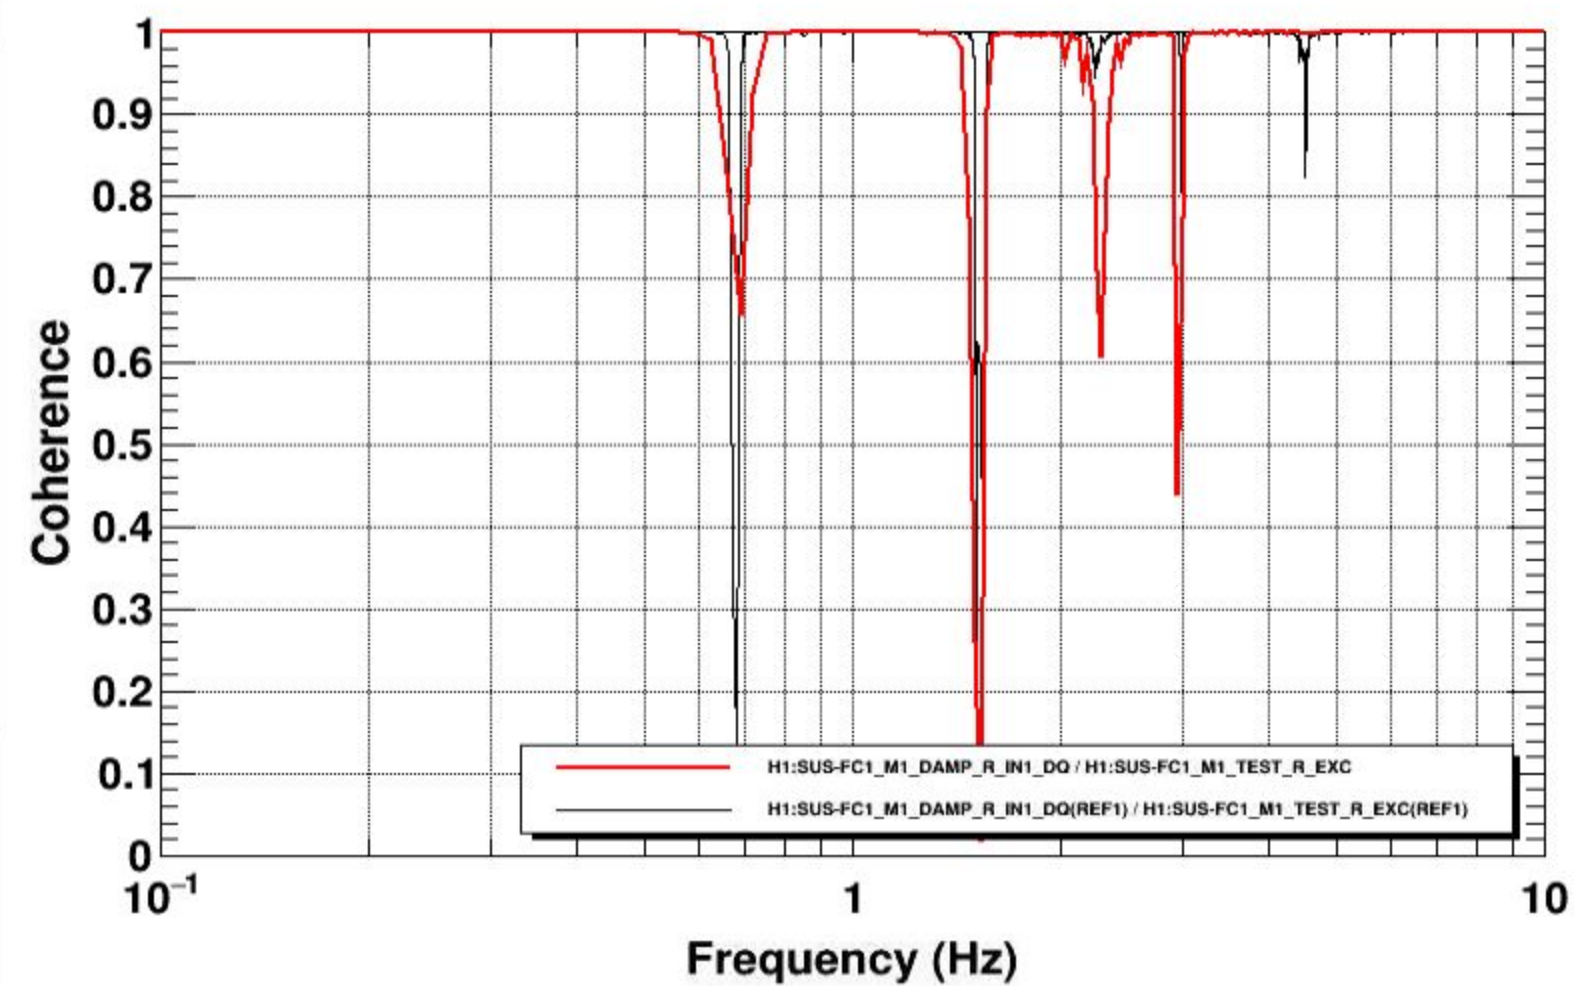


*T0=20/01/2024 19:17:44

Avg=5

*BW=0.046875

Transfer function

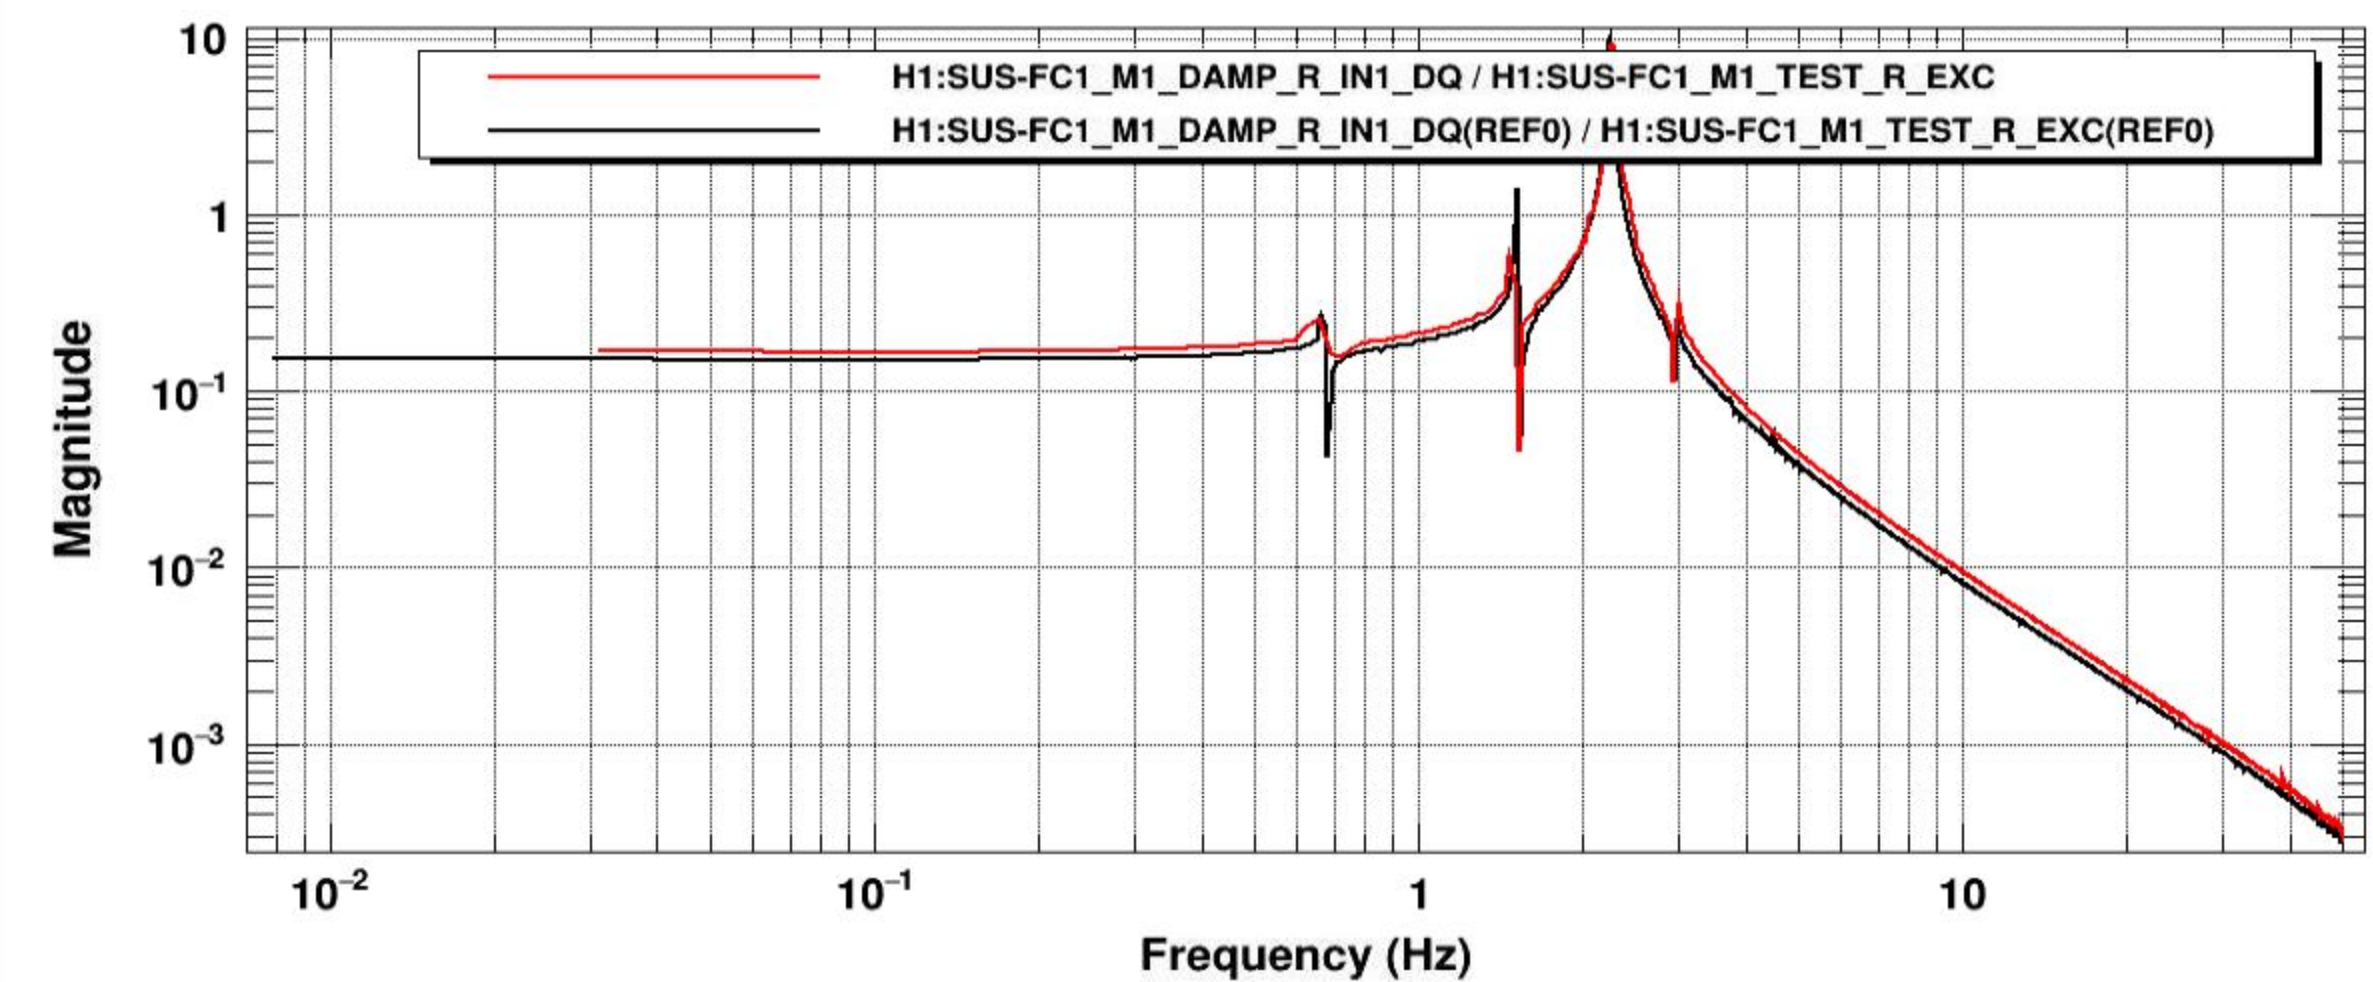


*T0=20/01/2024 19:17:44

Avg=5

*BW=0.046875

Transfer function

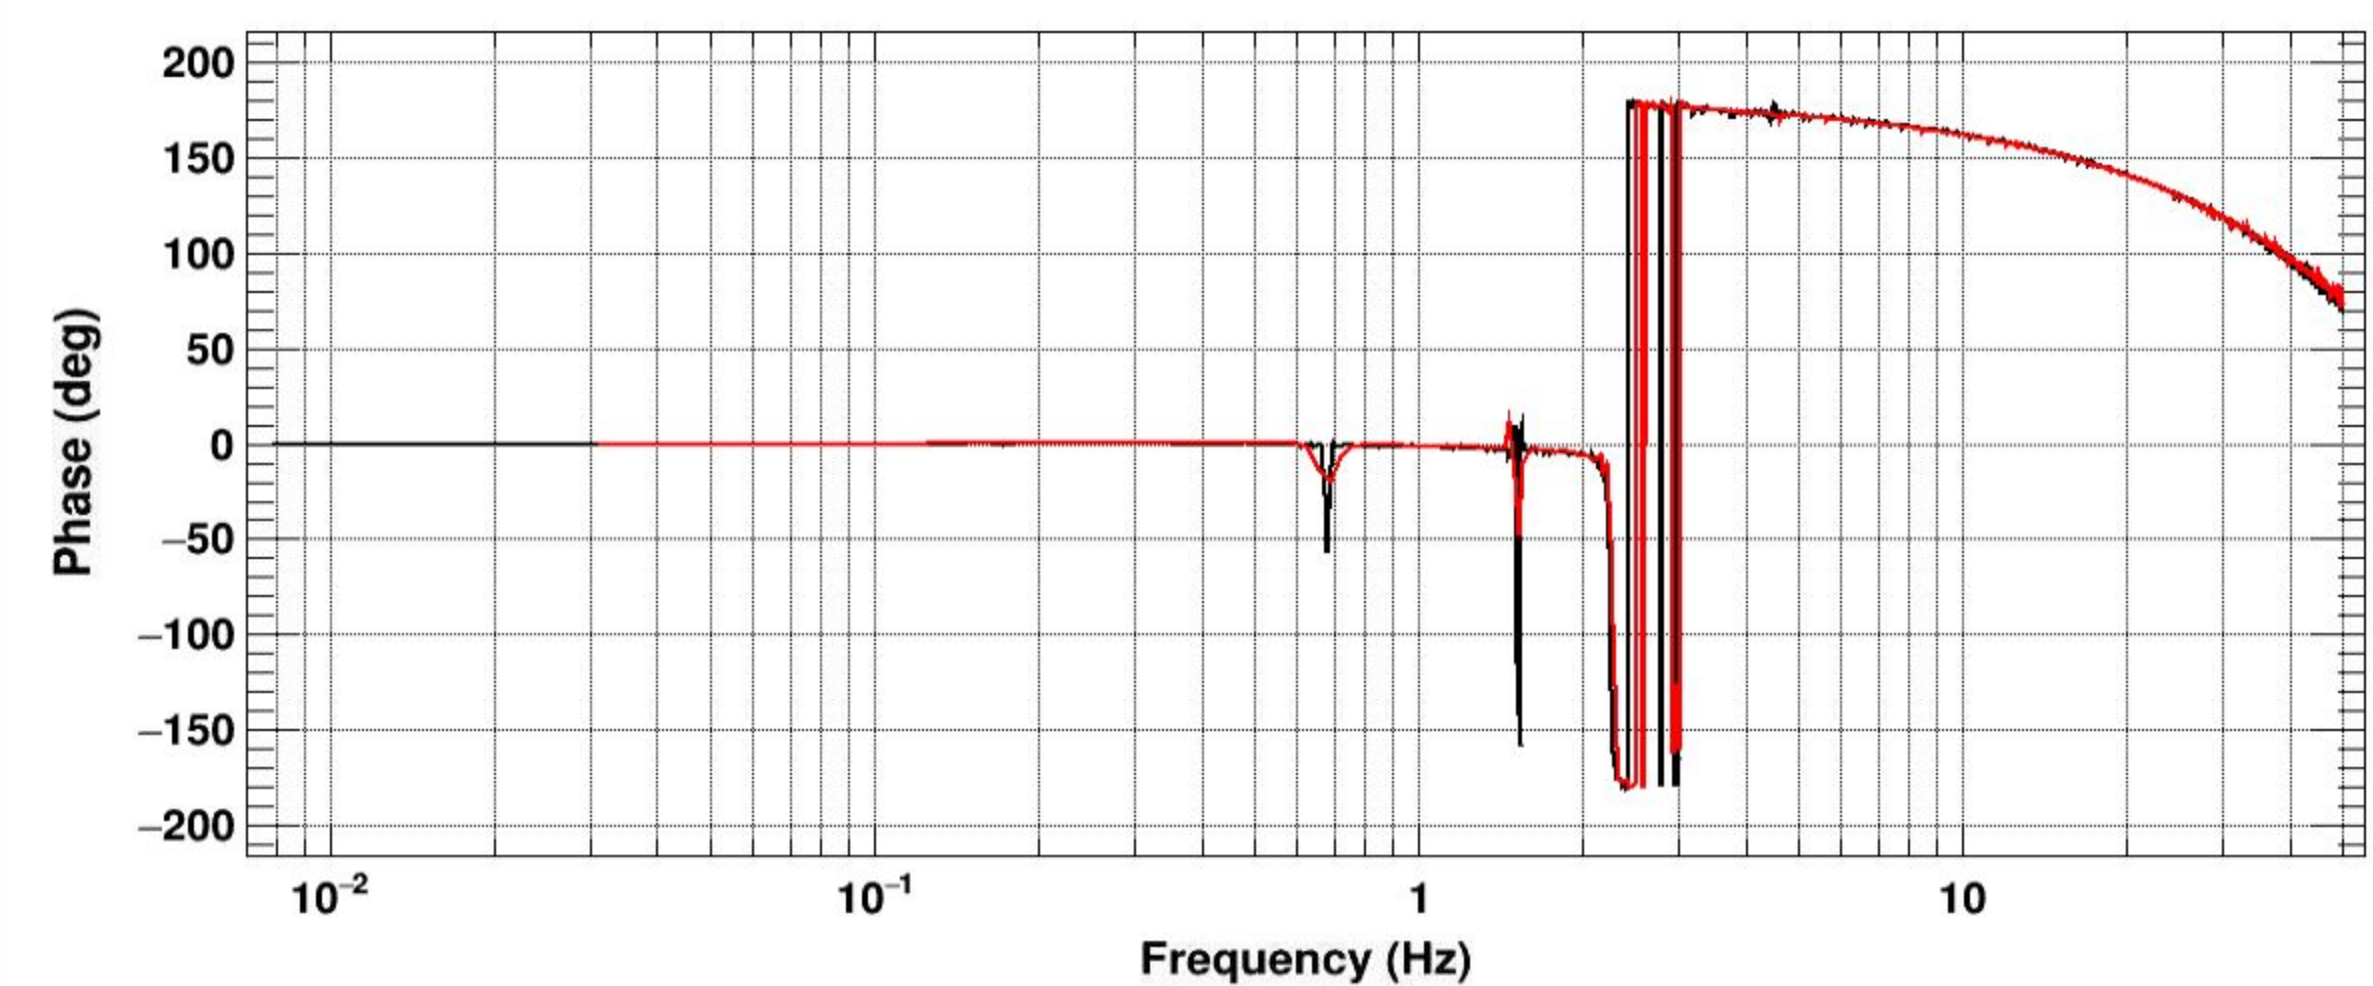

*T0=20/01/2024 19:17:44

Avg=5

*BW=0.046875

Active

New

Options...

Import...

Export...

Reference...

Calibration...


Print...

Pause

Resume

Abort

Transfer function

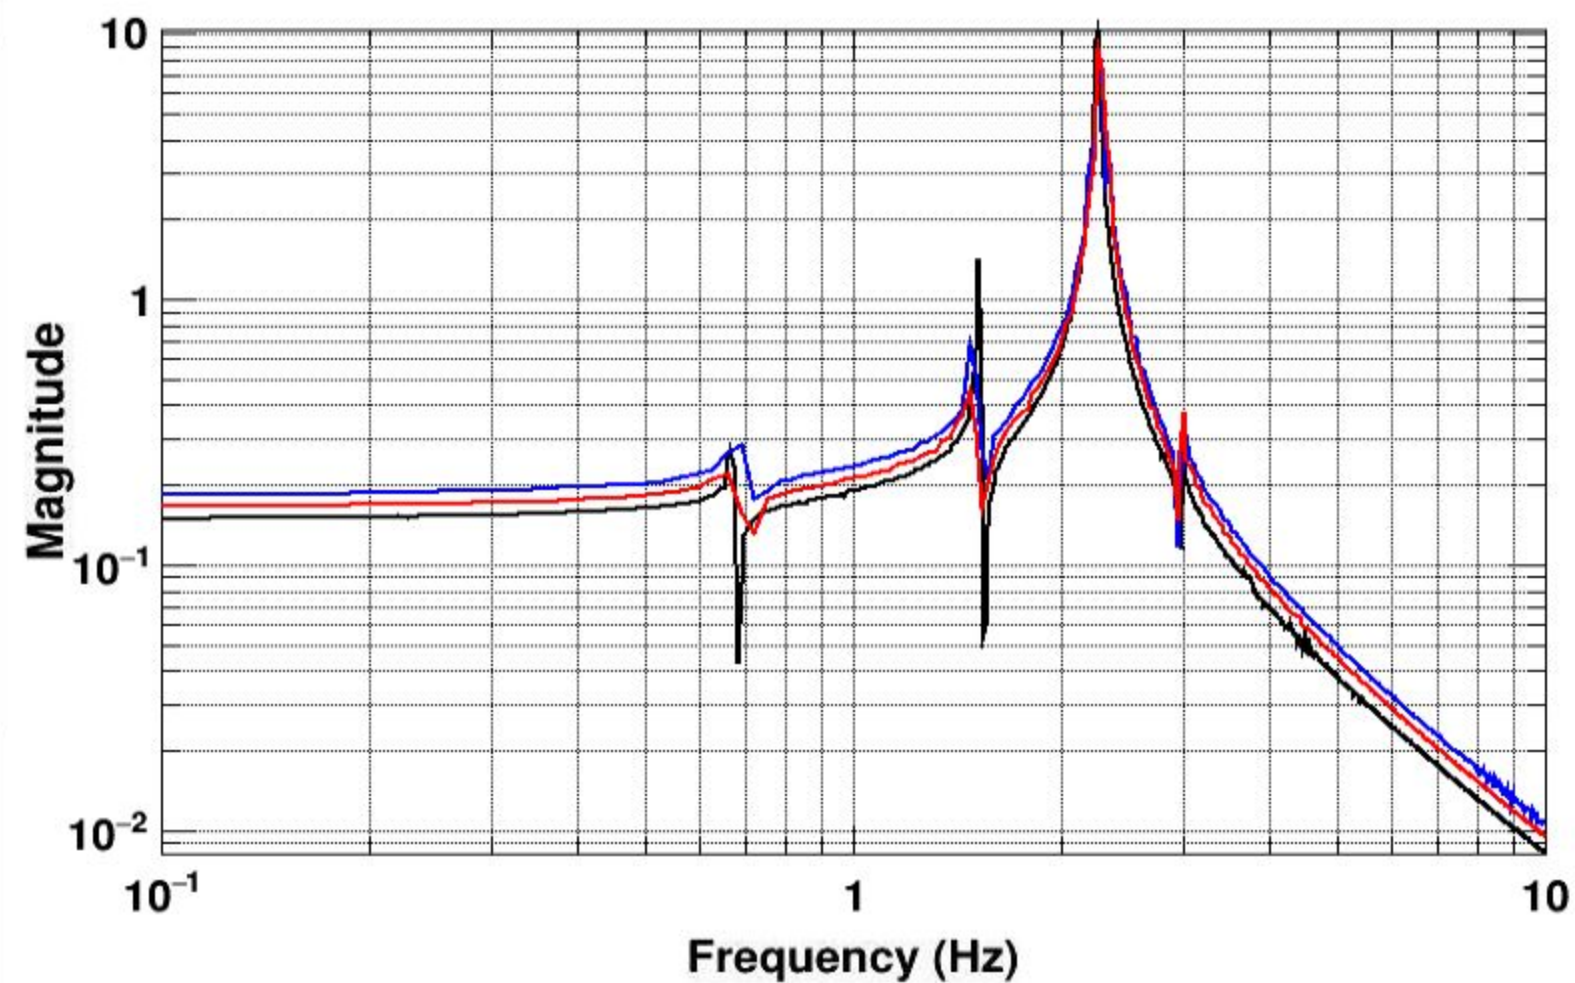


*T0=20/01/2024 19:20:57

Avg=5

*BW=0.046875

Transfer function

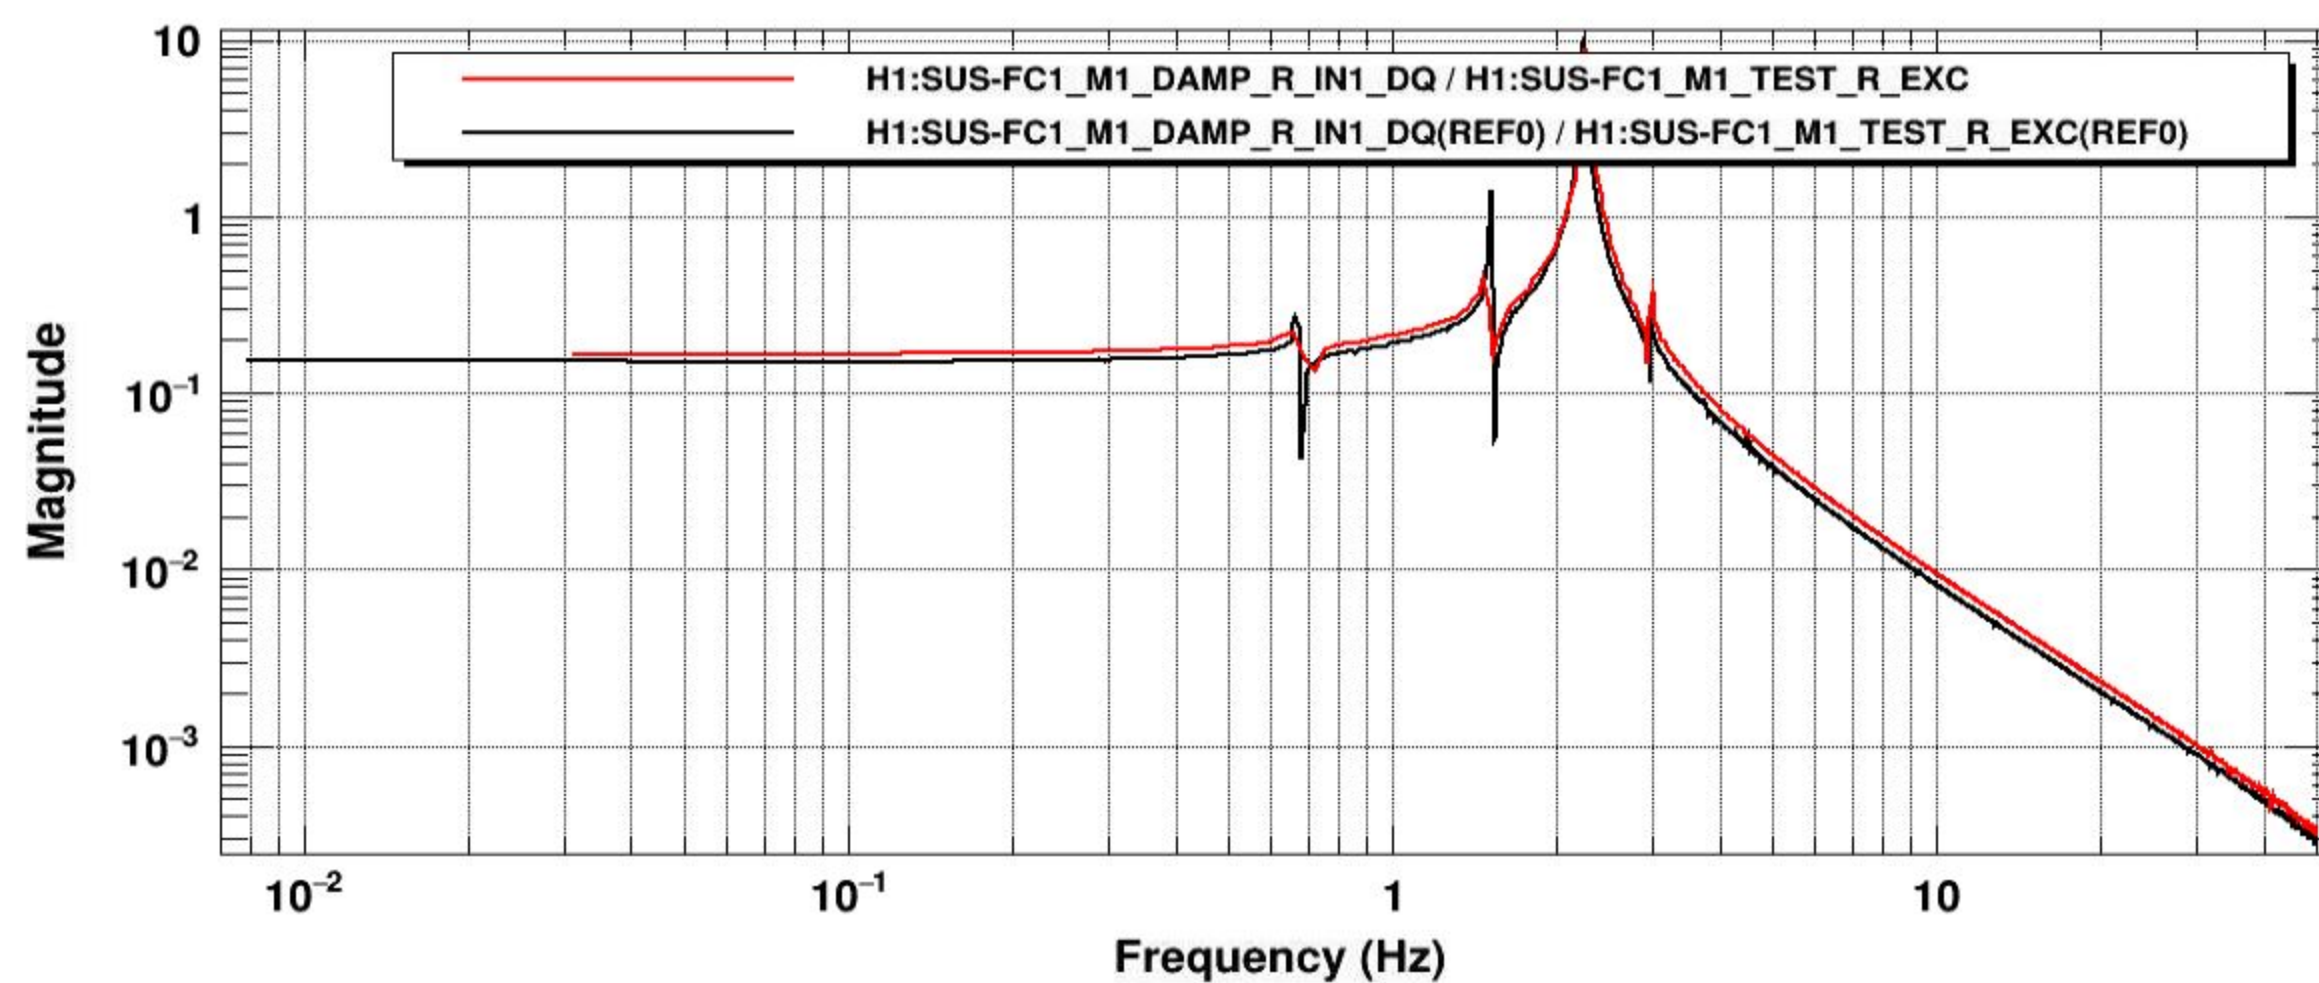


*T0=20/01/2024 19:20:57

Avg=5

*BW=0.046875

Coherence

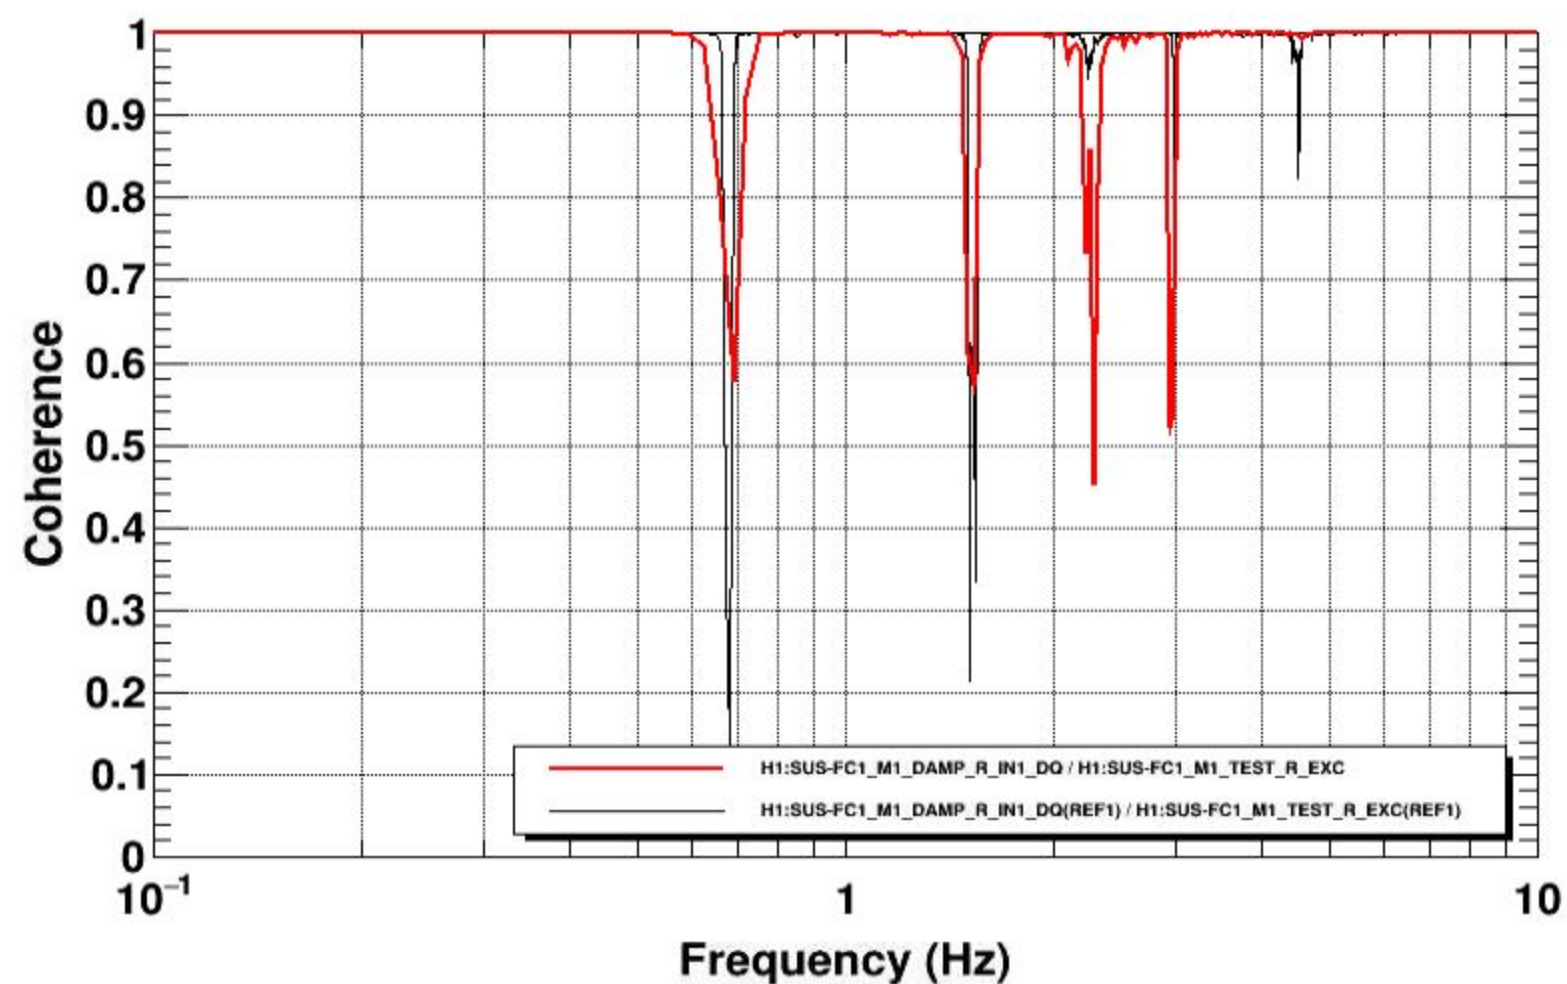


*T0=20/01/2024 19:20:57

Avg=5

*BW=0.046875

Transfer function

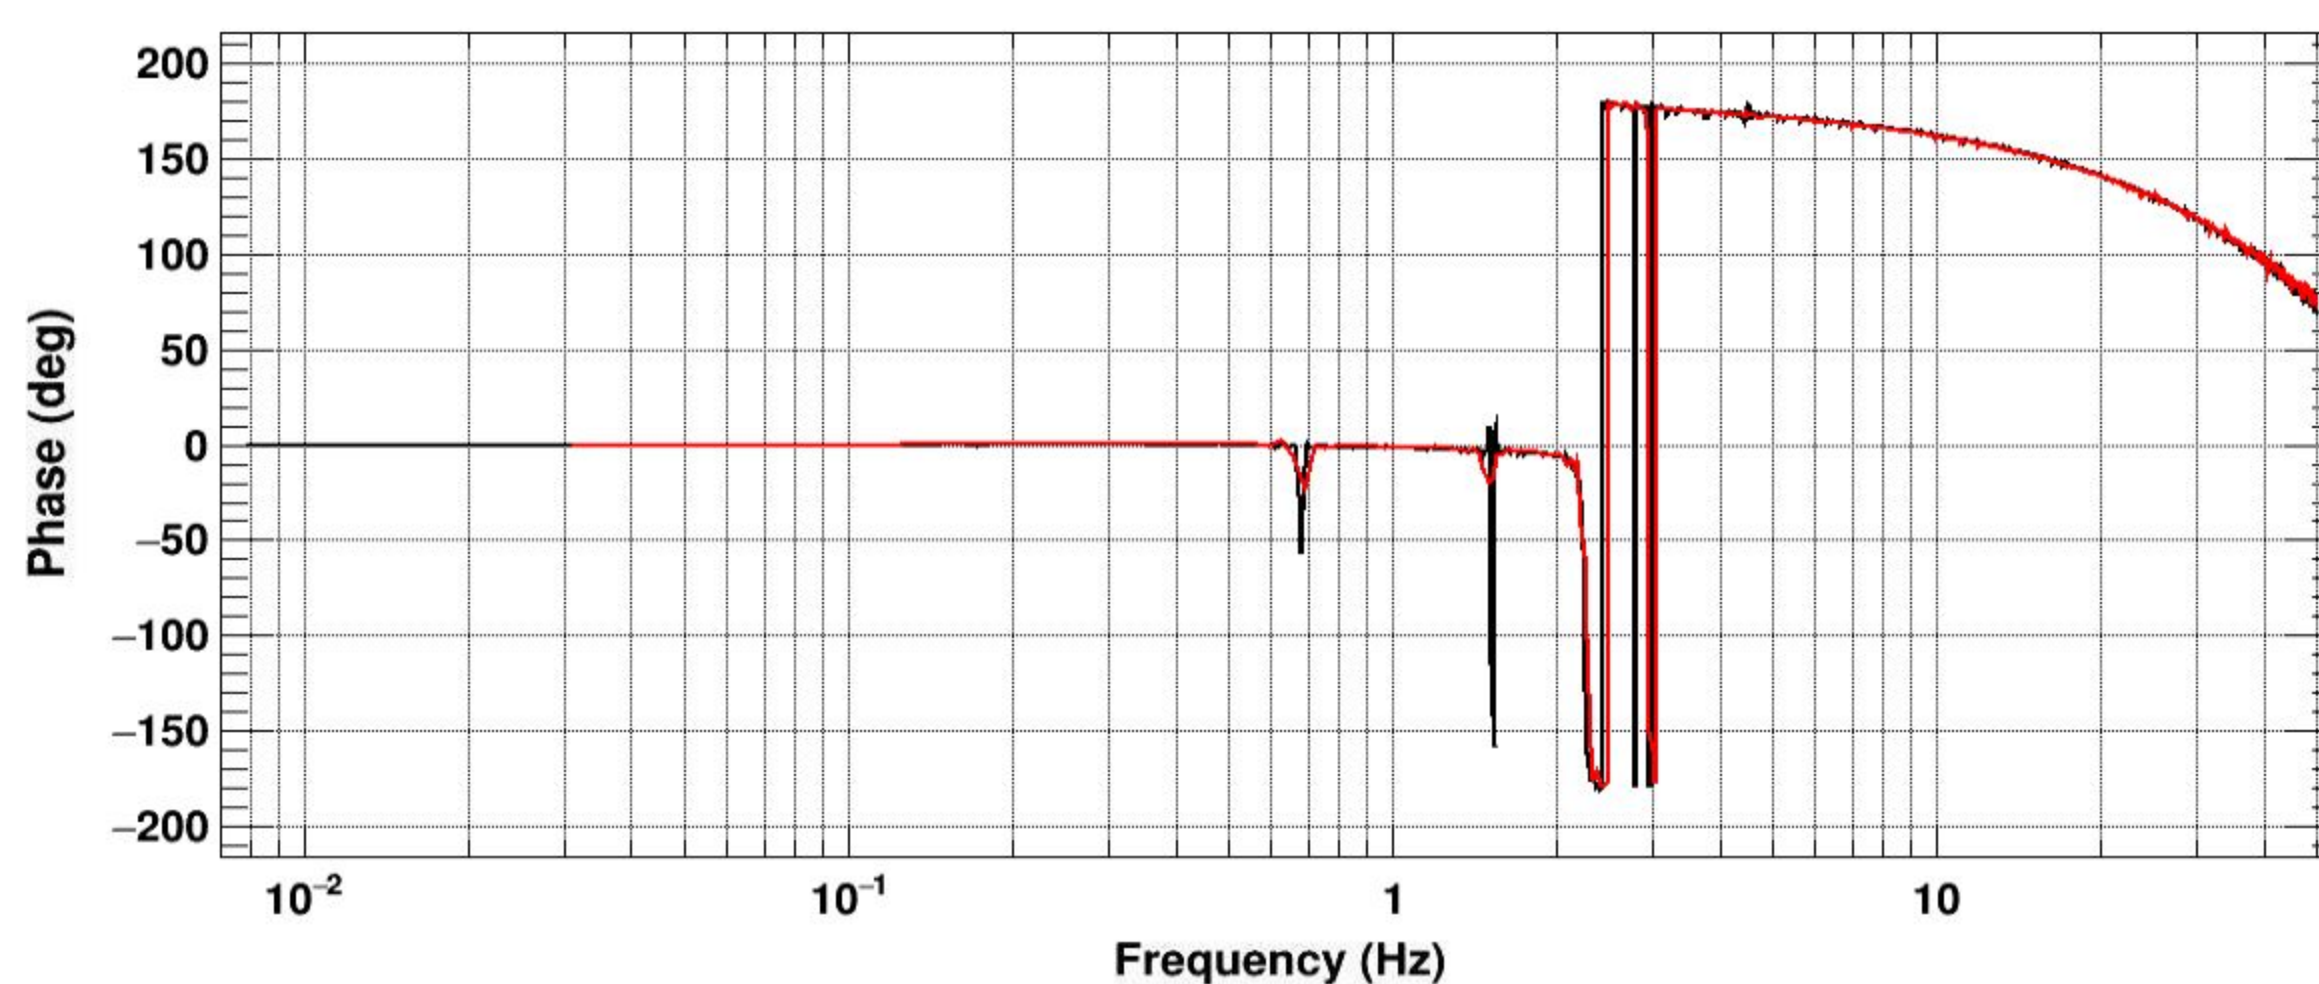

*T0=20/01/2024 19:20:57

Avg=5

*BW=0.046875

Active

New

Options...

Import...

Export...

Reference...

Calibration...

Print...

Pause

Resume


Abort

Repeat

Fourier tools

done

Transfer function

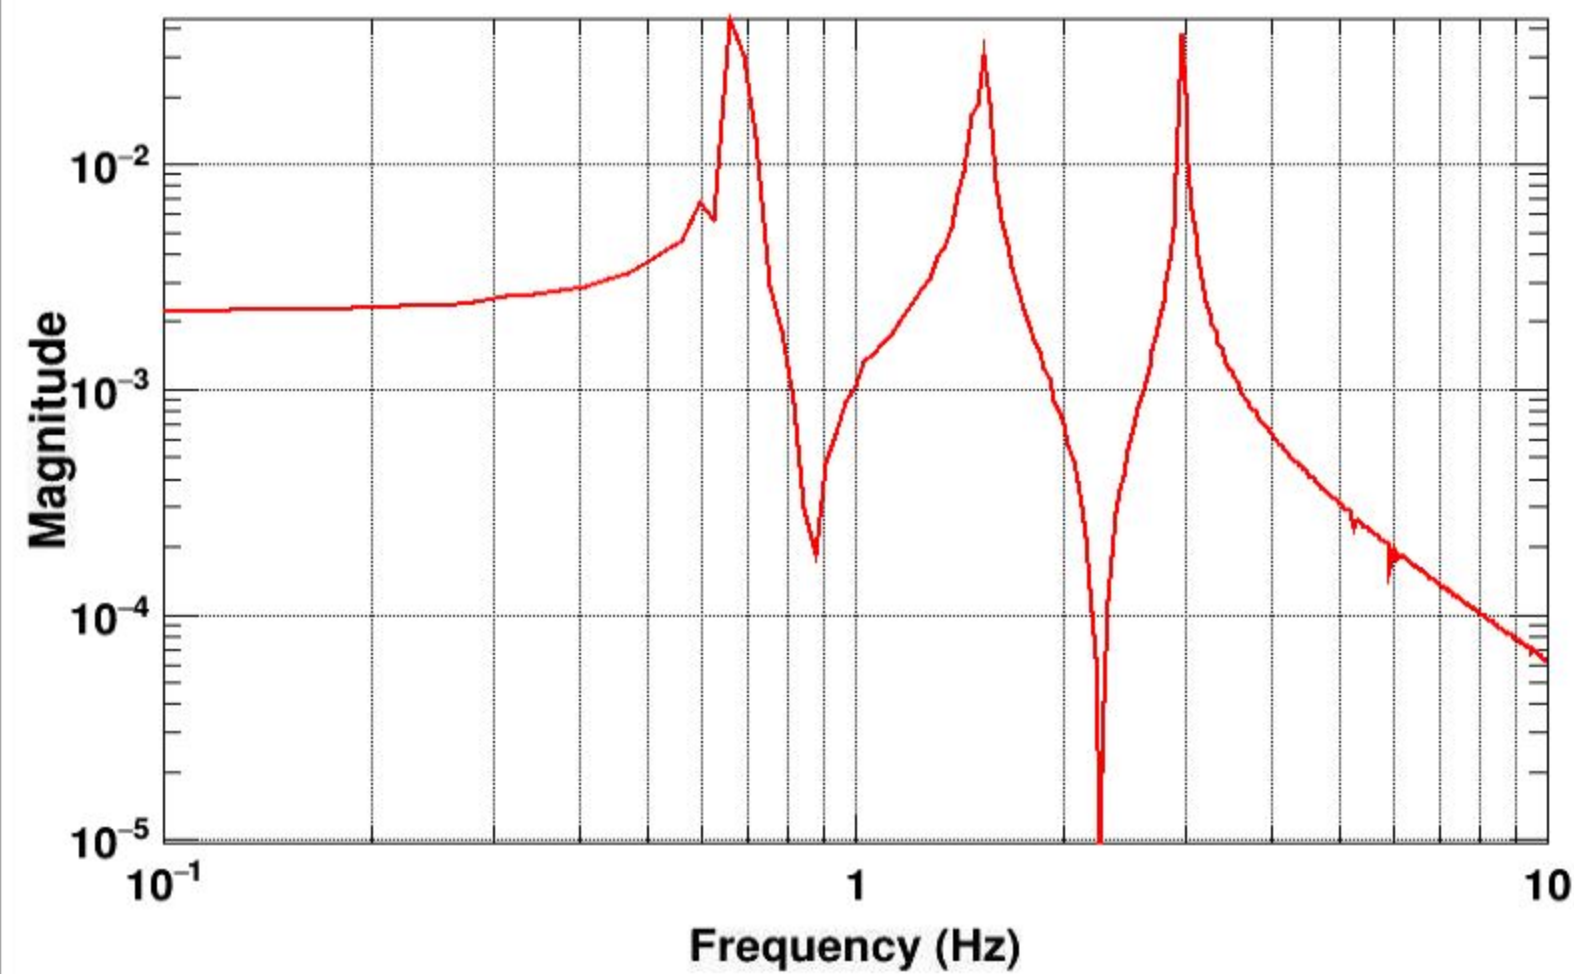


T0=20/01/2024 19:24:18

Avg=5

BW=0.046875

Transfer function

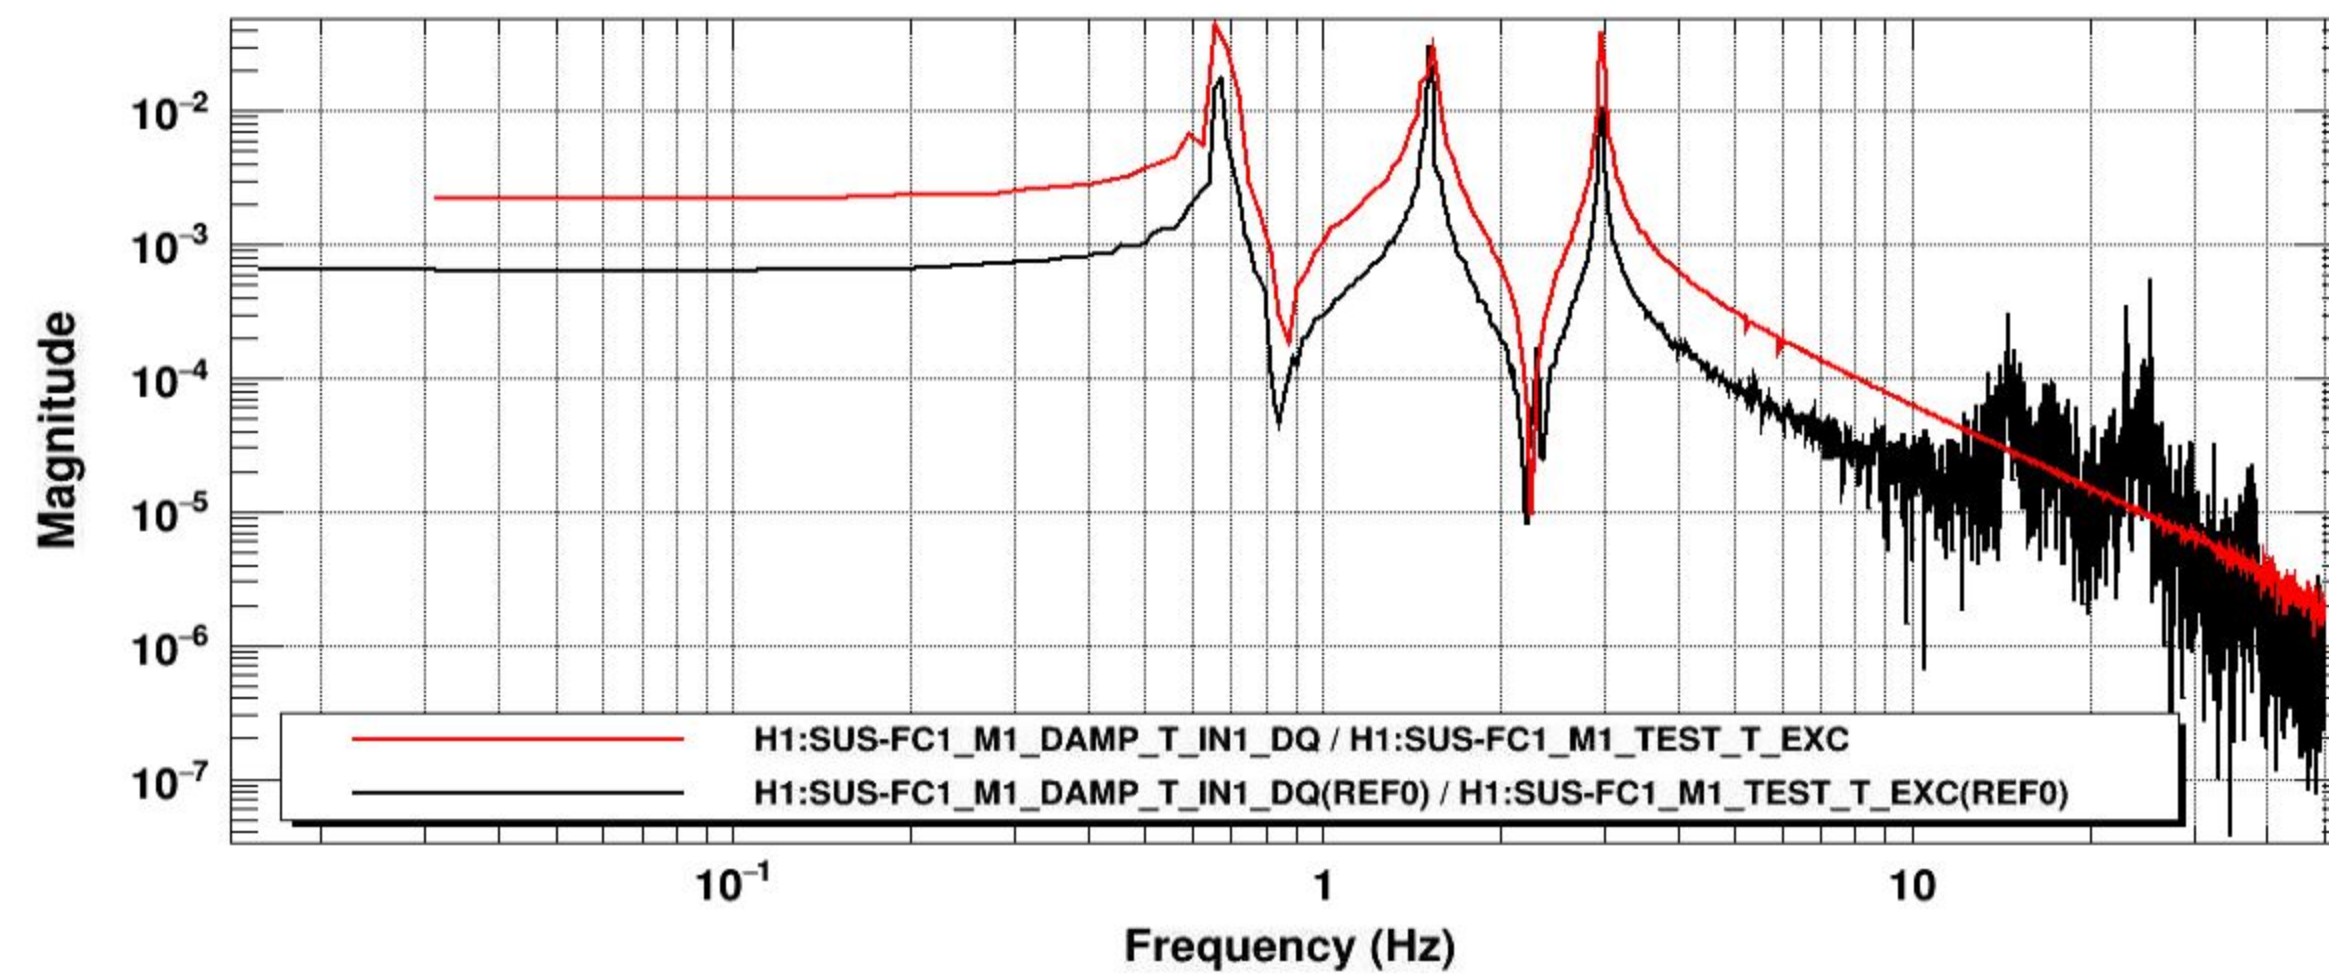


*T0=20/01/2024 19:24:18

Avg=5

*BW=0.046875

Coherence

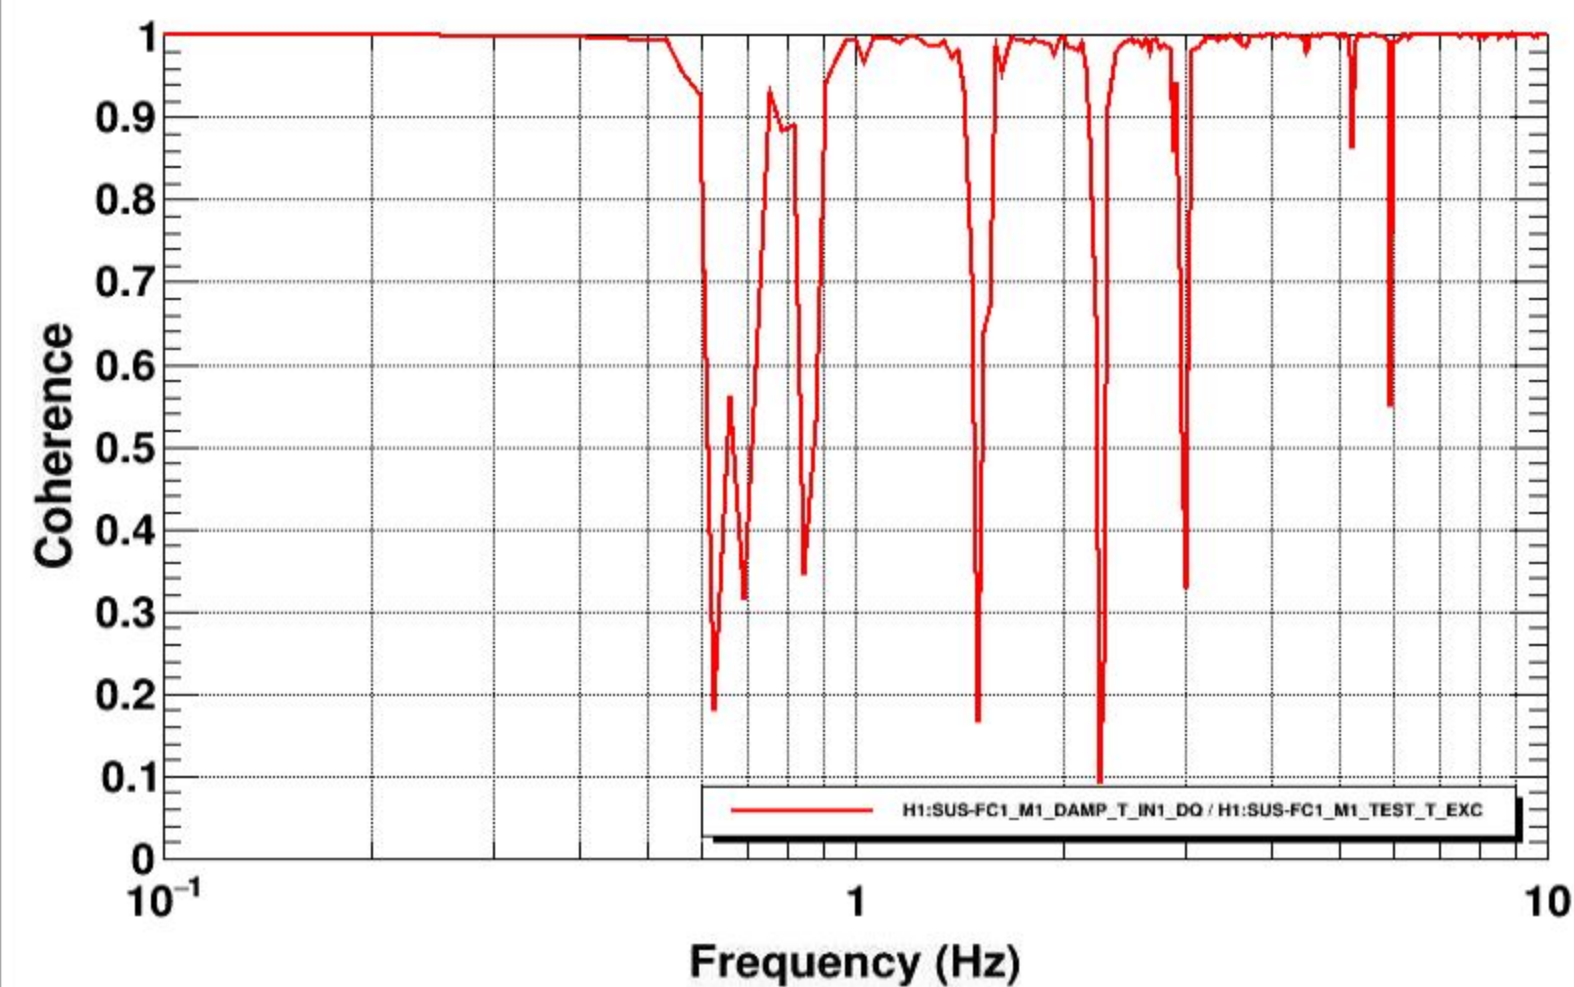


T0=20/01/2024 19:24:18

Avg=5

BW=0.046875

Transfer function

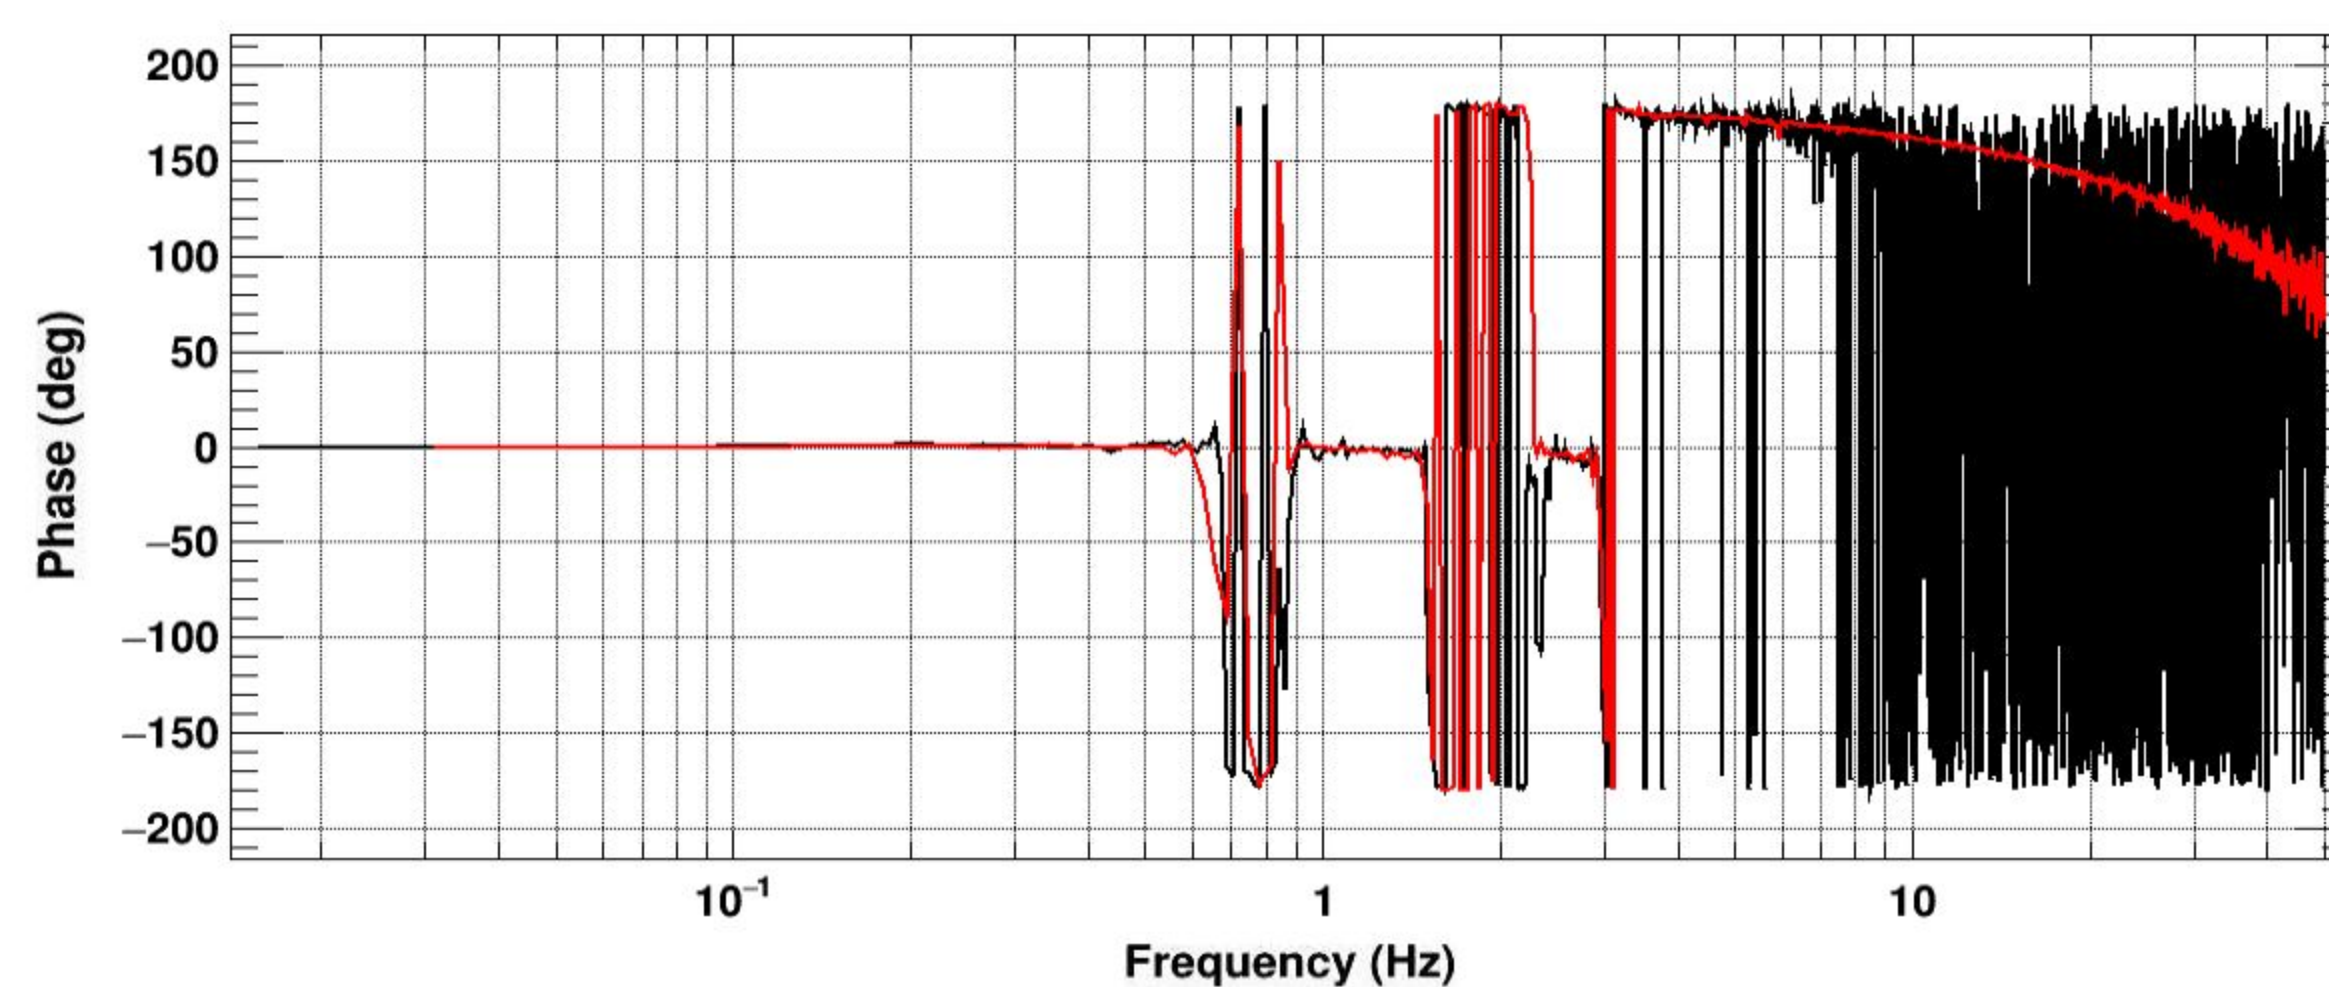

*T0=20/01/2024 19:24:18

Avg=5

*BW=0.046875

Active

New

Options...

Import...

Export...

Reference...

Calibration...

Print...

Pause


Resume

Abort

Repeat


Fourier tools

Transfer function

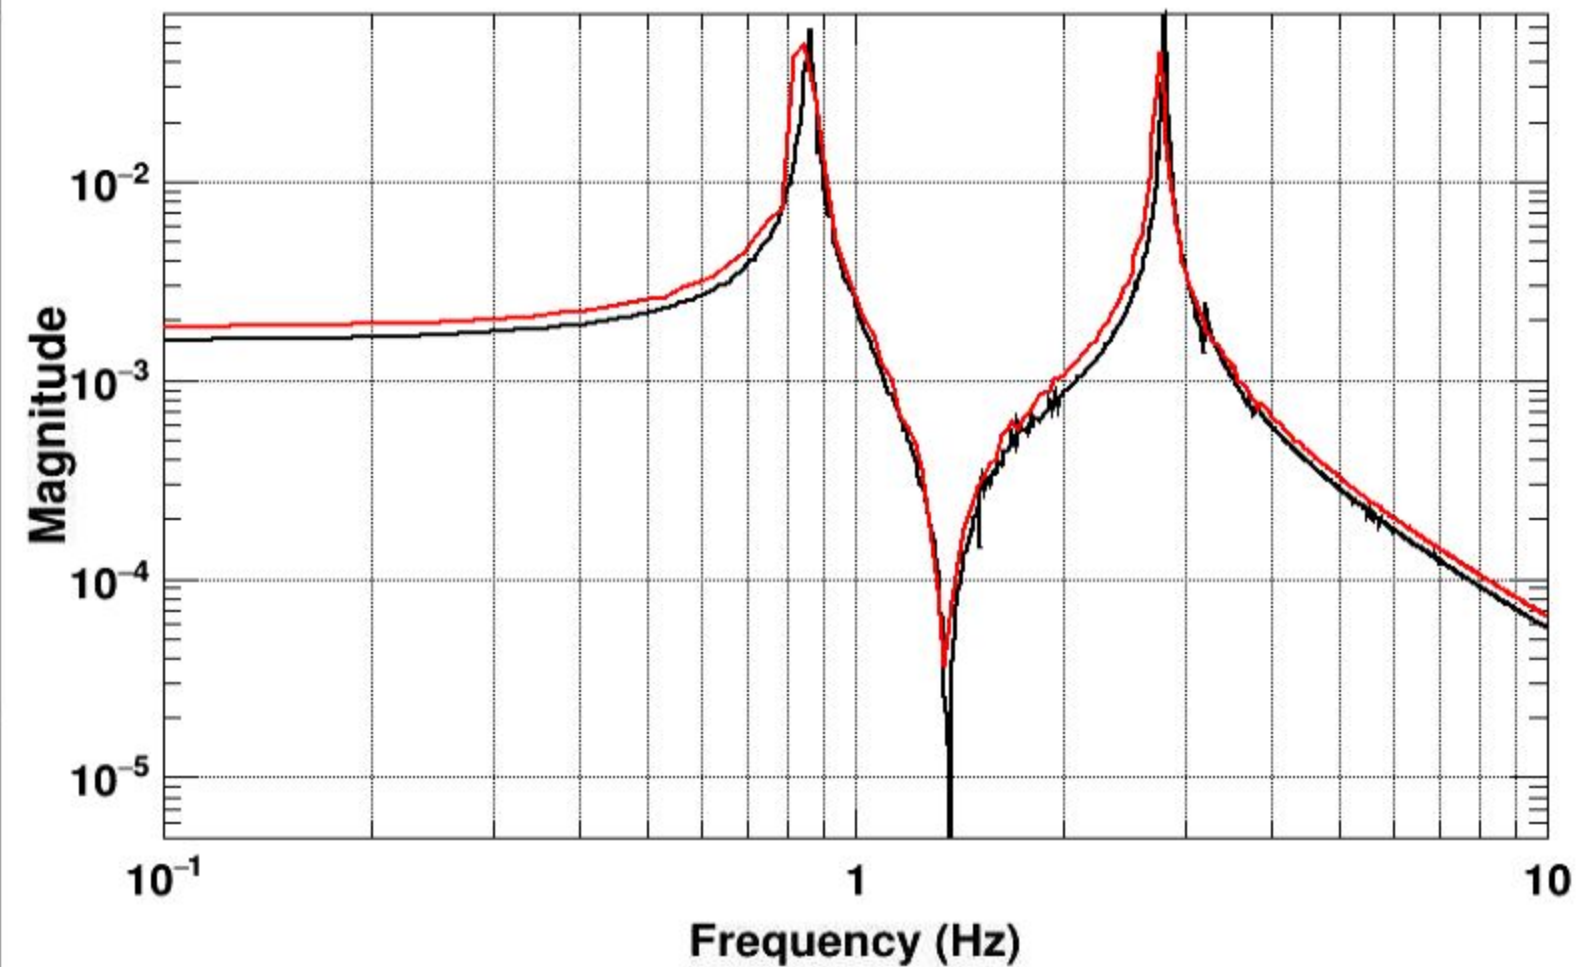


*T0=20/01/2024 19:27:38 Avg=5 *BW=0.046875

Transfer function

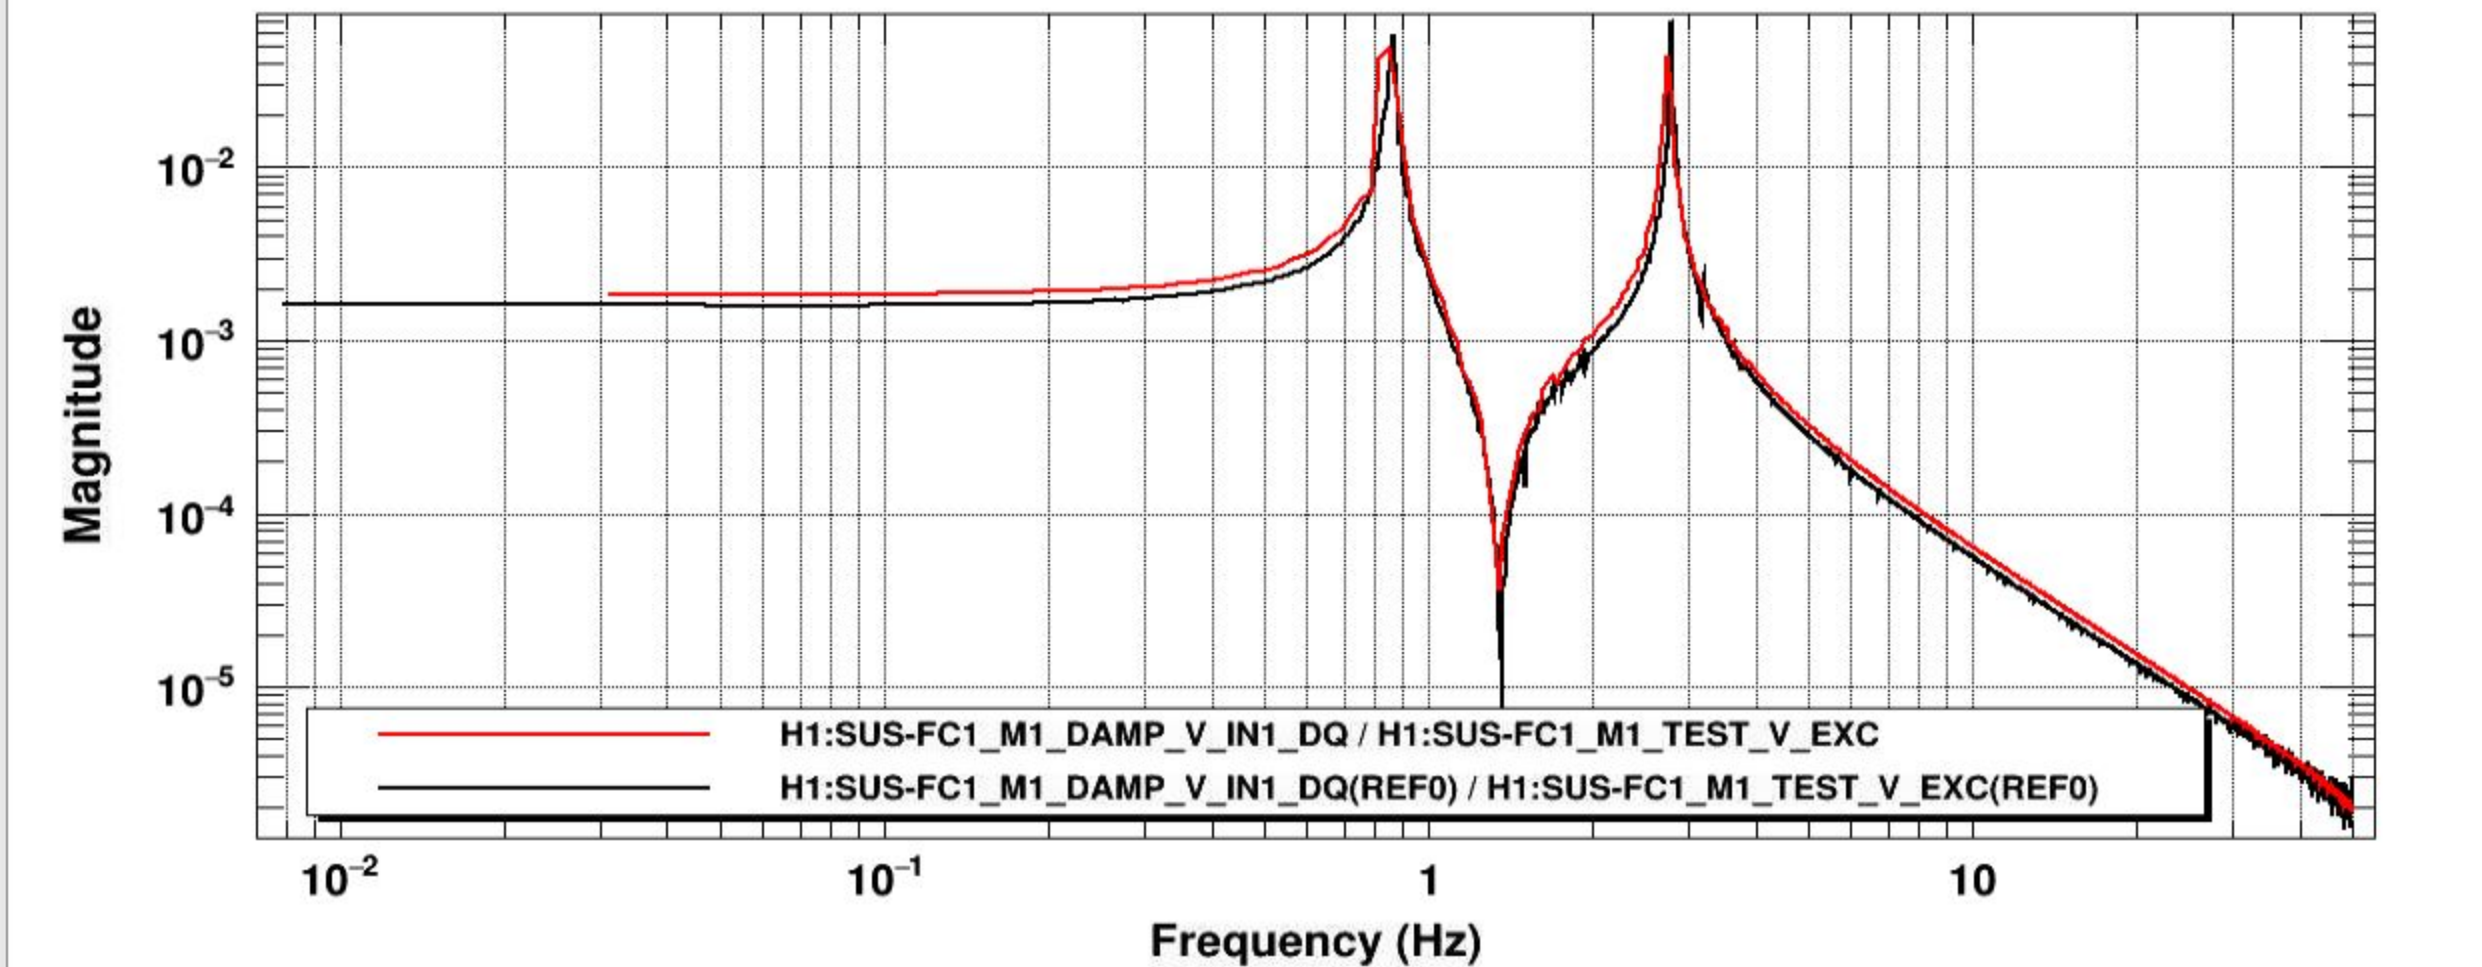


*T0=20/01/2024 19:27:38 Avg=5 *BW=0.046875

Coherence

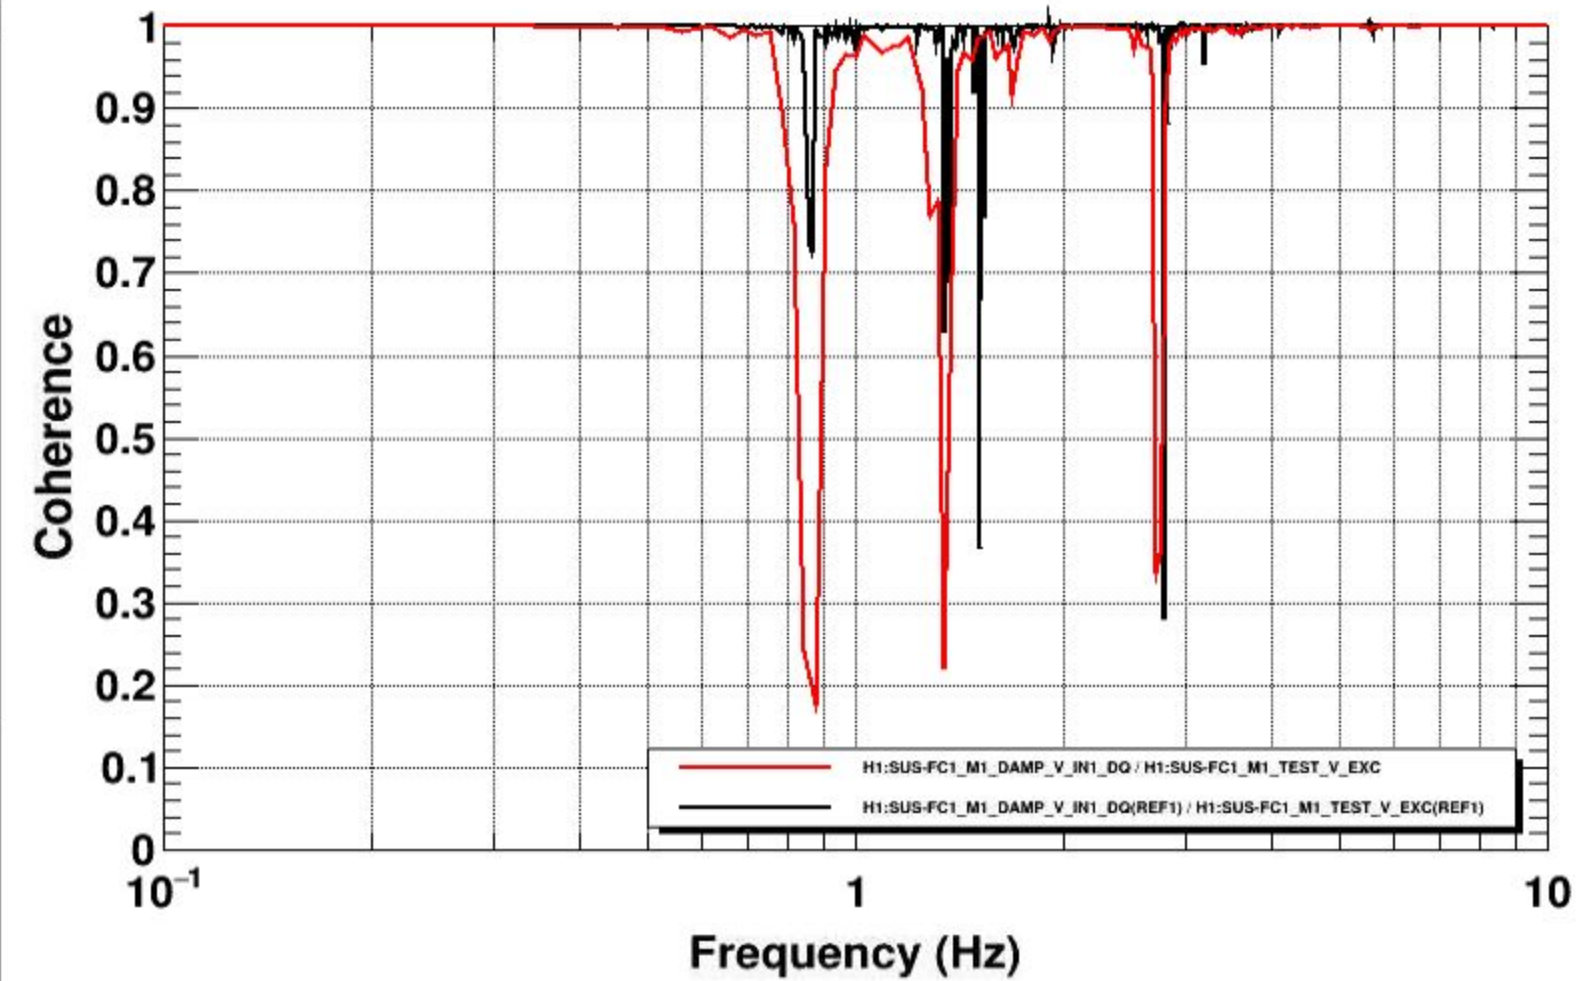

*T0=20/01/2024 19:27:38 Avg=5 *BW=0.046875

Transfer function

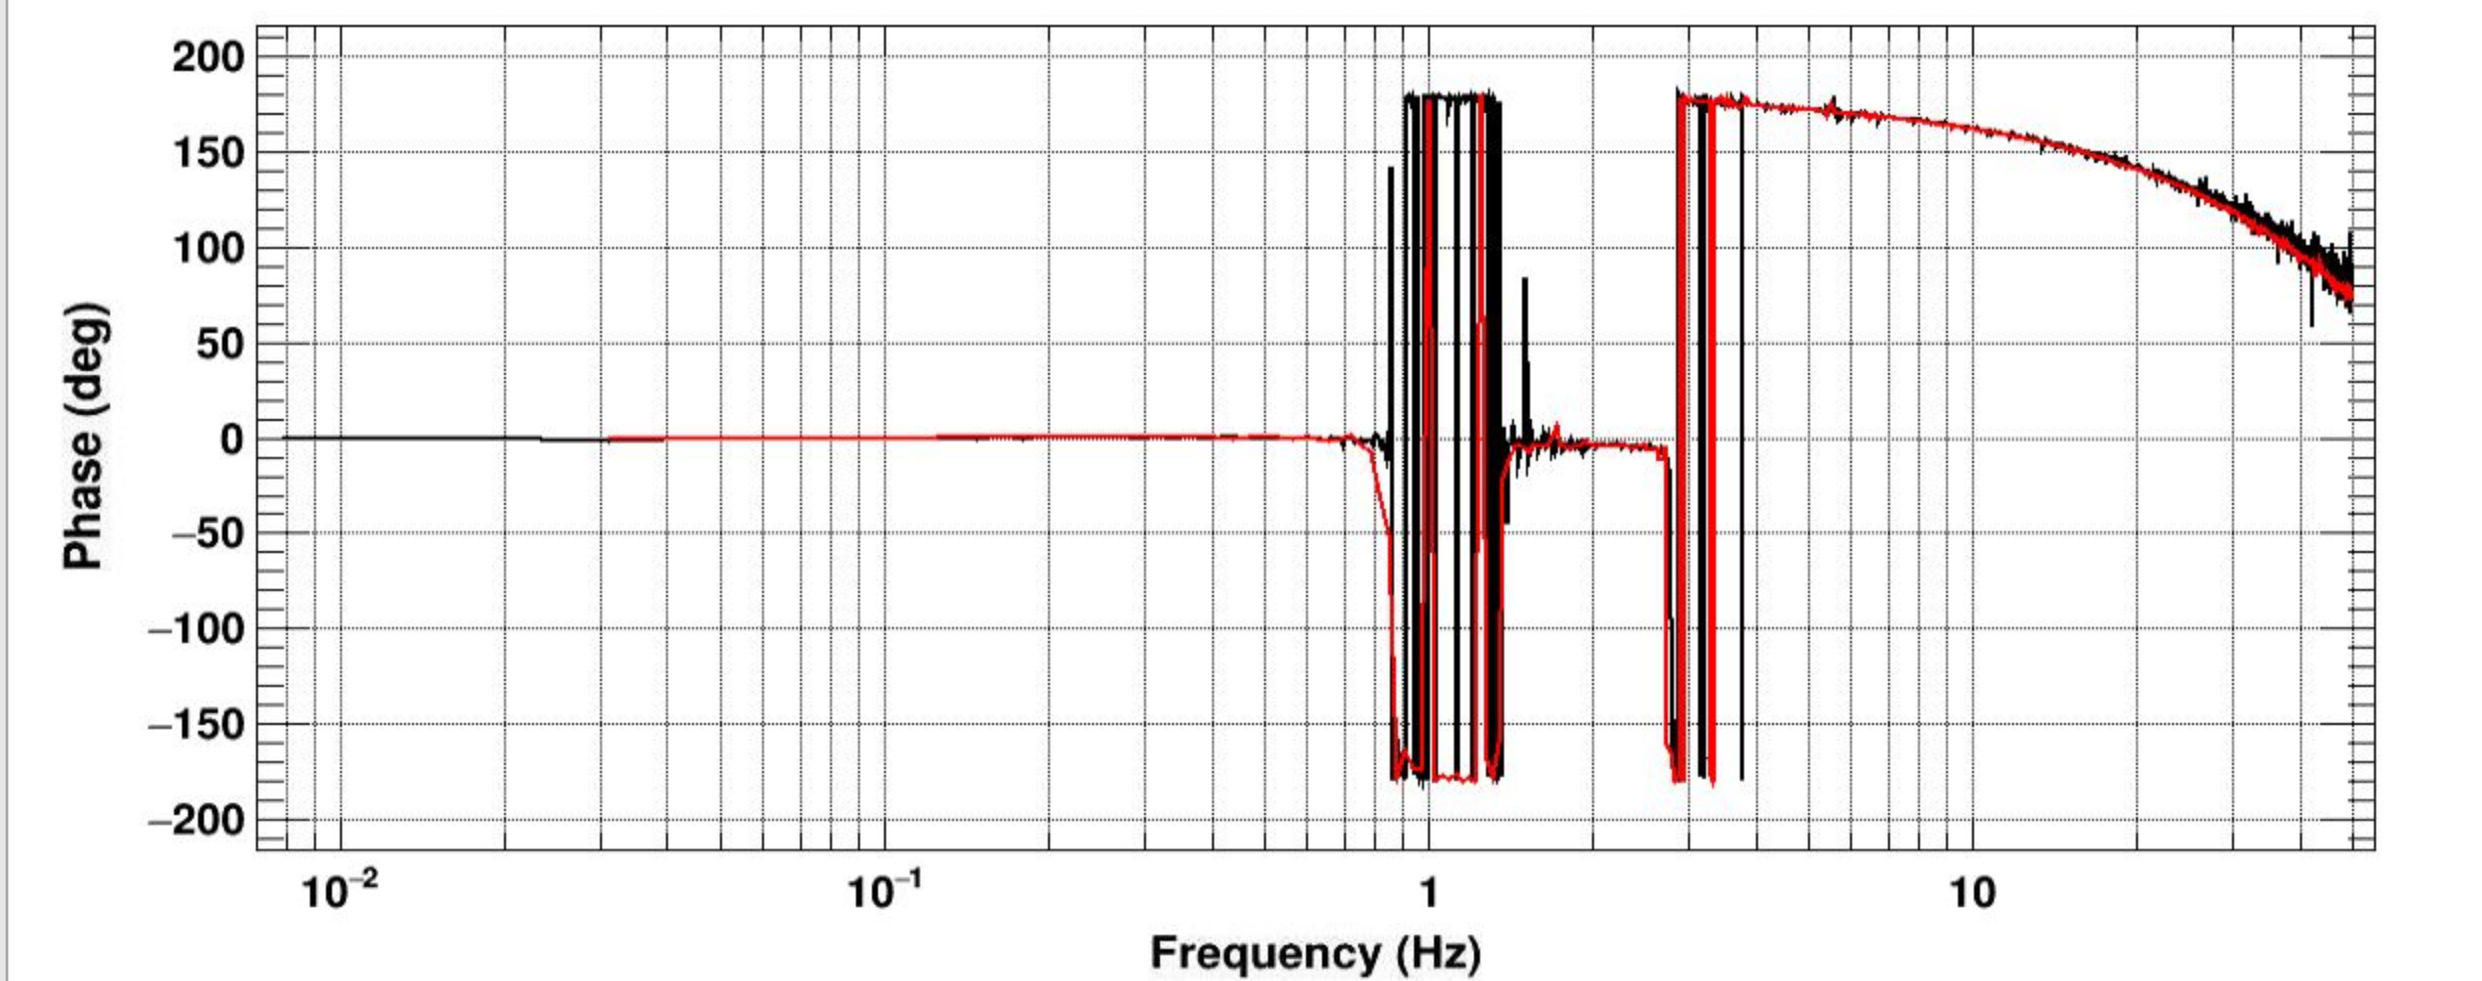

*T0=20/01/2024 19:27:38 Avg=5 *BW=0.046875

Active

New

Options...

Import...

Export...

Reference...

Calibration...


Print...

Pause

Resume

Abort

Transfer function

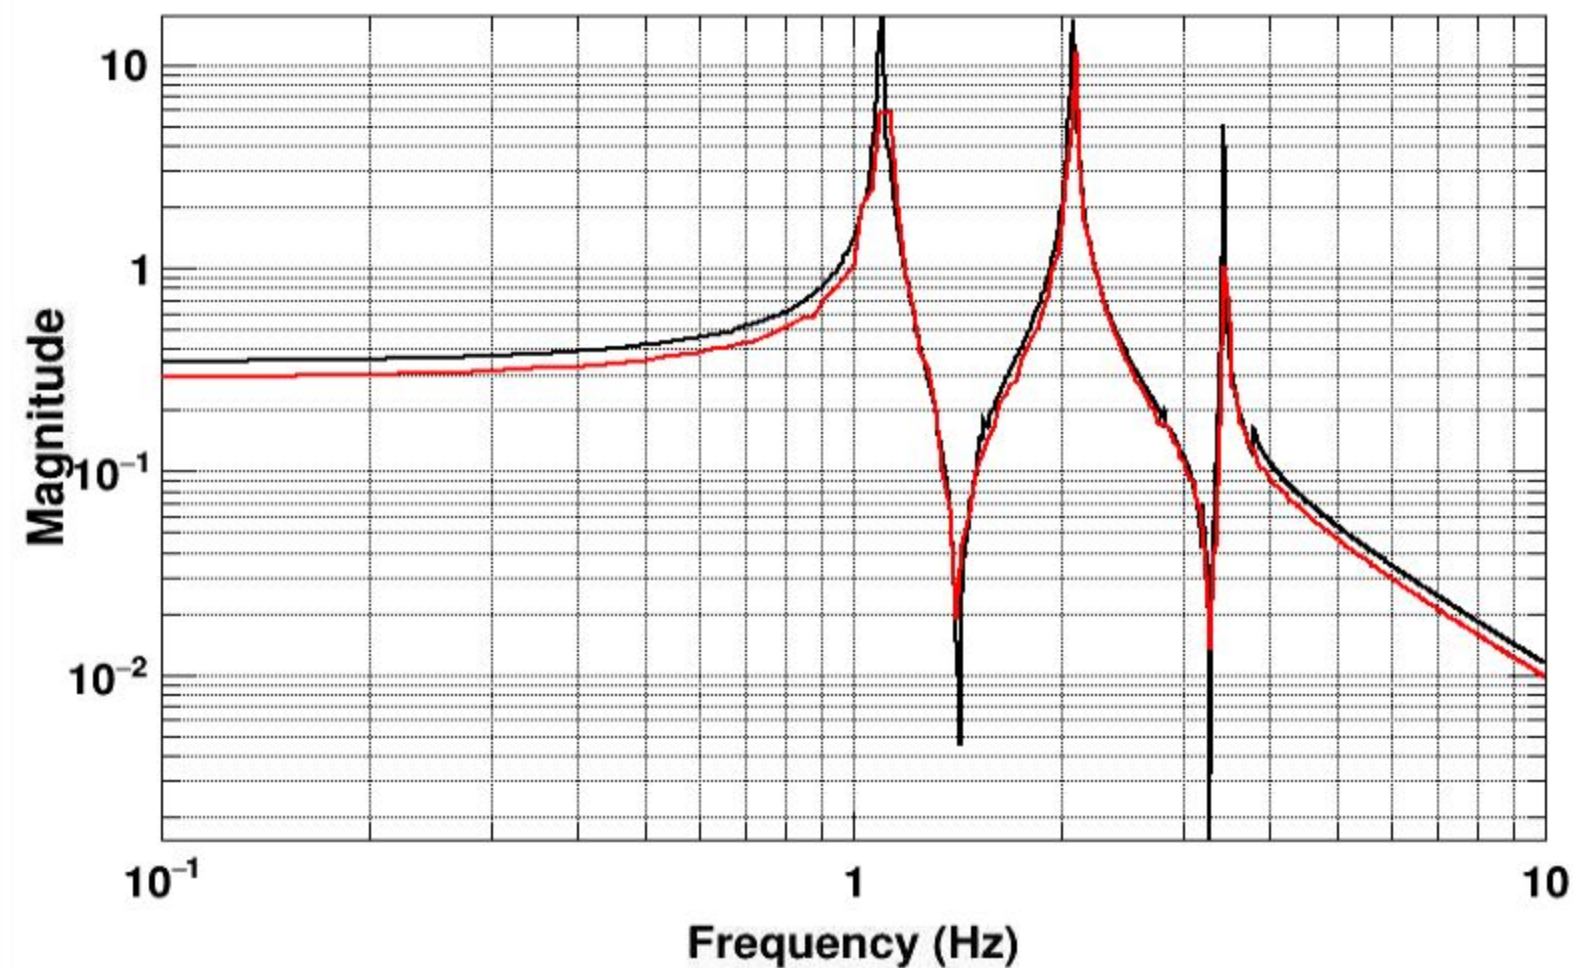


*T0=20/01/2024 19:31:40

Avg=5

*BW=0.046875

Transfer function

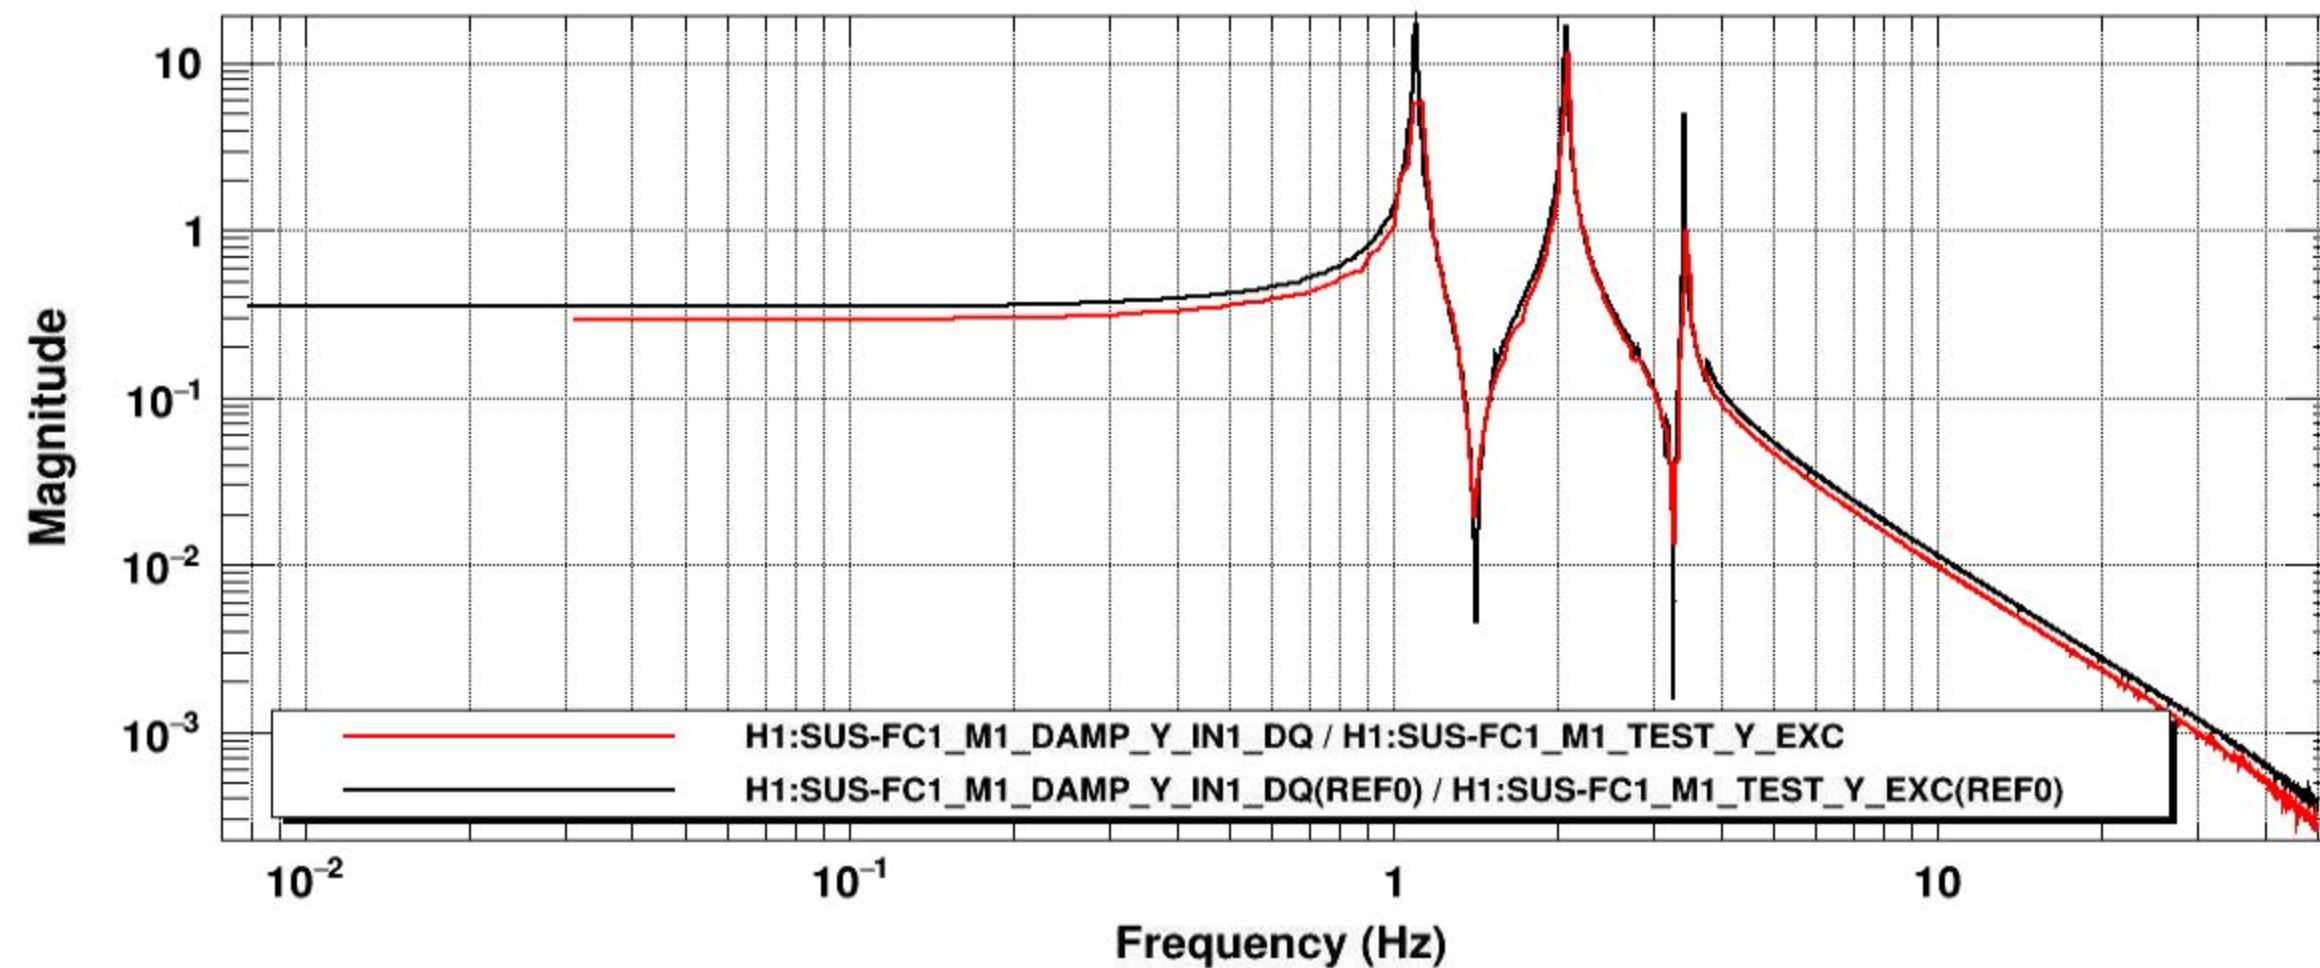


*T0=20/01/2024 19:31:40

Avg=5

*BW=0.046875

Coherence

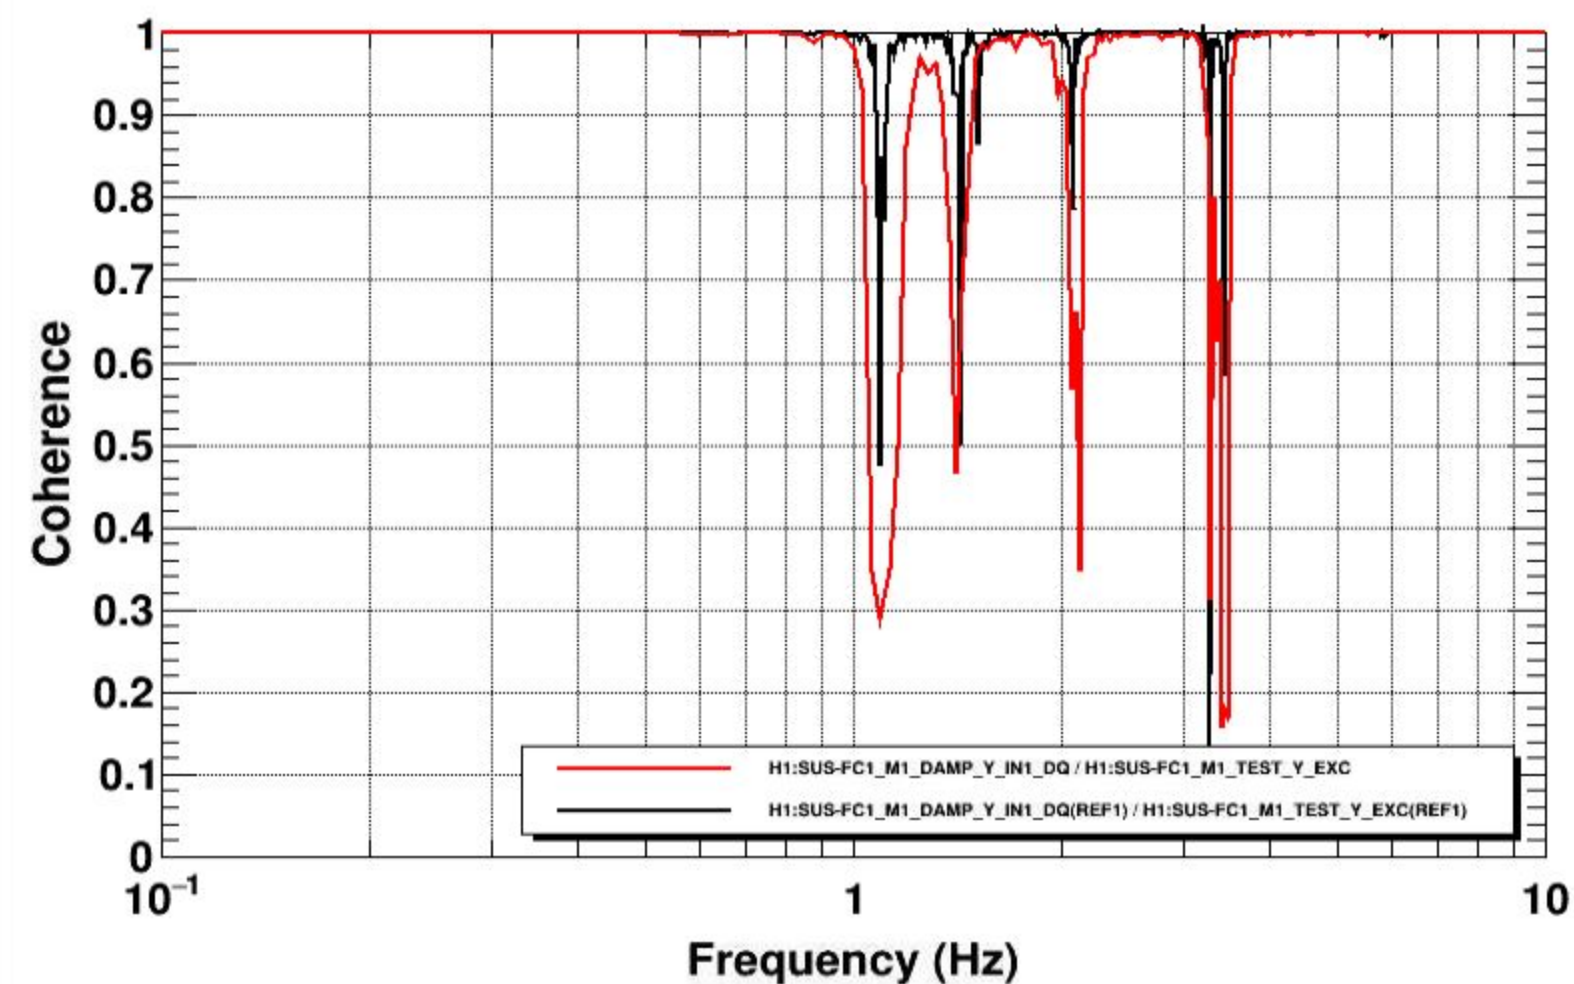


*T0=20/01/2024 19:31:40

Avg=5

*BW=0.046875

Transfer function

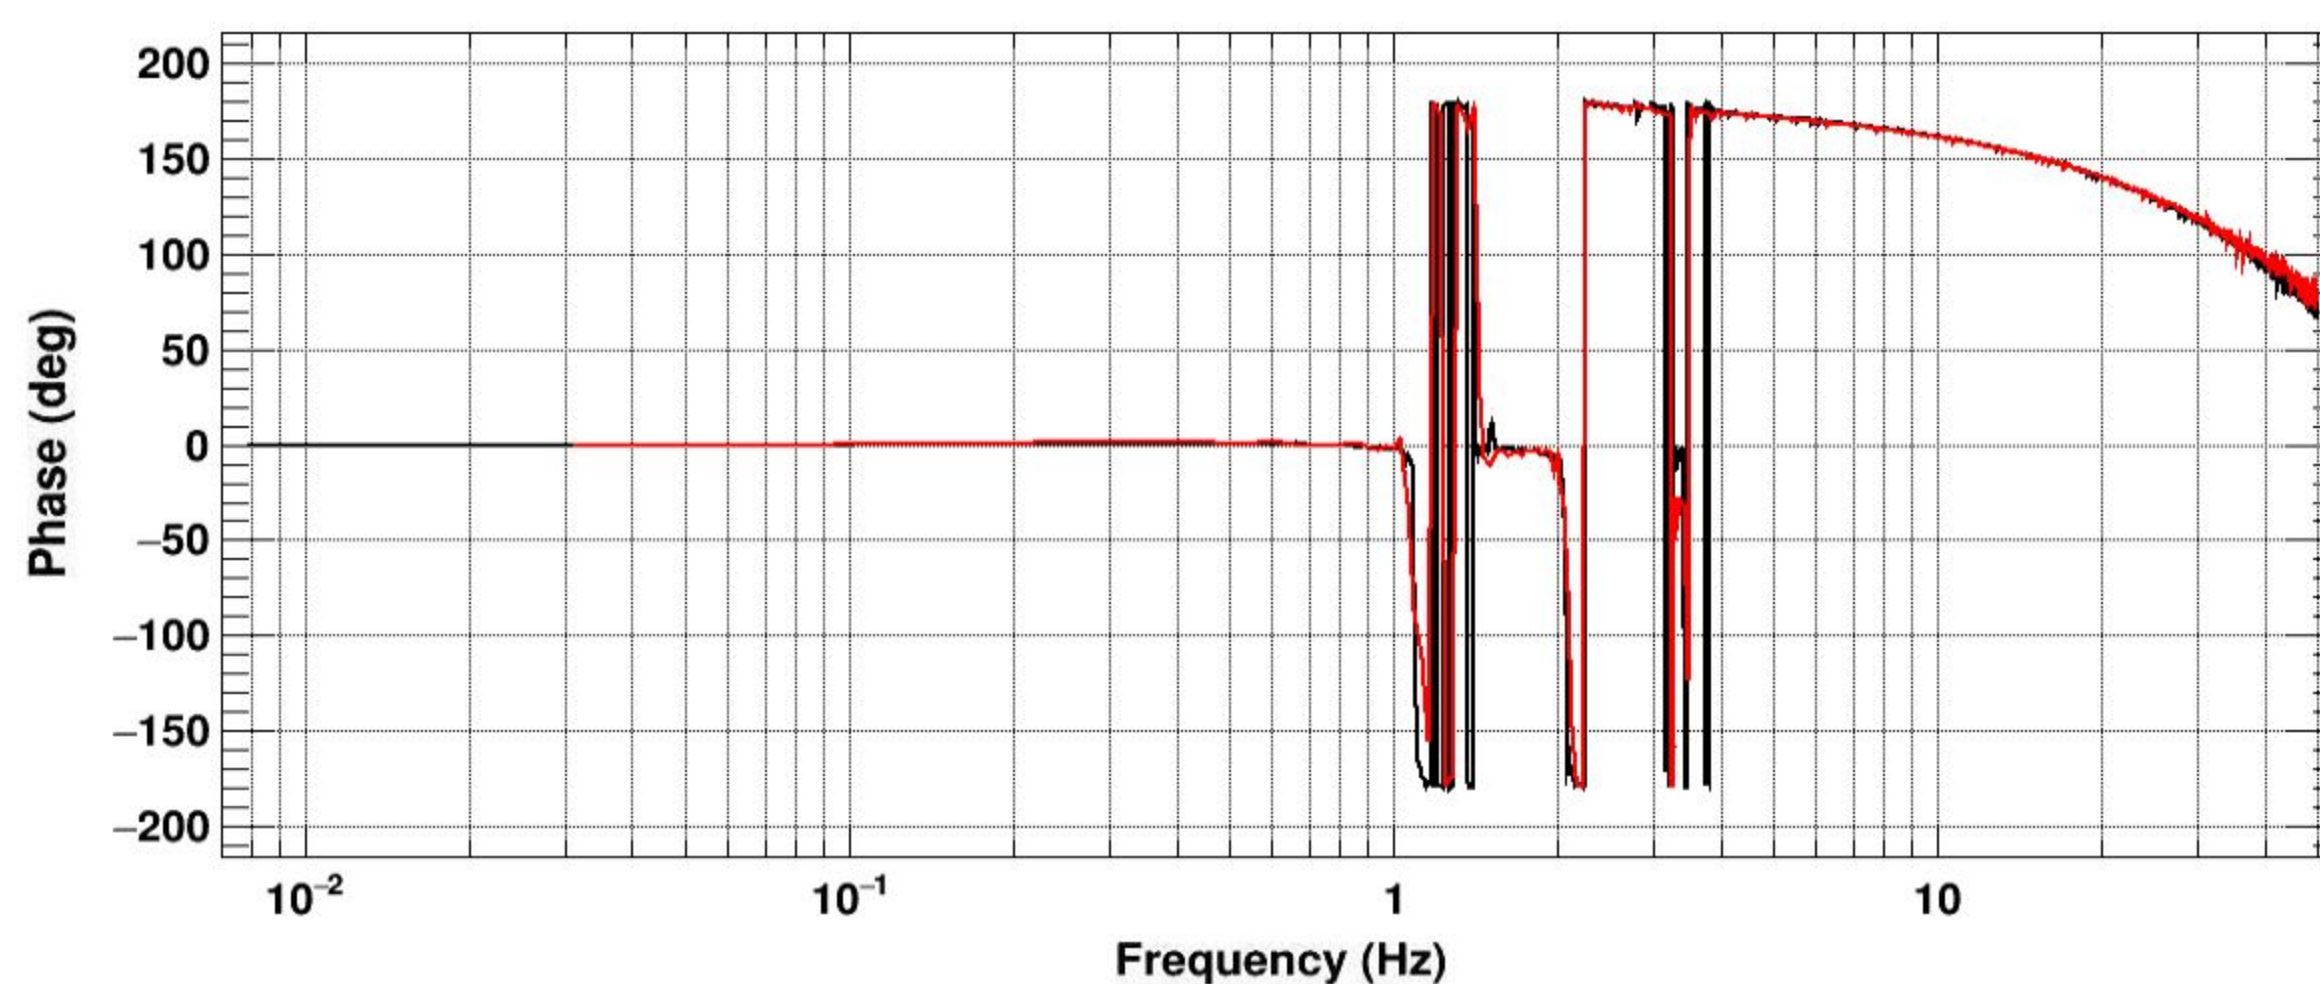

*T0=20/01/2024 19:31:40

Avg=5

*BW=0.046875

Active

New

Options...

Import...

Export...

Reference...

Calibration...

Print...

Pause

Resume

Abort