



DARM Sensing TF


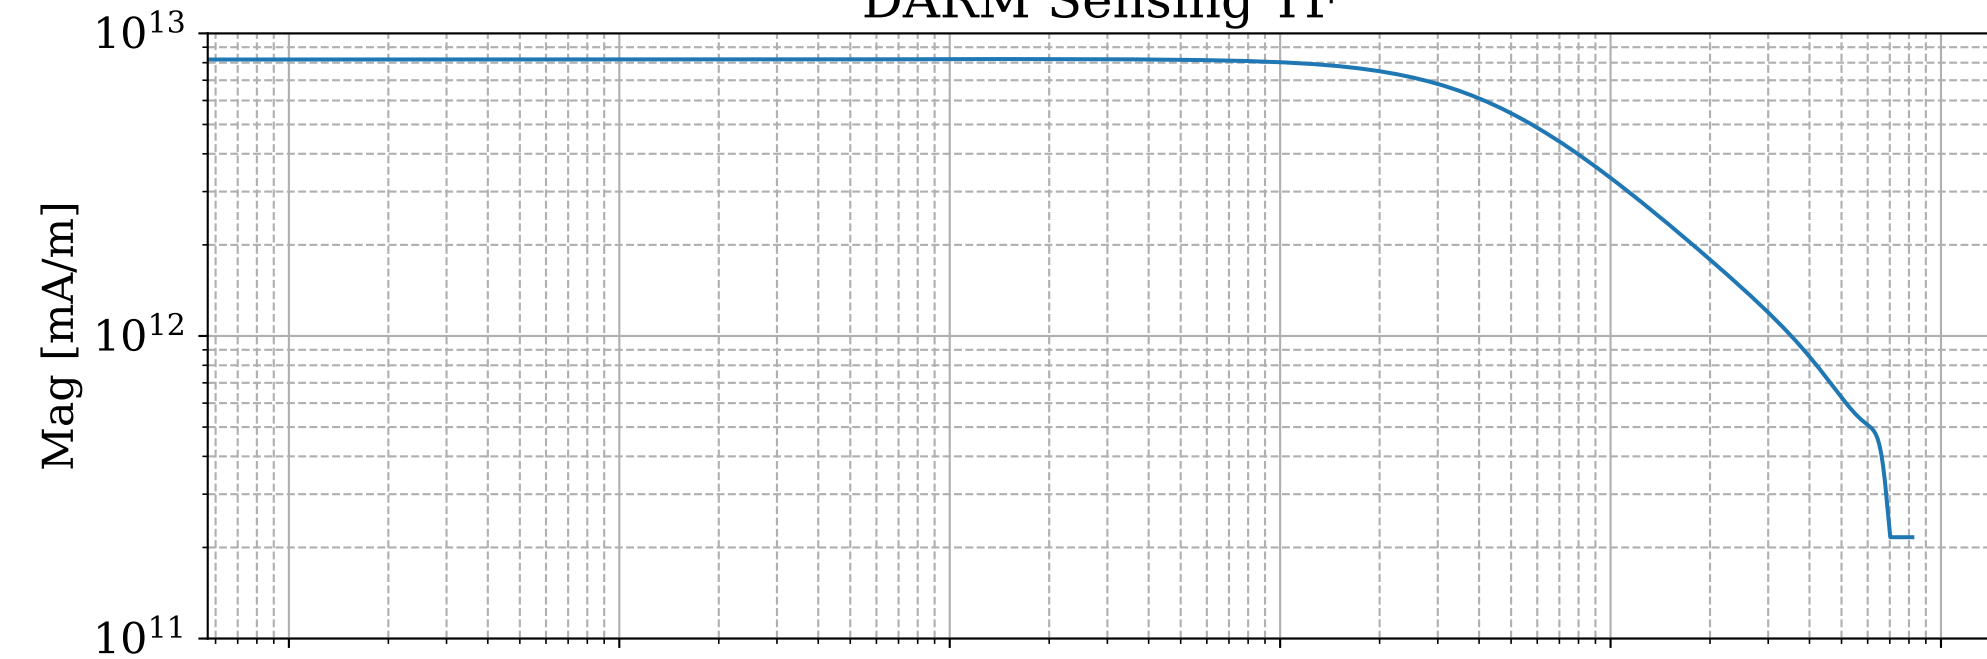


— DARM sensing TF

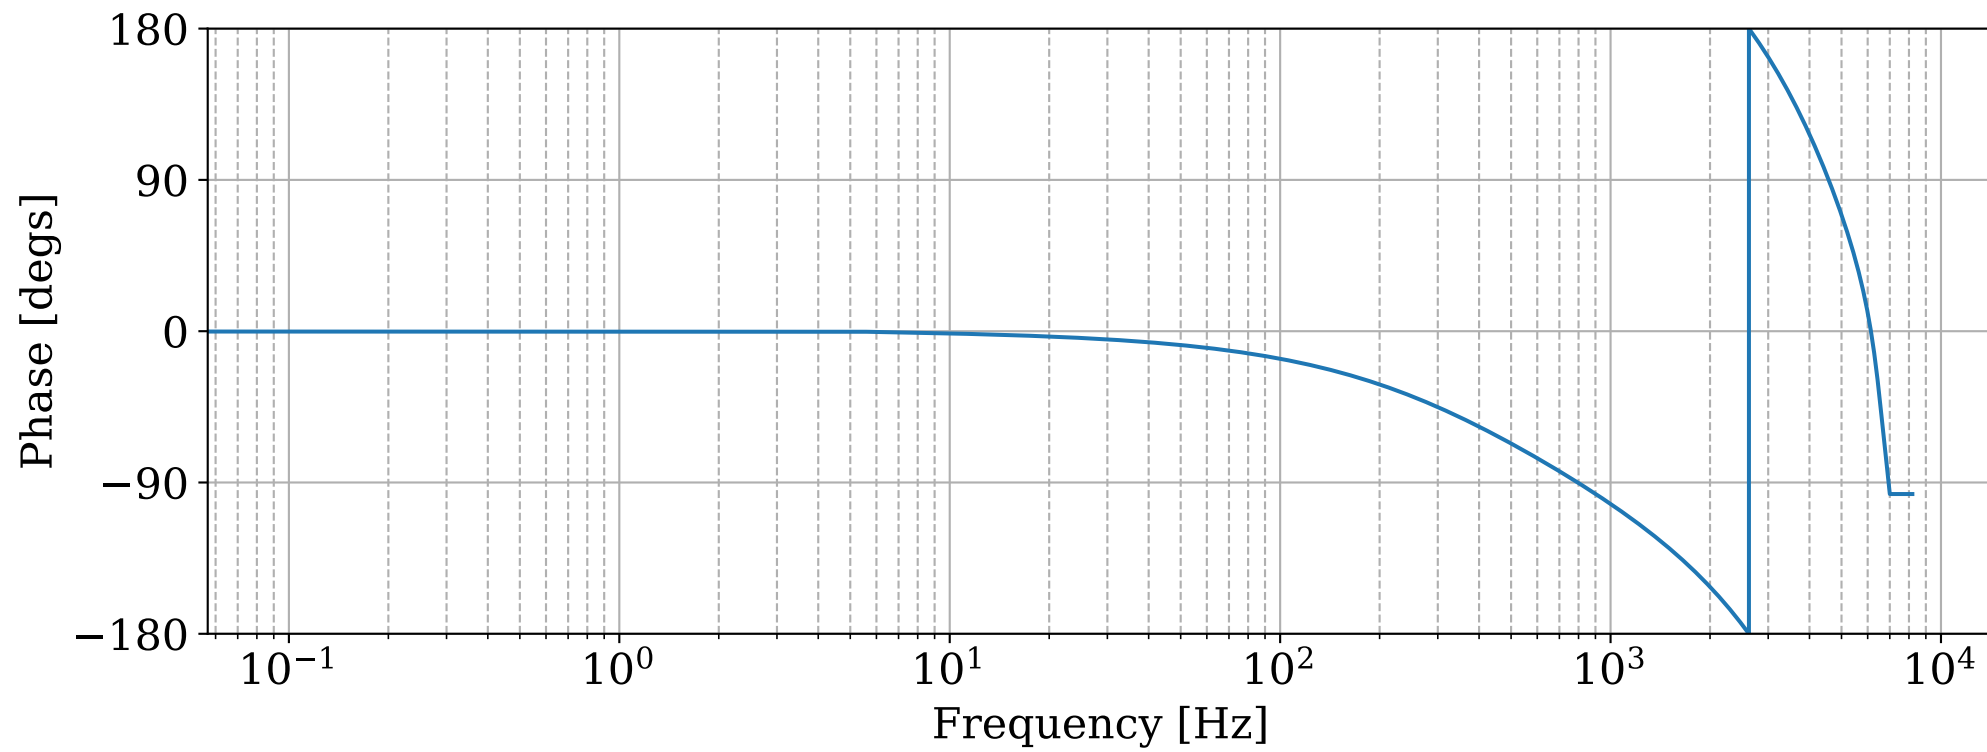


Frequency [Hz]


DARM OLG TF Model

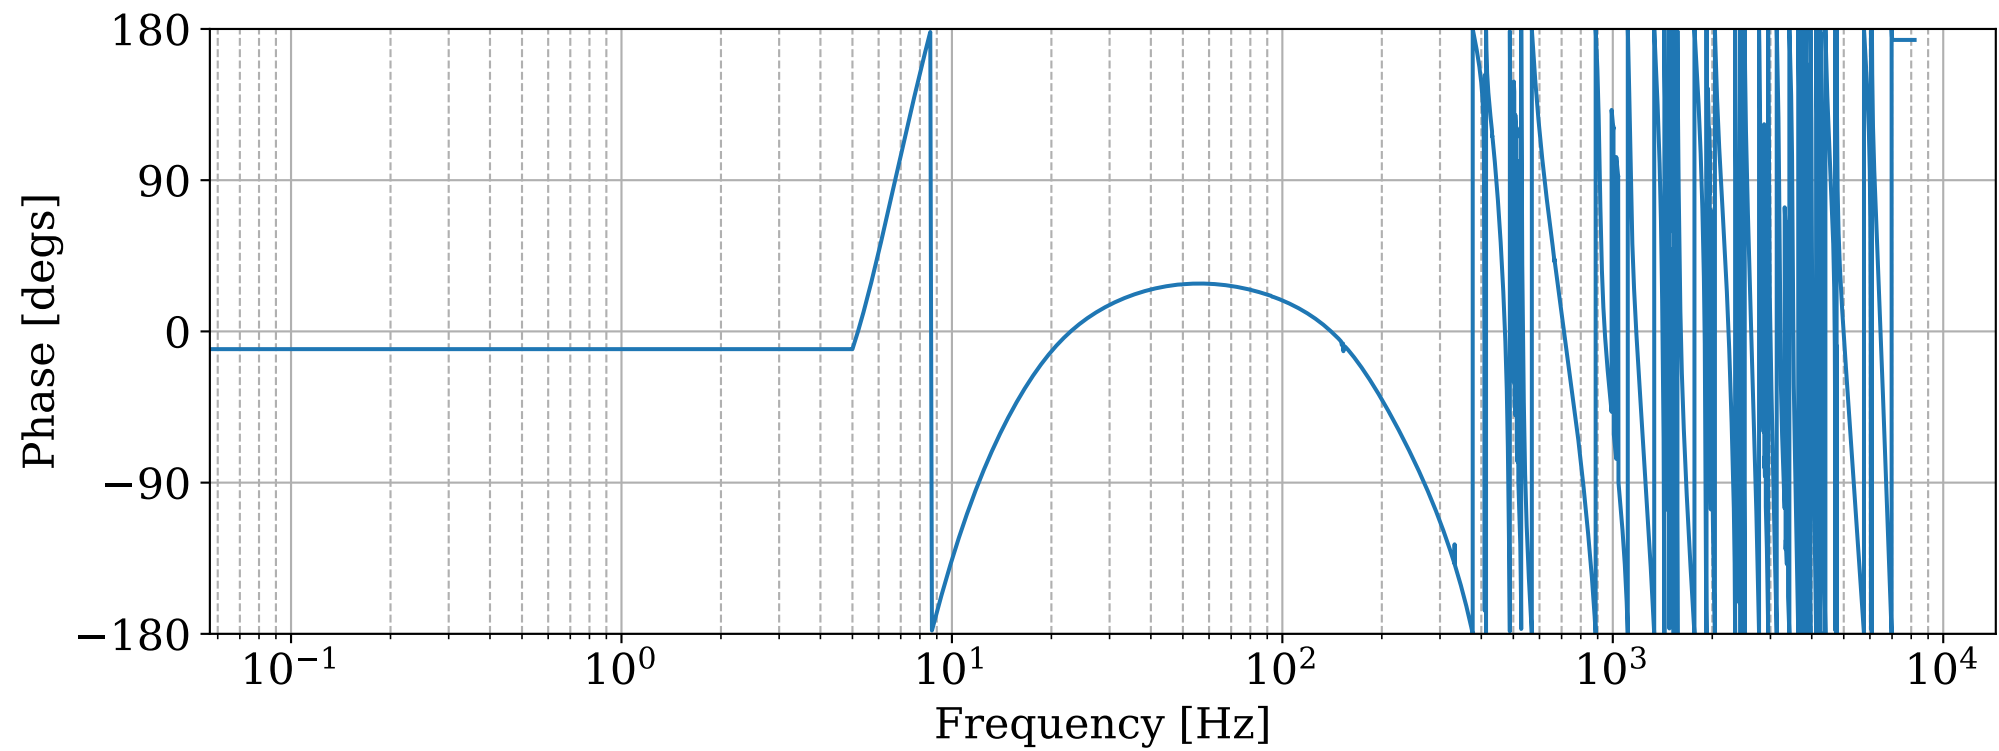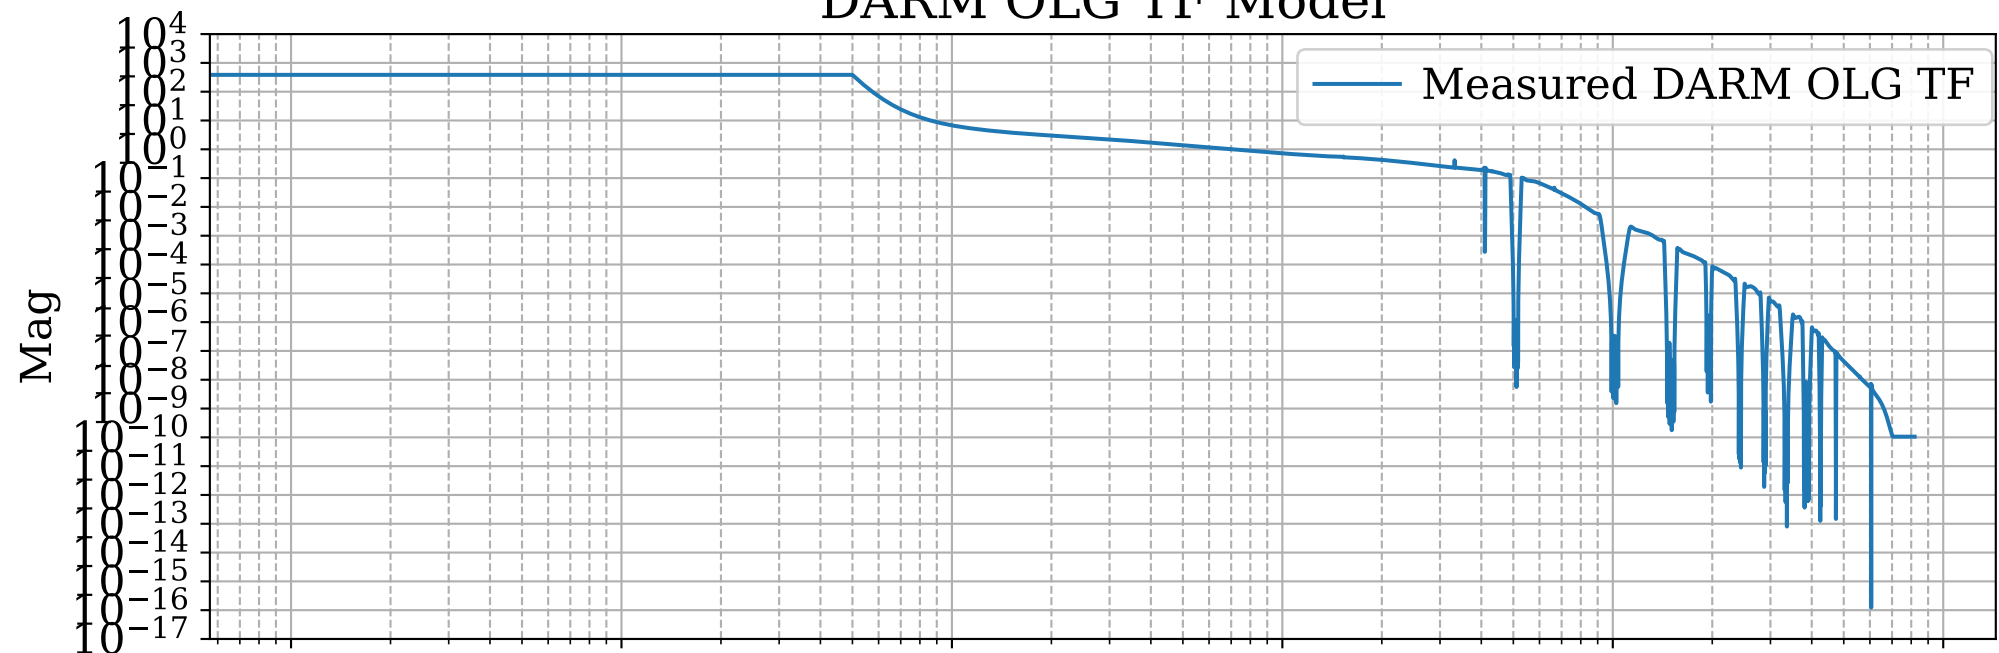


All vs PSD-rejected PSDs - 20231220 180016 utc

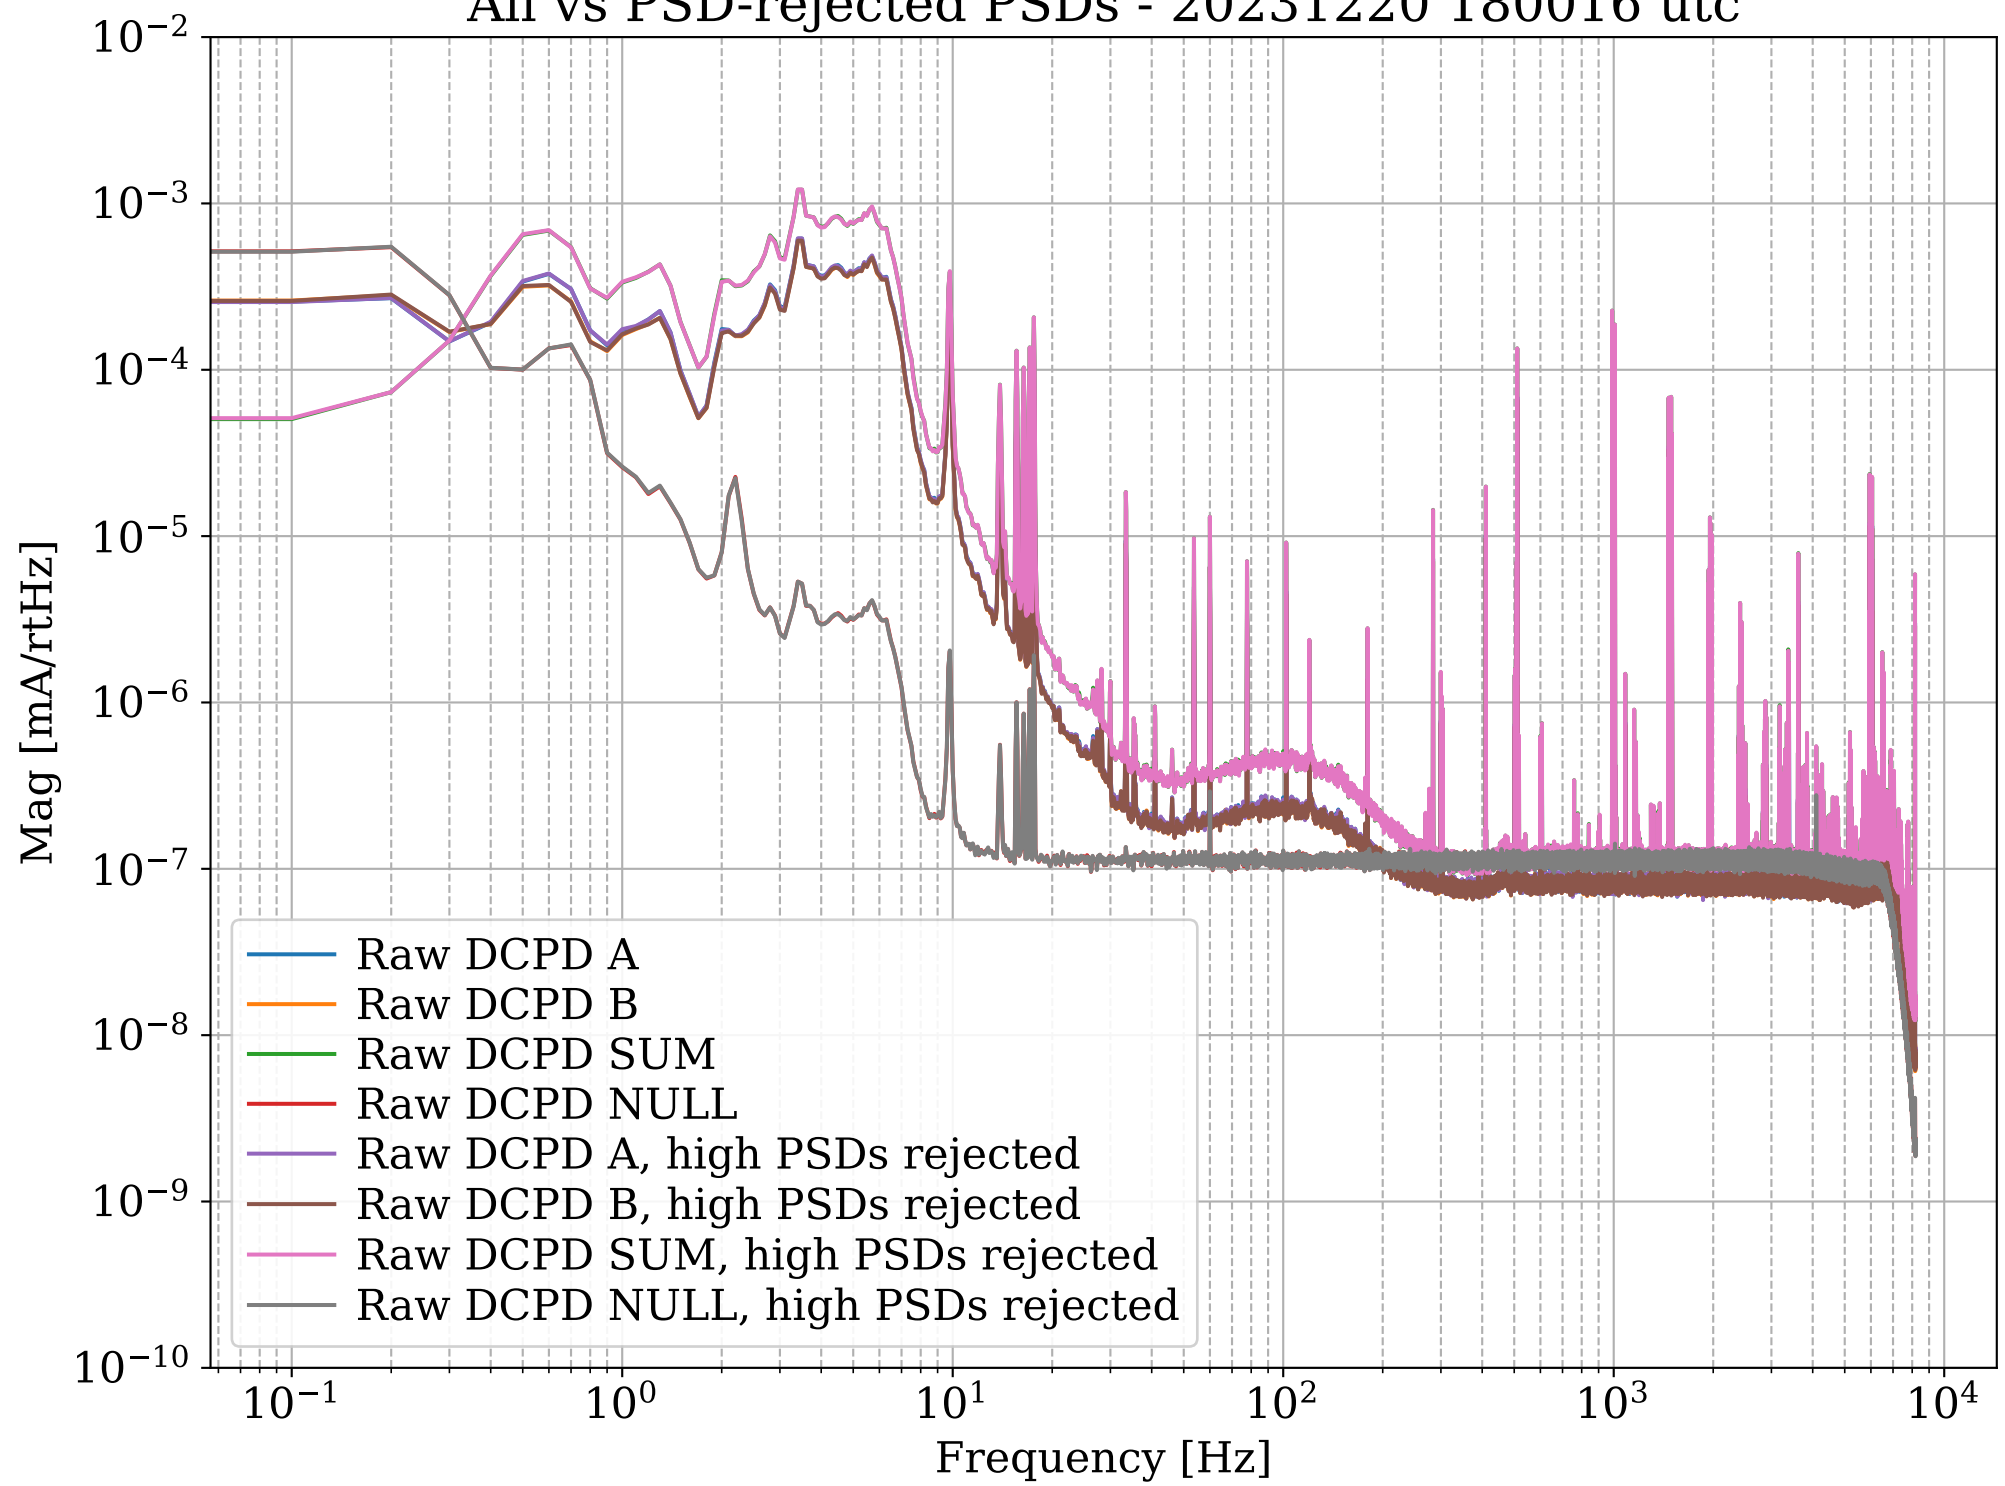


Uncalibrated correlated DARM - 20231220 180016 utc

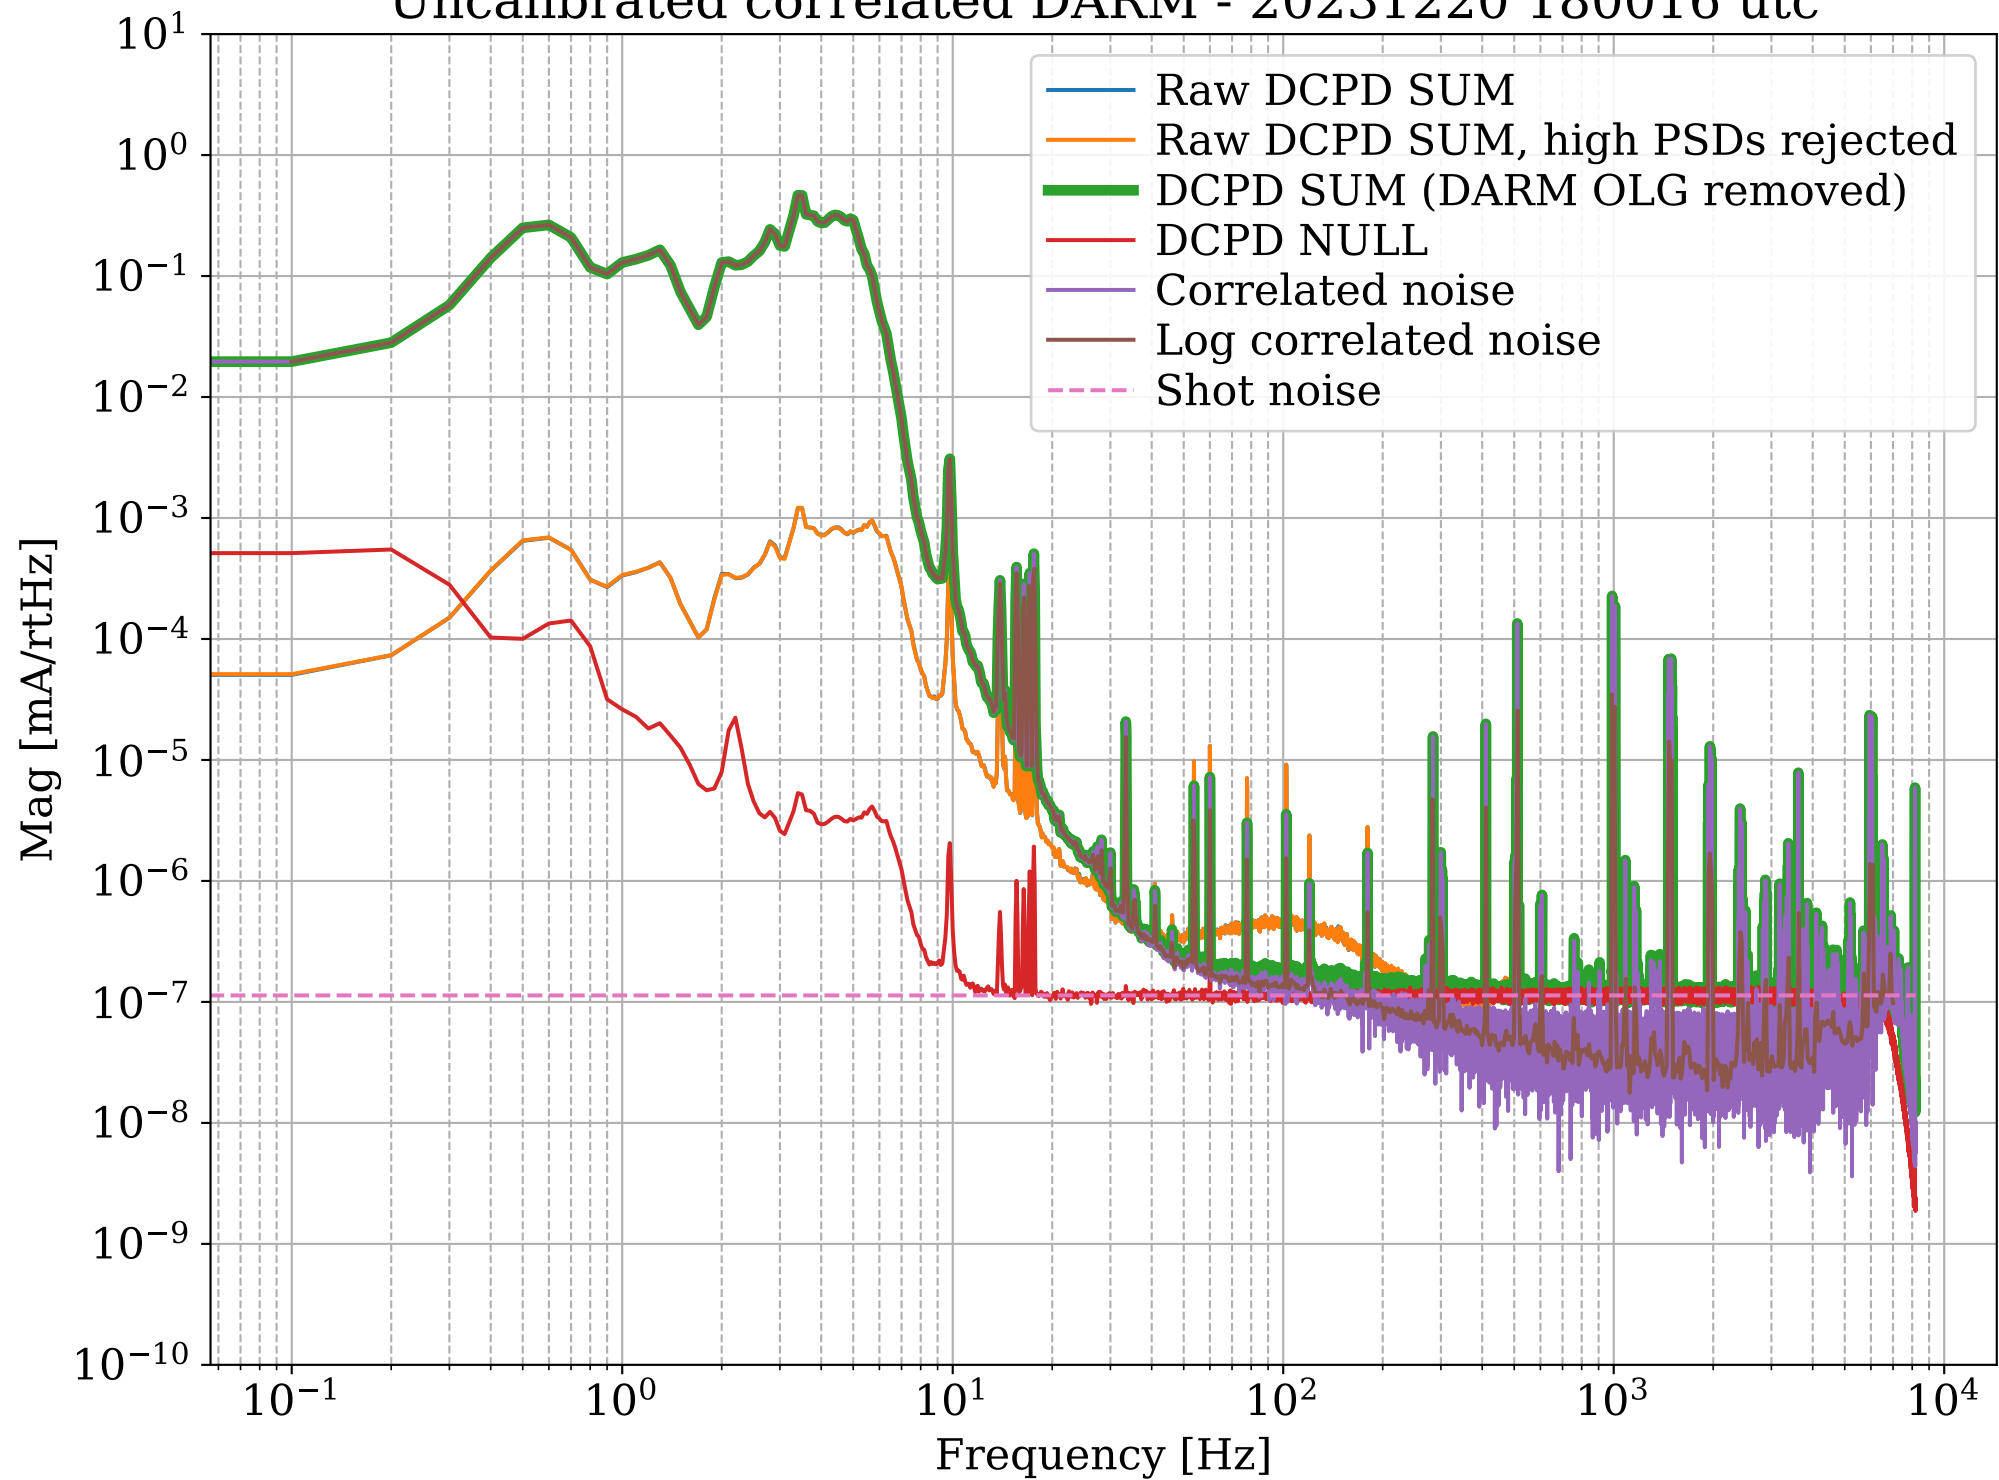


Uncalibrated correlated DARM - 20231220 180016 utc

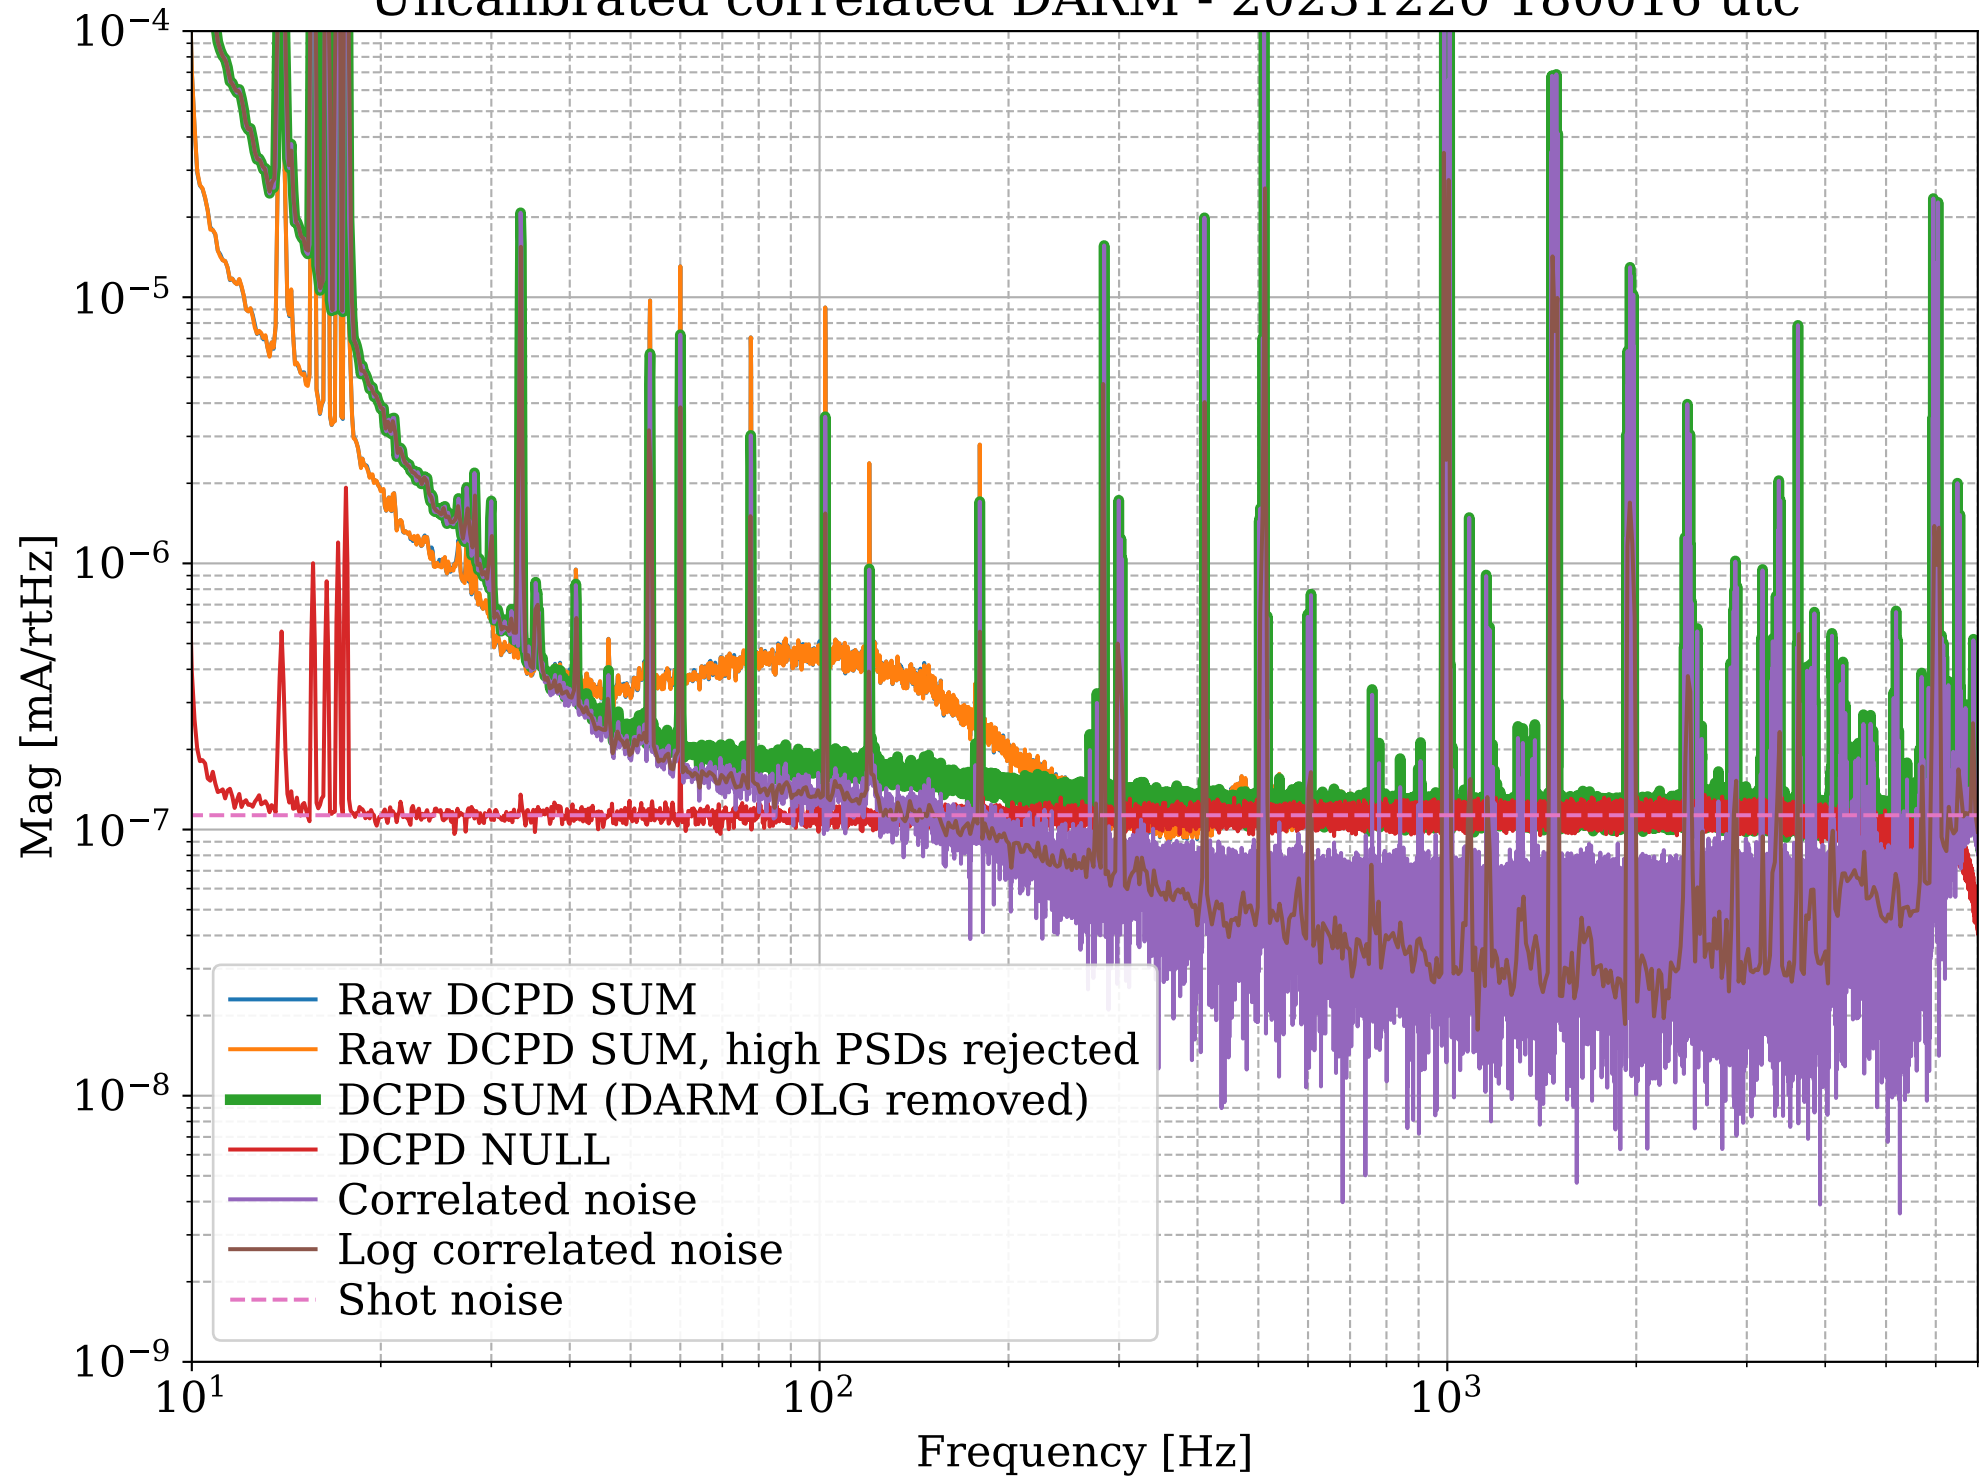

Uncalibrated correlated DARM - 20231220 180016 utc

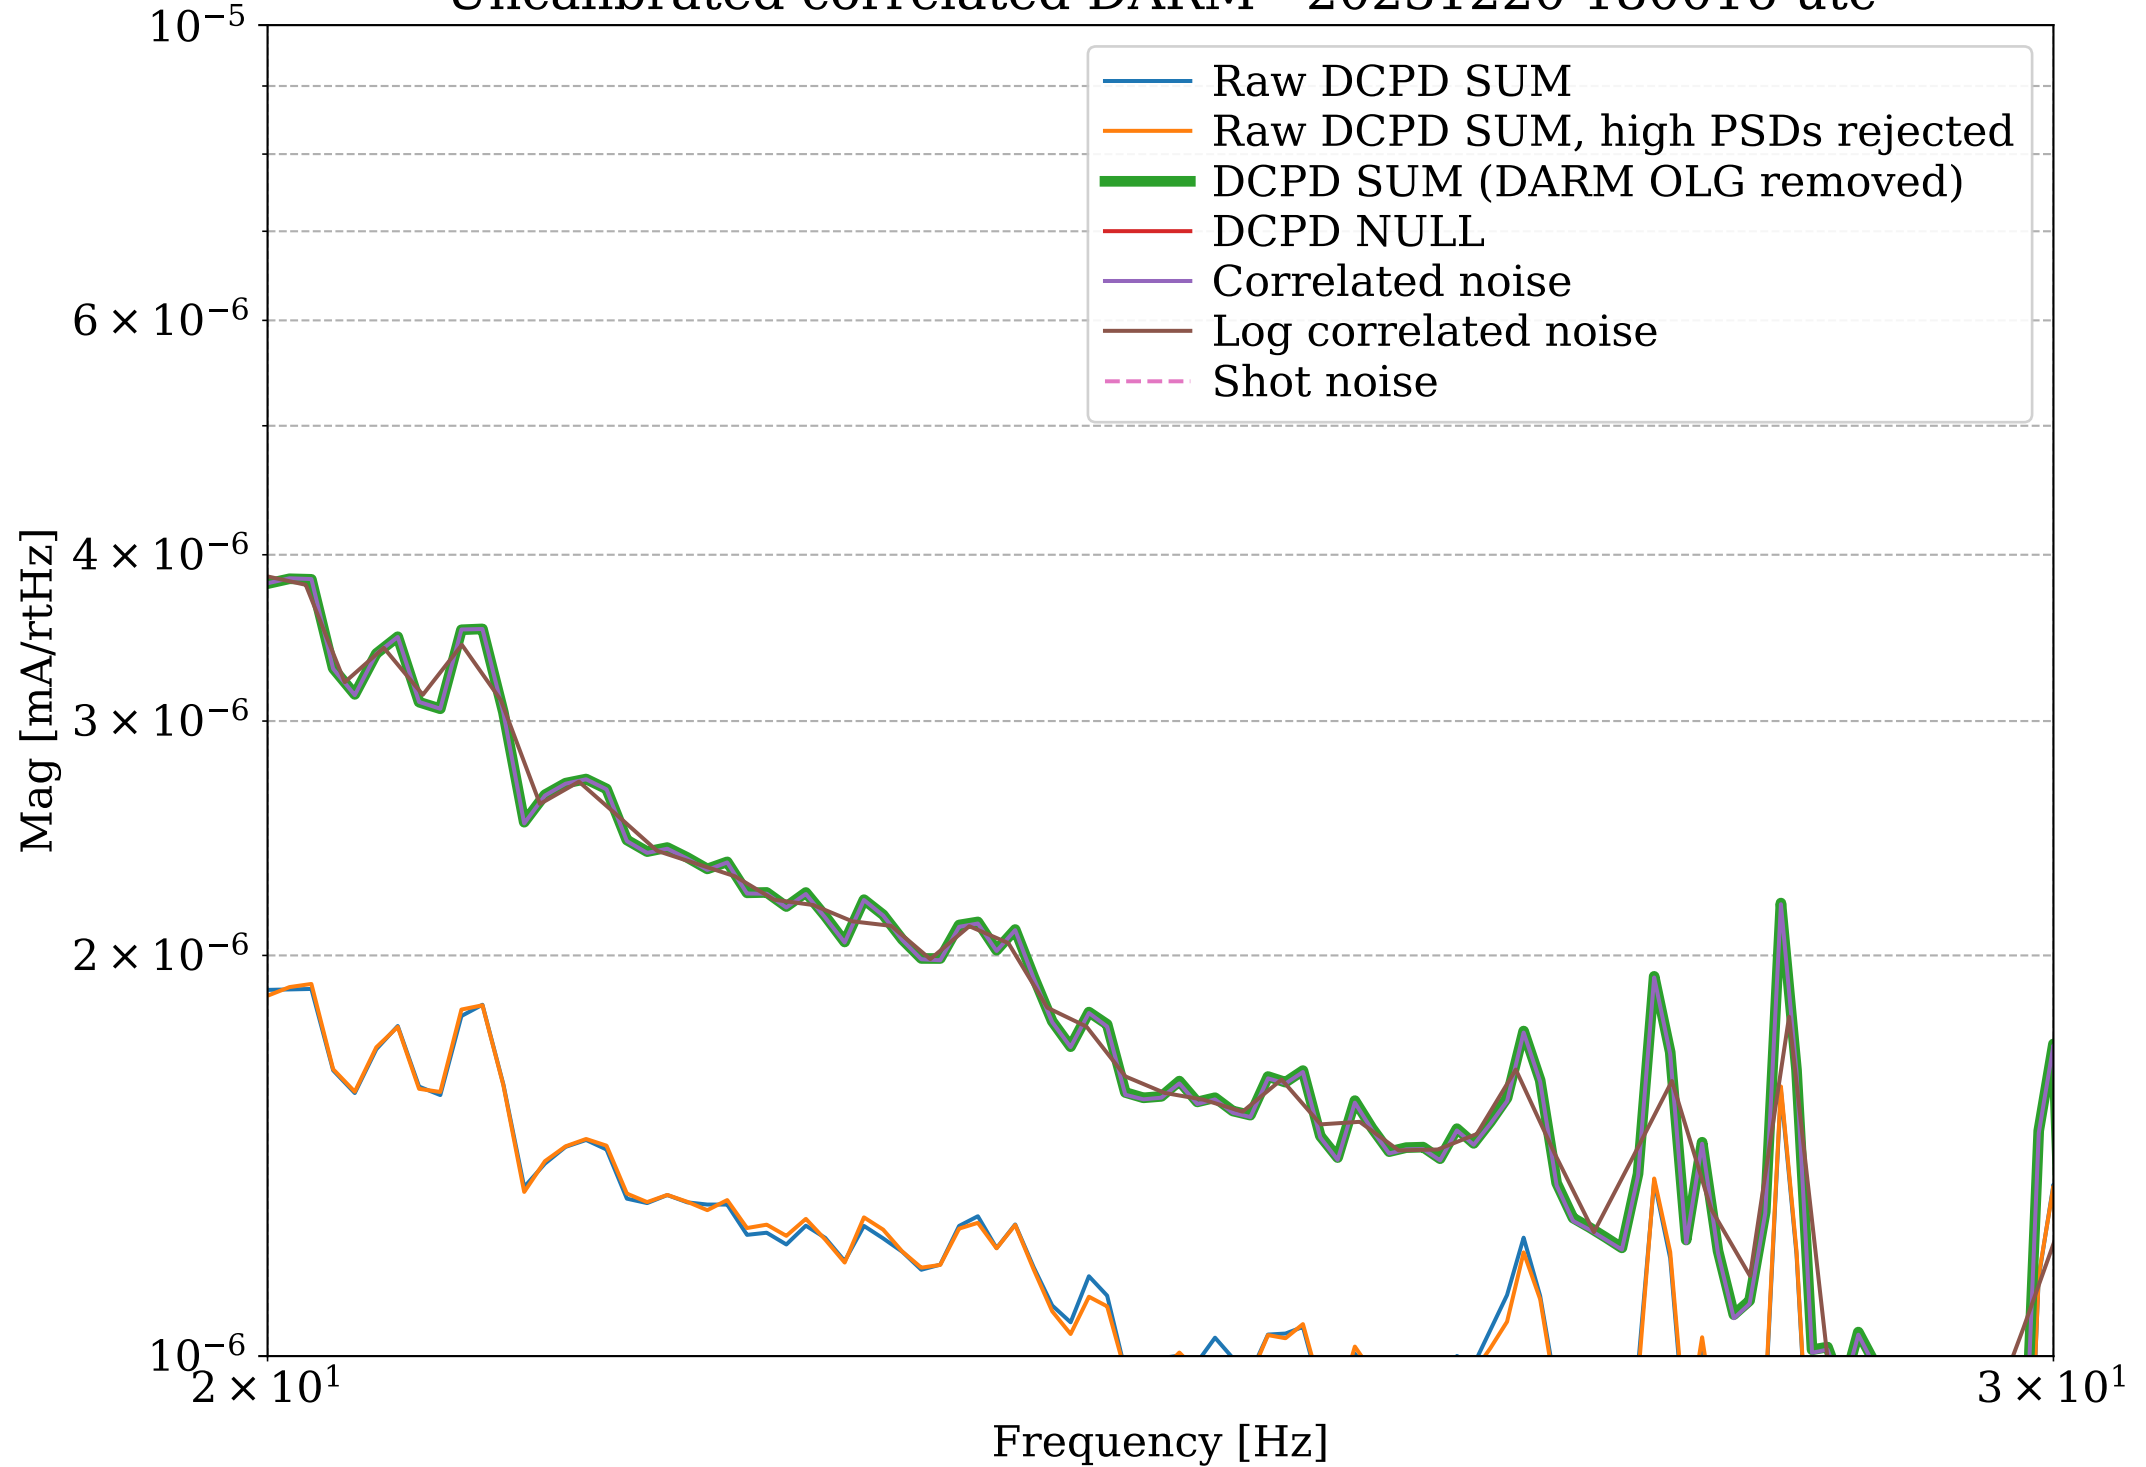

Correlated DARM - 20231220 180016 utc

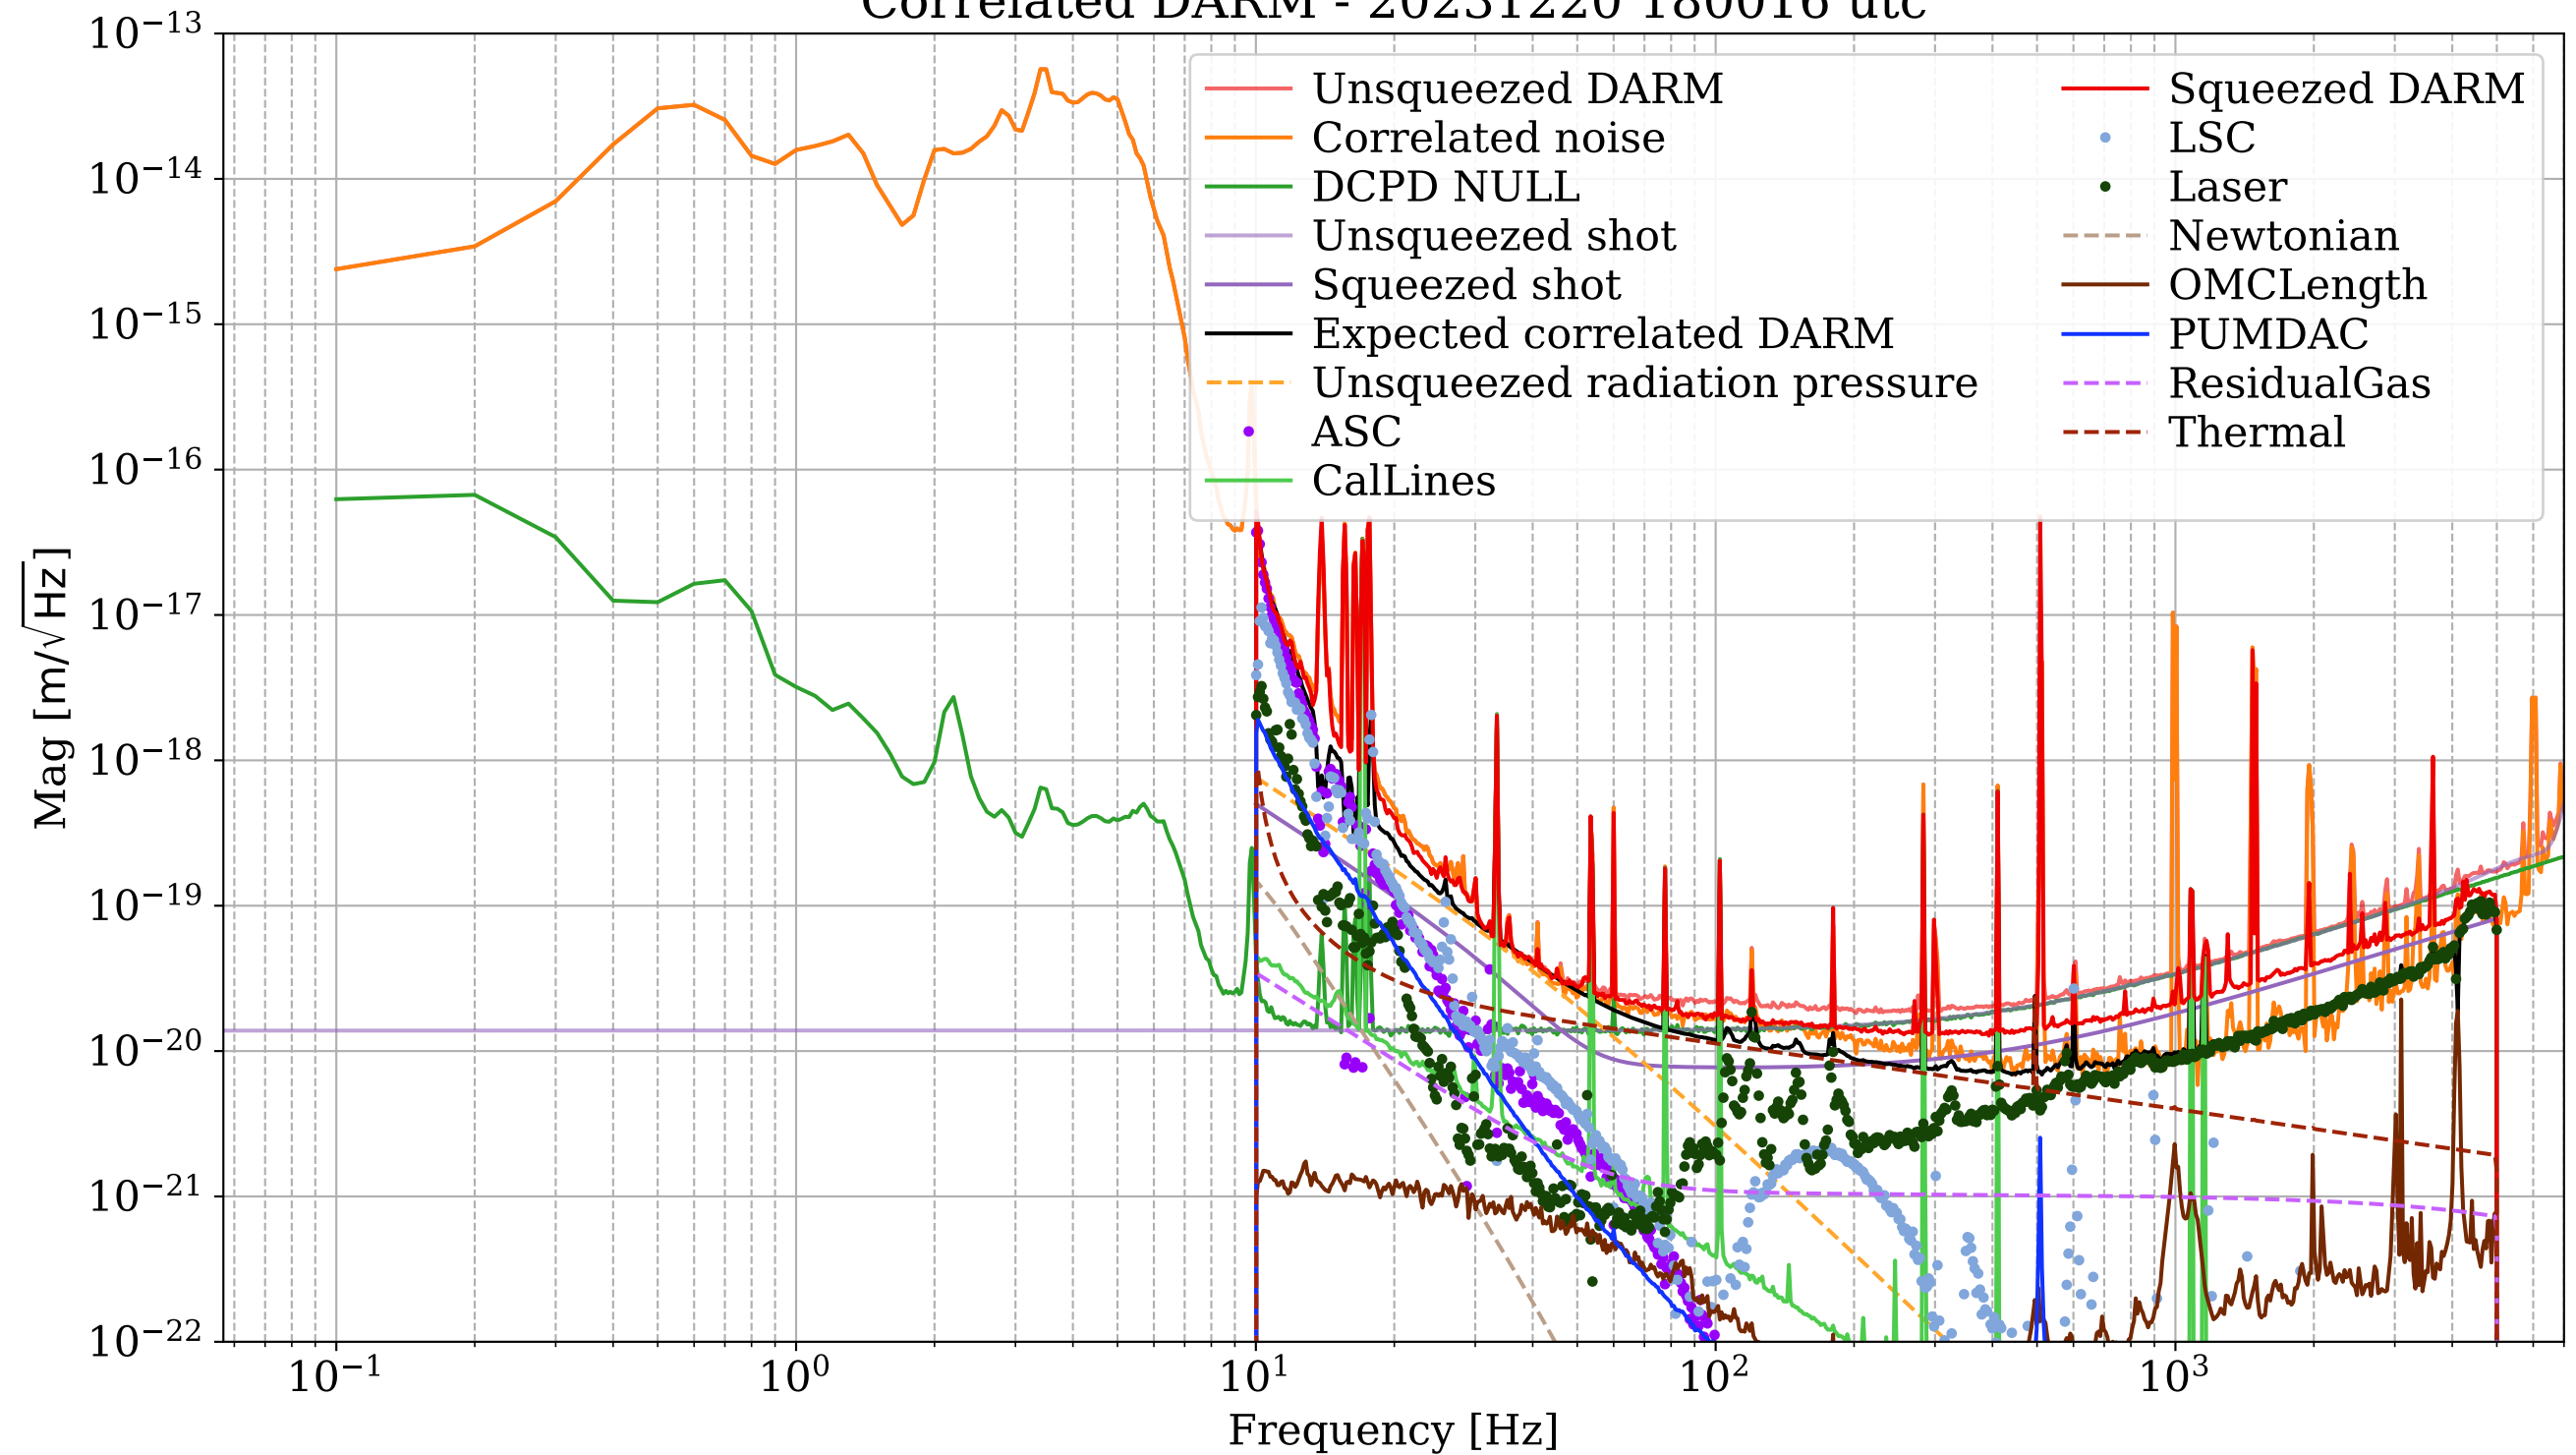

Correlated DARM - 20231220 180016 utc

